


# ACiQ™ A/C Only - Set Up

## Wire Connections

L1	208/240 Line Voltage
L2	
R	24 Volt - Hot Wire
C	24 Volt - Common Wire
Y1	Cooling Stage 1
Y2	Cooling Stage 2

## Dip Switch Settings

SW1-1	OFF (Down)
SW1-2	ON (Up)
SW1-3	ON (Up)
SW1-4	OFF (Down)

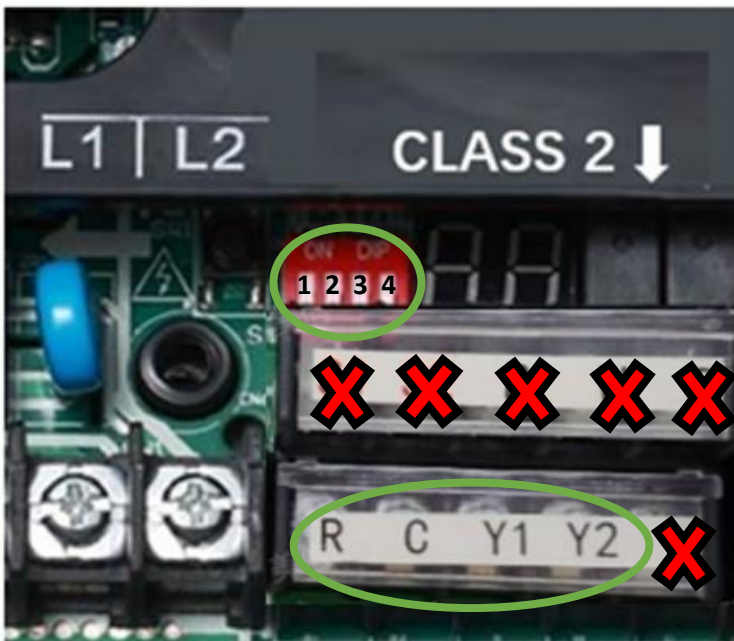

DIP switches must be changed while unit is powered off.

Outdoor circuit board is powered by DC voltage NOT the indoor step down transformer.

Remove outdoor disconnect and let unit sit for 5 minutes before touching outdoor circuitboard.