



Submittal Data Sheet

Indoor Unit Model#: EZ-24W-HP230B

Outdoor Unit Model#: EZ-24Z-HP230B

24K DIYCOOL R454B Std. Heat Mini-Split System

Location:	Approval:
Engineer:	Date:
Submitted to:	Construction:
Submitted by:	Unit #:
Reference:	Drawing #:



INDOOR UNIT SPECIFICATIONS

Indoor Air Flow (Turbo/H/M/L/Si) (CFM)		729.9 / 547.4 / 400.2 / 329.6 / NA
Indoor Noise Level (Turbo/H/M/L/Si) (dBA)		51.5 / 45.5 / 40.5 / 26.5 / 21.5
Dimension (W×D×H)	inch	42.60 x 9.21 x 13.27
	mm	1082 x 234 x 337
Package (W×D×H)	inch	45.47 x 16.34 x 12.40
	mm	1155 x 415 x 315
Net/Gross Weight	lbs	35.49 / 49.60
	kg	16.1 / 22.5

OUTDOOR UNIT SPECIFICATIONS

Compressor Type		ROTARY
Compressor Model		KTM240D46UKT2
Refrigerant		R454B
Refrigerant Oil Charge (mL)		620
Refrigerant Oil		VG74
Outdoor Air Flow (Max) (CFM)		3000
Outdoor Noise Level (dBA)		61
Dimension (W×D×H)	inch	35.04 x 13.46 x 26.50
	mm	890 x 342 x 673
Package (W×D×H)	inch	39.17 x 15.67 x 29.13
	mm	995 x 398 x 740
Net/Gross Weight	lbs	95.90 / 117.73
	kg	43.5 / 53.4

EFFICIENCY RATINGS

Cooling		Heating	
SEER2	18.9	HSPF2-4	8.7
EER2	9.7	COP	3.20

COOLING PERFORMANCE

Cooling (Btu/hr)	
Rated Capacity	24000
Min/Max Capacity	6000 ~ 26500
Moisture Removal (L/h)	3.11
Standard Operating Range (°F/°C)	-13 ~ 75 (-15 ~ 50)
Conditions:	Indoor: 80°F DB/67°F WB Outdoor: 95°F DB/75°F WB

HEATING PERFORMANCE

Heating (Btu/hr)	
1. @ 47°F Rated Capacity	25000
1. @ 47°F Min/Max Capacity	6200 ~ 28300
2. @ 17°F Rated Capacity	16300
3. @ 5°F Rated: Capacity / COP	17000 / 2.08
3. @ 5°F Max: Capacity	16100
Standard Operating Range (°F/°C)	-13 ~ 122 (-25 ~ 24)
1. Conditions:	Indoor: 70°F DB/60°F WB Outdoor: 47°F DB/43°F WB
2. Conditions:	Indoor: 70°F DB/60°F WB Outdoor: 17°F DB/15°F WB
3. Conditions	Indoor: 70°F DB/60°F WB Outdoor: 5°F DB/5°F WB


ELECTRICAL SPECIFICATIONS

Power Supply	208/230V, 60Hz, 1Ph
System MCA	19
Connection Wiring	14#x4
System MOCP	20
Compressor RLA	13.8
Outdoor Fan Motor RLA	0.8
Outdoor Fan Motor W	80
Indoor Fan Motor RLA	0.6
Indoor Fan Motor W	58
System Power Input @ Cooling (W)	2474 (540 ~ 2800)
System Power Input @ Heating (W)	2290 (410 ~ 2600)
MCA: Min. circuit amps (A)	MOCP: Max. over current protection (A)
RLA: Rated load amps (A)	W: Fan motor rated output (W)

REFRIGERANT PIPING SPECIFICATIONS


Throttle type (Indoor)	N/A
Throttle type (Outdoor)	Throttle valve
Liquid Size	9.52mm (3/8in)
Gas Size	15.9mm (5/8in)
Max. Piping Length (ft/m)	164 (50)
Max. Height Difference (ft/m)	82 (25)
Max. Pre-charged Length (ft/m)	24.6 (7.5)
Refrigerant Pre-charged Amount (oz/g)	50.44 (1.43)
Additional Charge of Refrigerant ((oz/ft)/(g/m))	0.32 (30)
Connection Method	Connector

Indoor Unit Dimensions

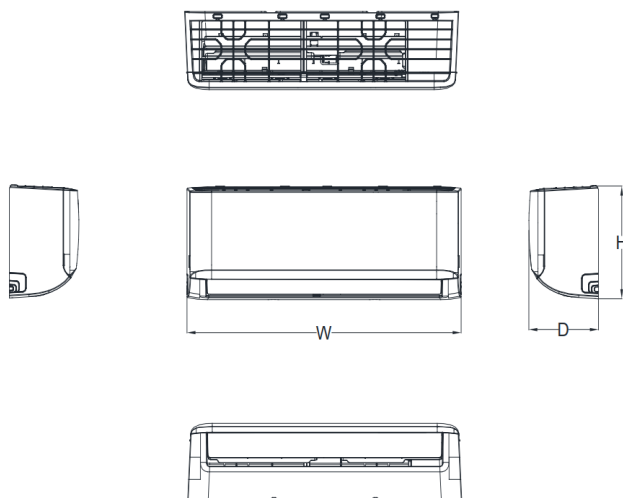


Capacity	Body Code	W(inch/mm)	D(mm/inch)	H(mm/inch)
9K	A	28-3/4in /729mm	7-7/8in /200mm	11-1/2in /292mm
12K	B	31-5/8in /802mm	7-7/8in /200mm	11-5/8in /295mm
18K	C	38-1/4in /971mm	9in/228mm	12-5/8in /321mm
24K	D	42-5/8in /1082mm	9-1/4in/234mm	13-1/4in /337mm


Indoor Unit Installation Instructions

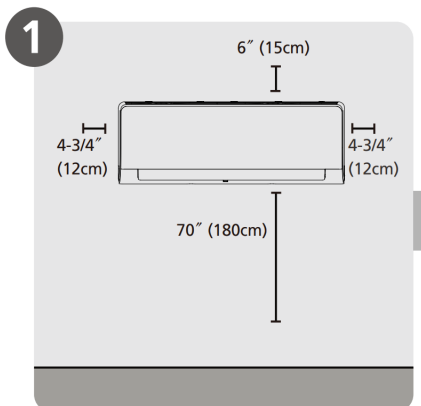

Select Installation Location

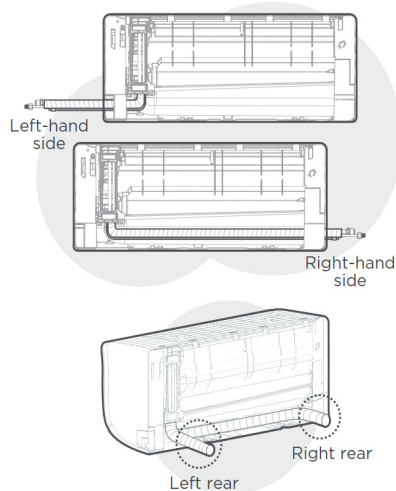


NOTE:
Based on the position of the wall hole relative to the mounting plate, choose the side from which the piping will exit the unit. You have four options for the exit direction of the piping.

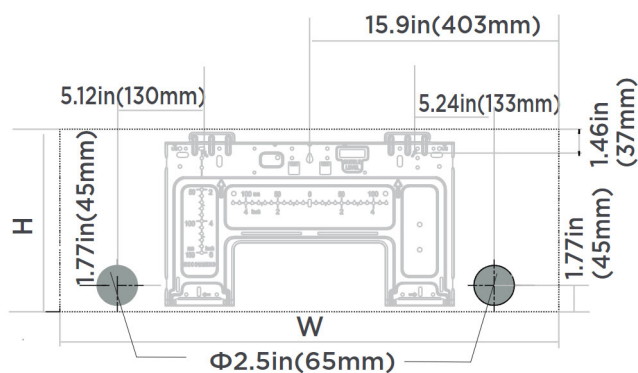


Indoor unit dimensions(WxH):
31.7in(806mm)x11.65in(296mm)

NOTE:
When the gas side connective pipe is Φ (5/8in) 16mm or more, the wall hole should be (3-1/2in) 90mm.

Outdoor Unit Dimensions

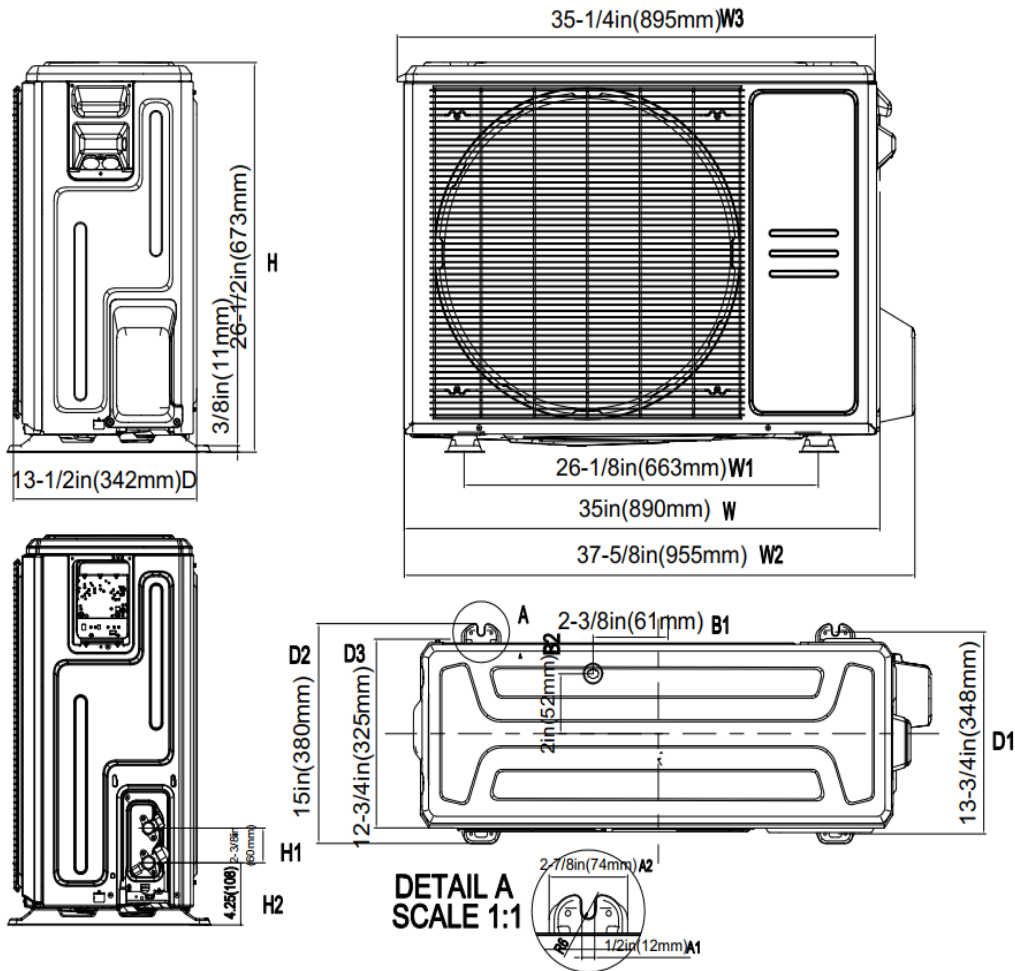

Outdoor Unit Installation Instructions

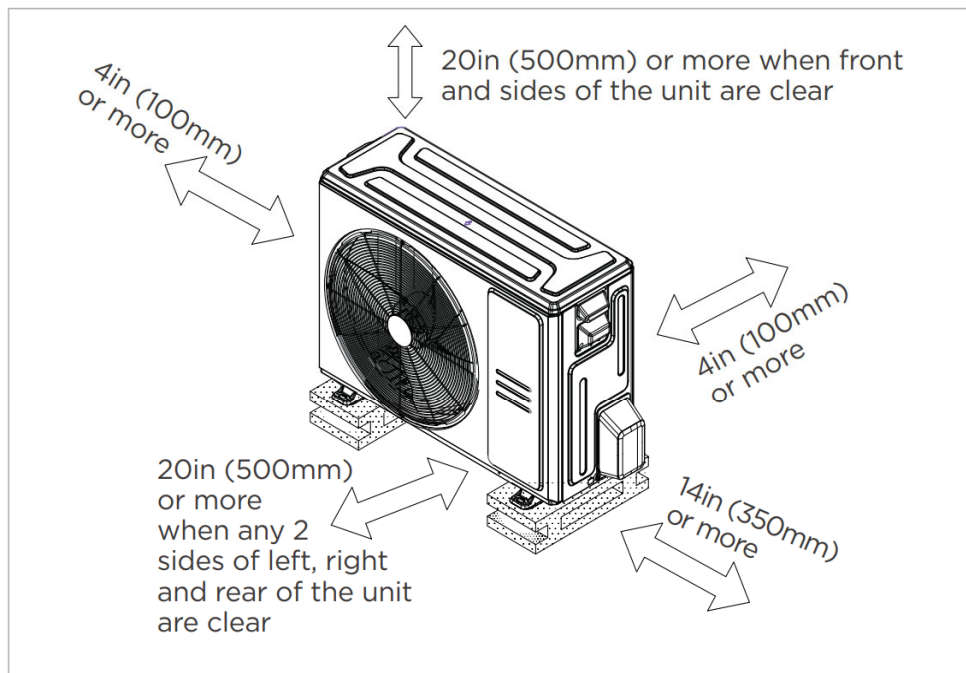

Meets all spatial requirements shown in Installation Clearance Requirements above.

Features

- Indoor unit TU1 copper coil
- Humidity control
- 1~100% fan speed setting
- WiFi capability: through WiFi dongle or wired controller with built-in WiFi
- OTA (by using WiFi dongle)
- Multiple control options available:
 - Two way communication wired controller:120N(X6)
 - Two way communication wired controller with built-in WiFi:120N(X6W)
 - Infrared wired controller: 120L
 - Wireless remote controller
 - Third-Party 24V Thermostat*

*24V interface is required.