

Up to 14.0 SEER, 11.5 EER, PACKAGE GAS / ELECTRIC UNIT
208/230-1-60, Single Phase, 2-5 Nominal Tons (Sizes 24-60)
208/230-3-60 & 460-3-60, Three Phase, 3-5 Nominal Tons (Sizes 36-60)

REFRIGERATION CIRCUIT

- Environmentally balanced R-410A refrigerant
- Copper tube/aluminum fin condenser and evaporator coils
- Dehumidification mode (airflow reduction) on all models

EASY TO INSTALL AND SERVICE

- Installs easily on a rooftop or at ground level
- Easy three-panel accessibility for maintenance and installation
- Easily converts to down discharge applications
- Combination gas heating and electric cooling
- Low NOx units available

BUILT TO LAST

- Induced-draft combustion and venting
- Pre-painted steel cabinet
- Direct spark ignition
- High efficiency ECM indoor blower motor on all models
- Vertical condenser fan discharge
- Full perimeter steel base rails
- High pressure switch (and low pressure switch – 24 & 30 size) for added compressor reliability
- Cabinet air leakage of 2.0% or less at 0.5 in. W.C. when tested in accordance with ASHRAE standard 193 (Low cabinet air leakage FIOP models only) Models with factory installed options are identified with letters in the 11th and 12th positions in the model number
- Aluminized steel tubular heat exchanger and 2" spacing wire grilles on PGD4 models (00), Stainless Steel tubular heat exchanger and hail guard (3/8" spacing) wire grilles on PGS4 models
- Single phase models with factory installed tin-plated copper evaporator main tubes PGD4 (TP), PGS4 (GP), 3-phase models with standard evaporator tubes PGS4 (GP)
- Single and 3-phase models with factory installed option for low cabinet air leakage and tin-plated copper evaporator main tubes PGD4 (LC), PGS4 (GC)

LIMITED WARRANTY*

1-Phase PGS4 "G/H" Models

- 3 year No Hassle Replacement™ limited warranty
- 10 year parts limited warranty (including compressor and coils) with timely registration
- 5 year parts limited warranty and 20 year heat exchanger limited warranty if not registered within 90 days of original installation.

1-Phase PGD4 "G/H" Models

- 15 year heat exchanger limited warranty
- 10 year parts limited warranty (including compressor and coils) with timely registration
- 5 year parts limited warranty and 15 year heat exchanger limited warranty if not registered within 90 days of original installation.

3-Phase PGS4, PGD4 "E" Models

- 10 year heat exchanger limited warranty
- 5 year compressor limited warranty
- 1 year parts limited warranty

* See warranty certificate for complete details and restrictions



PGD4 – Representative model only, some models may vary in appearance.



Use of the AHRI Certified TM Mark indicates a manufacturer's participation in the program. For verification of certification for individual products, go to www.ahridirectory.org.

UNIT PERFORMANCE DATA

| Aluminized Steel Heat Exchanger | Stainless Steel Heat Exchanger | COOLING | | | HEATING | | | Unit Dimensions Height x Width x Depth in (mm) | Operating Weight lbs (kg) |
|---------------------------------|--------------------------------|-------------------|------|------|----------------|----------------------|------|---|------------------------------|
| | | Capacity BTU/h | SEER | EER | Input BTU/h | Efficiency AFUE % | | | |
| | | | | | | 1Ø | 3Ø | | |
| PGD424040K**^# | PGS424040K**^# | 23,600 | 14.0 | 11.5 | 40,000 | 81.0 | - | 43 ³ / ₄ x 48 ³ / ₁₆ x 32 ⁵ / ₈ (1111 x 1224 x 829) | 304 (138) |
| PGD424060K**^# | PGS424060K**^# | 23,600 | 14.0 | 11.5 | 60,000 | 81.0 | - | | 304 (138) |
| PGD430040K**^# | PGS430040K**^# | 28,600 | 14.0 | 11.5 | 40,000 | 81.0 | - | 45 ³ / ₄ x 48 ³ / ₁₆ x 32 ⁵ / ₈ (1162 x 1224 x 829) | 320 (145) |
| PGD430060K**^# | PGS430060K**^# | 28,600 | 14.0 | 11.5 | 60,000 | 81.0 | - | | 320 (145) |
| PGD436060†**^# | PGS436060†**^# | 34,800 | 14.0 | 11.5 | 60,000 | 81.0 | 80.0 | 51 ³ / ₄ x 48 ³ / ₁₆ x 32 ⁵ / ₈ (1315 x 1224 x 829) | 349 (158) |
| PGD436090†**^# | PGS436090†**^# | 34,800 | 14.0 | 11.5 | 90,000 | 81.0 | 79.3 | | 349 (158) |
| PGD442060†**^# | PGS442060†**^# | 40,000 | 14.0 | 11.5 | 60,000 | 81.0 | 78.5 | 44 ³ / ₄ x 48 ³ / ₁₆ x 44 ¹ / ₈ (1137 x 1224 x 1123) | 413 (187) |
| PGD442090†**^# | PGS442090†**^# | 40,000 | 14.0 | 11.5 | 90,000 | 81.0 | 80.4 | | 413 (187) |
| PGD448090†**^# | PGS448090†**^# | 48,000 | 14.0 | 11.5 | 90,000 | 81.0 | 80.4 | 52 ³ / ₄ x 48 ³ / ₁₆ x 44 ¹ / ₈ (1340 x 1224 x 1123) | 438 (199) |
| PGD448115†**^# | PGS448115†**^# | 48,000 | 14.0 | 11.5 | 115,000 | 81.0 | 80.3 | | 438 (199) |
| PGD448130†**^# | PGS448130†**^# | 48,000 | 14.0 | 11.5 | 127,000 | 81.0 | - | | 438 (199) |
| PGD460090†**^# | PGS460090†**^# | 56,000 | 14.0 | 11.5 | 90,000 | 81.0 | 80.4 | 54 ³ / ₄ x 48 ³ / ₁₆ x 44 ¹ / ₈ (1391 x 1224 x 1123) | 455 (206) |
| PGD460115†**^# | PGS460115†**^# | 56,000 | 14.0 | 11.5 | 115,000 | 81.0 | 80.3 | | 455 (206) |
| PGD460130†**^# | PGS460130†**^# | 56,000 | 14.0 | 11.5 | 127,000 | 81.0 | - | | 455 (206) |

† K = 208/230-1-60, H = 208/230-3-60, L = 460-3-60

** PGD4 - 00 = Standard, LC = Low cabinet air leakage plus Tin-Plated Copper Evaporator Main Tubes, TP = Tin-Plated Copper Evaporator Main Tubes (single phase)

PGS4 - GC = Low cabinet air leakage plus Tin-Plated Copper Evaporator Main Tubes plus Stainless Steel Heat Exchanger, GP(1-phase) or GP(3-phase) = Tin-Plated Evaporator Main Tubes plus Stainless Steel Heat Exchanger

^ 0 = Standard, 1 = Low Nox

G or H = 1-phase series, E = 3-phase series

MODEL NUMBER NOMENCLATURE

| MODEL NOMENCLATURE | | | | | | | | | | | |
|---|----------|----------|----------|----------|-----------|------------|----------|-----------|----------|----------|----------|
| MODEL SERIES | 1 | 2 | 3 | 4 | 5,6 | 7,8,9 | 10 | 11,12 | 13 | 14 | 15 |
| | P | G | D | 4 | 36 | 090 | K | 00 | 0 | E | 1 |
| P = Package | | | | | | | | | | | |
| G = Gas/Electric | | | | | | | | | | | |
| D = Standard | | | | | | | | | | | |
| S = Mainline w/ SS HX | | | | | | | | | | | |
| 3 = 13 | | | | | | | | | | | |
| 4 = 14 | | | | | | | | | | | |
| 5 = 15 | | | | | | | | | | | |
| 24 = 24,000 BTUH = 2 Tons | | | | | | | | | | | |
| 30 = 30,000 BTUH = 2.5 Tons | | | | | | | | | | | |
| 36 = 36,000 BTUH = 3 Tons | | | | | | | | | | | |
| 42 = 42,000 BTUH = 3.5 Tons | | | | | | | | | | | |
| 48 = 48,000 BTUH = 4 Tons | | | | | | | | | | | |
| 60 = 60,000 BTUH = 5 Tons | | | | | | | | | | | |
| 000 = no factory heat | | | | | | | | | | | |
| 040 = 40,000 BTU/hr | | | | | | | | | | | |
| 060 = 60,000 BTU/hr | | | | | | | | | | | |
| 090 = 90,000 BTU/hr | | | | | | | | | | | |
| 115 = 115,000 BTU/hr | | | | | | | | | | | |
| 130 = 127,000 or 130,000 BTU/hr | | | | | | | | | | | |
| K = 208/230-1-60 | | | | | | | | | | | |
| H = 208/230-3-60 | | | | | | | | | | | |
| L = 460-3-60 | | | | | | | | | | | |
| 00 = No options | | | | | | | | | | | |
| TP = Tin Coated Copper Evap Main Tubes (single phase) | | | | | | | | | | | |
| GC = Low Cabinet Air Leakage plus Tin Coated Copper Evap Main Tubes (PGS4) | | | | | | | | | | | |
| GP = Tin Coated Copper Evap Main Tubes plus Stainless Steel Heat Exchanger (single phase) | | | | | | | | | | | |
| LC = Low Cabinet Air Leakage plus Tin Coated Copper Evap Main Tubes (PGD4) | | | | | | | | | | | |
| 0 = Standard | | | | | | | | | | | |
| 1 = Low NOx | | | | | | | | | | | |
| Sales Model Digit | | | | | | | | | | | |
| Engineering Digit | | | | | | | | | | | |

For California Residents:

For installation in SCAQMD only: This furnace does not meet the SCAQMD Rule 1111 14 ng/J NOx emission limit, and thus is subject to a mitigation fee of up to \$450. This furnace is not eligible for the Clean Air Furnace Rebate Program: www.CleanAirFurnaceRebate.com

AHRI* CAPACITIES

Cooling Capacities and Efficiencies

| UNIT SIZE | NOMINAL TONS | STANDARD CFM | COOLING CAPACITY | EER | SEER |
|-----------|--------------|--------------|------------------|------|------|
| 24 | 2 | 800 | 23000 | 11.5 | 14.0 |
| 30 | 2.5 | 1000 | 28600 | 11.5 | 14.0 |
| 36 | 3 | 1150 | 34800 | 11.5 | 14.0 |
| 42 | 3.5 | 1350 | 40000 | 11.5 | 14.0 |
| 48 | 4 | 1550 | 46000 | 11.5 | 14.0 |
| 60 | 5 | 1750 | 56000 | 11.5 | 14.0 |

LEGEND

dB—Sound Levels (decibels)

db—Dry Bulb

SEER—Seasonal Energy Efficiency Ratio

wb—Wet Bulb

COP—Coefficient of Performance

* Air Conditioning, Heating & Refrigeration Institute.

**At "A" conditions—80°F (26.7°C) indoor db/67°F (19.4°C) indoor wb & 95°F (35°C) outdoor db.

† Rated in accordance with U.S. Government DOE Department of Energy) test procedures and/or AHRI Standards 210/240.

Notes:

1. Ratings are net values, reflecting the effects of circulating fan heat.

Ratings are based on:

Cooling Standard: 80°F (26.7°C) db, 67°F wb (19.4°C) indoor entering—air temperature and 95°F db (35°C) outdoor entering—air temperature.

2. Before purchasing this appliance, read important energy cost and efficiency information available from your retailer.

Gas Heating Capacities and Efficiencies, Single Phase Models

| UNIT SIZE | HEATING INPUT (Btuh) | OUTPUT CAPACITY (Btuh) | TEMPERATURE RISE RANGE °F (°C) | AFUE (%) |
|----------------------------------|----------------------|--------------------------------------|--------------------------------|----------|
| 24040 30040 | 40,000 | 33,000 | 25-55 (14-31) | 81.0 |
| 24060 30060 36060 42060 | 60,000 | 49,000 | 25-55 (14-31) | 81.0 |
| 36090 42090 48090 60090 | 90,000 | 73,000 74,000 74,000 74,000 | 35-65 (19-36) | 81.0 |
| 48115 60115 | 115,000 | 94,000 | 30-60 (17-33) | 81.0 |
| 48130 60130 | 127,000 | 104,000 | 35-65 (19-36) | 81.0 |

LEGEND

AFUE—Annual Fuel Utilization Efficiency

NOTE: Before purchasing this appliance, read important energy cost and efficiency information available from your retailer.

Gas Heating Capacities and Efficiencies, Three Phase Models

| UNIT SIZE | HEATING INPUT (Btuh) | OUTPUT CAPACITY (Btuh) | TEMPERATURE RISE RANGE °F (°C) | AFUE (%) |
|----------------------------------|----------------------|--------------------------------------|--------------------------------|------------------------------|
| 36060 42060 | 60,000 | 48,000 47,000 | 25-55 (14-31) | 80.0 78.5 |
| 36090 42090 48090 60090 | 90,000 | 72,000 73,000 73,000 73,000 | 35-65 (19-36) | 79.3 80.4 80.4 80.4 |
| 48115 60115 | 115,000 | 93,000 | 30-60 (17-33) | 80.3 |
| 48130 60130 | 130,000 | 103,000 | 35-65 (19-36) | 78.9 |

LEGEND

AFUE—Annual Fuel Utilization Efficiency

NOTE: Before purchasing this appliance, read important energy cost and efficiency information available from your retailer.

A-Weighted Sound Power Level

| UNIT SIZE | SOUND RATING (dBA) | TYPICAL OCTAVE BAND SPECTRUM (dB, without tone adjustment) | | | | | | |
|-----------|--------------------|--|------|------|------|------|------|------|
| | | 125 | 250 | 500 | 1000 | 2000 | 4000 | 8000 |
| 24 | 69 | 71.5 | 71.0 | 64.0 | 61.3 | 60.0 | 57.6 | 49.0 |
| 30 | 72 | 76.3 | 70.5 | 67.8 | 64.4 | 63.8 | 61.4 | 54.3 |
| 36 | 72 | 74.5 | 71.7 | 68.9 | 68.0 | 62.6 | 57.9 | 52.5 |
| 42 | 72 | 73.0 | 71.1 | 68.9 | 68.4 | 62.6 | 57.6 | 53.2 |
| 48 | 72 | 75.4 | 70.7 | 68.9 | 67.4 | 62.6 | 59.9 | 56.7 |
| 60 | 72 | 81.3 | 72.6 | 68.2 | 65.4 | 62.9 | 59.0 | 54.4 |

NOTE: Tested in accordance with AHRI Standard 270-2008 (not listed in AHRI).

PHYSICAL DATA

| UNIT SIZE | 24040 | 24060 | 30040 | 30060 | 36060 | 36090 | 42060 | 42090 |
|---|------------------------------|------------|-------------|------------|------------|------------|---|------------|
| NOMINAL CAPACITY (ton) | 2 | 2 | 2-1/2 | 2-1/2 | 3 | 3 | 3-1/2 | 3-1/2 |
| SHIPPING WEIGHT lb. | 329 | 329 | 361 | 361 | 390 | 390 | 455 | 455 |
| SHIPPING WEIGHT (kg) | 149 | 149 | 164 | 164 | 177 | 177 | 206 | 206 |
| COMPRESSOR / QUANTITY | Rotary / 1 | | | | Scroll / 1 | | | |
| REFRIGERANT (R-410A) | | | | | | | | |
| Quantity lb. | 5.3 | 5.3 | 6.0 | 6.0 | 8.2 | 8.2 | 6.2 | 6.2 |
| Quantity (kg) | 2.4 | 2.4 | 2.7 | 2.7 | 3.7 | 3.7 | 2.8 | 2.8 |
| REFRIGERANT METERING DEVICE | Orifice | | | | TXV | | Orifice | |
| ORIFICE ID in. / mm | .059 / 1.5 | | .063 / 1.60 | | N/A | | .073 / 1.85 | |
| OUTDOOR COIL | | | | | | | | |
| Rows...Fins/in. | 1...21 | 1...21 | 1...21 | 1...21 | 1...21 | 1...21 | 1...21 | 1...21 |
| Face Area (sq ft) | 11.9 | 11.9 | 13.6 | 13.6 | 18.8 | 18.8 | 13.6 | 13.6 |
| OUTDOOR FAN | | | | | | | | |
| Nominal CFM | 2500 | 2500 | 2700 | 2700 | 3200 | 3200 | 3600 | 3600 |
| Diameter in. | 24 | 24 | 24 | 24 | 24 | 24 | 26 | 26 |
| Diameter (mm) | 609.6 | 609.6 | 609.6 | 609.6 | 609.6 | 609.6 | 660.4 | 660.4 |
| Motor Hp (Rpm) | 1/10 (810) | 1/10 (810) | 1/10 (810) | 1/10 (810) | 1/5 (810) | 1/5 (810) | 1/5 (810) | 1/5 (810) |
| INDOOR COIL | | | | | | | | |
| Rows...Fins/in. | 3...17 | 3...17 | 3...17 | 3...17 | 3...17 | 3...17 | 3...17 | 3...17 |
| Face Area (sq ft) | 3.7 | 3.7 | 3.7 | 3.7 | 3.7 | 3.7 | 4.7 | 4.7 |
| INDOOR BLOWER | | | | | | | | |
| Nominal Cooling Airflow (Cfm) | 800 | 800 | 1000 | 1000 | 1150 | 1150 | 1350 | 1350 |
| Size in. | 10x10 | 10x10 | 10x10 | 10x10 | 11x10 | 11x10 | 11x10 | 11x10 |
| Size (mm.) | 254x254 | 254x254 | 254x254 | 254x254 | 279.4x254 | 279.4x254 | 279.4x254 | 279.4x254 |
| Motor HP (RPM) | 1/2 (1050) | 1/2 (1050) | 1/2 (1050) | 1/2 (1050) | 3/4 (1000) | 3/4 (1000) | 1/2 (1050) | 1/2 (1050) |
| FURNACE SECTION* | | | | | | | | |
| Burner Orifice No. (Qty...Drill Size) | | | | | | | | |
| 1 Phase Natural Gas (Factory Installed) | 2...44 | 3...44 | 2...44 | 3...44 | 3...44 | 3...38 | 3...44 | 3...38 |
| 1 Phase Propane Gas | 2...55 | 3...55 | 2...55 | 3...55 | 3...55 | 3...53 | 3...55 | 3...53 |
| 3 Phase Natural Gas (Factory Installed) | | | 2...44 | 2...38 | 2...38 | 3...38 | 2...38 | 3...38 |
| 3 Phase Propane Gas | | | 2...55 | 2...53 | 2...53 | 3...53 | 2...53 | 3...53 |
| HIGH-PRESSURE SWITCH (psig) Cut-out Reset (Auto) | 650 +/- 15 420 +/- 25 | | | | | | | |
| LOSS-OF-CHARGE / LOW-PRESSURE SWITCH (Liquid Line) (psig) cut-out Reset (auto) | 50 +/- 7 95 +/- 7 | | | | N/A | | | |
| RETURN-AIR FILTERS†‡ | | | | | | | 1 each 24x14x1 610x356x25 24x15x1 610x406x25 | |
| Throwaway Size in. (mm) | 2 each 20x12x1 508x305x25 | | | | | | | |

*Based on altitude of 0 to 2000 ft (0-610 m).

† Required filter sizes shown are based on the larger of the AHRI (Air Conditioning Heating and Refrigeration Institute) rated cooling airflow or the heating airflow velocity of 300 to 350 ft/minute for throwaway type. Air filter pressure drop for non-standard filters must not exceed 0.08 IN. W.C.

‡ If using accessory filter rack refer to the filter rack installation instructions for correct filter sizes and quantity.

PHYSICAL DATA

| UNIT SIZE | 48090 | 48115 | 48130 | 60090 | 60115 | 60130 |
|---|---|------------|------------|---|------------|------------|
| NOMINAL CAPACITY (ton) | 4 | 4 | 4 | 5 | 5 | 5 |
| SHIPPING WEIGHT lb | 480 | 480 | 480 | 497 | 497 | 497 |
| SHIPPING WEIGHT kg | 218 | 218 | 218 | 225 | 225 | 225 |
| COMPRESSOR / QUANTITY | Scroll / 1 | | | | | |
| REFRIGERANT (R-410A) | | | | | | |
| Quantity lb | 9.2 | 9.2 | 9.2 | 9.8 | 9.8 | 9.8 |
| Quantity (kg.) | 4.2 | 4.2 | 4.2 | 4.4 | 4.4 | 4.4 |
| REFRIGERANT METERING DEVICE | Orifice | | | | | |
| ORIFICE ID in./mm | .080 / 2.03 | | | .084 / 2.14 | | |
| OUTDOOR COIL | | | | | | |
| Rows...Fins/in. | 1...21 | 1...21 | 1...21 | 1...21 | 1...21 | 1...21 |
| Face Area (sq ft) | 21.4 | 21.4 | 21.4 | 23.3 | 23.3 | 23.3 |
| OUTDOOR FAN | | | | | | |
| Nominal Cfm | 3600 | 3600 | 3600 | 4200 | 4200 | 4200 |
| Diameter in. | 26 | 26 | 26 | 26 | 26 | 26 |
| Diameter (mm) | 660.4 | 660.4 | 660.4 | 660.4 | 660.4 | 660.4 |
| Motor Hp (Rpm) | 1/5 (810) | 1/5 (810) | 1/5 (810) | 1/5 (810) | 1/5 (810) | 1/5 (810) |
| INDOOR COIL | | | | | | |
| Rows...Fins/in. | 3...17 | 3...17 | 3...17 | 3...17 | 3...17 | 3...17 |
| Face Area (sq ft) | 4.7 | 4.7 | 4.7 | 5.6 | 5.6 | 5.6 |
| INDOOR BLOWER | | | | | | |
| Nominal Cooling Airflow (Cfm) | 1550 | 1550 | 1550 | 1750 | 1750 | 1750 |
| Size in. | 11x10 | 11x10 | 11x10 | 11x10 | 11x10 | 11x10 |
| Size (mm) | 279.4x254 | 279.4x254 | 279.4x254 | 279.4x254 | 279.4x254 | 279.4x254 |
| Motor HP (RPM) | 1.0 (1075) | 1.0 (1075) | 1.0 (1075) | 1.0 (1040) | 1.0 (1040) | 1.0 (1040) |
| FURNACE SECTION* | | | | | | |
| Burner Orifice No. (Qty...Drill Size) | | | | | | |
| 1 & 3 Phase Natural Gas (Factory Installed) | 3...38 | 3...33 | 3...31 | 3...38 | 3...33 | 3...31 |
| 1 & 3 Phase Propane Gas | 3...53 | 3...51 | 3...49 | 3...53 | 3...51 | 3...49 |
| HIGH-PRESSURE SWITCH (psig) Cut-out Reset (Auto) | 650 +/- 15 420 +/- 25 | | | | | |
| LOSS-OF CHARGE / LOW-PRESSURE SWITCH (Liquid Line) (psig) cut-out Reset (auto) | N/A | | | | | |
| RETURN-AIR FILTERS Throwaway†‡ in. mm | 1 each 24x14x1 610x356x25 24x15x1 610x406x25 | | | 1 each 24x16x1 610x406x25 24x18x1 610x457x25 | | |

*Based on altitude of 0 to 2000 ft (0-610 m).

† Required filter sizes shown are based on the larger of the AHRI (Air Conditioning Heating and Refrigeration Institute) rated cooling airflow or the heating airflow velocity of 300 to 350 ft/minute for throwaway type. Air filter pressure drop for non-standard filters must not exceed 0.08 IN. W.C.



‡ If using accessory filter rack refer to the filter rack installation instructions for correct filter sizes and quantity.

OPTIONS AND ACCESSORIES


| ITEM | DESCRIPTION | FACTORY INSTALLED OPTION | FIELD INSTALLED ACCESSORY |
|---------------------------------------|---|--------------------------|---------------------------|
| Compressor Start Kit | Compressor Start Kit assists compressor start-up by providing additional starting torque on single phase units only. | | X |
| Corporate Thermostats | Thermostats provide control for the system heating and cooling functions. | | X |
| Crankcase Heater | Crankcase Heater provides anti-floodback protection for low-load cooling applications. | | X* |
| Economizer | Horizontal Economizer with solid state controls and barometric relief dampers includes filter racks and provide outdoor air during cooling and reduce compressor operation. | | X |
| | Vertical Economizer with solid state controls and barometric relief dampers includes filter racks and provide outdoor air during cooling and reduce compressor operation. | | X |
| Filter Rack | Filter Rack features easy installation, serviceability, and high-filtering performance for vertical or horizontal applications. Includes 1-in. filter. | | X |
| Flat Roof Curbs | Flat Roof Curbs in 14-in. (356 mm) sizes are available for roof mounted applications. | | X |
| Flue Discharge Deflector | Directs flue gas exhaust 90 degrees upward from current discharge. | | X |
| High Altitude Propane Conversion Kit | High Altitude Propane Conversion Kit is for use at 2001 to 6000 ft. (611–1829 m) above sea level. Kit consists of propane gas orifices that compensate for gas heat operation at high altitude. | | X |
| Low Ambient Kit | Low Ambient Kit (Motormaster II Control) allows the use of mechanical cooling down to outdoor temperatures as low as 0°F (-18°C) when properly installed. | | X |
| Manual Outside Air Damper | Manual Outside Air Damper includes hood and filter rack with adjustable damper blade for up to 25% outdoor air. | | X |
| Natural to Propane Gas Conversion Kit | Natural to Propane Gas Conversion Kit allows for conversion from natural gas to propane gas (0–2000 ft) (0–610 m) | | X |
| Propane to Natural Gas Conversion Kit | Propane to Natural Gas Conversion Kit allows for conversion from propane to natural gas for altitudes of 0–2000 ft (0–610 m) | | X |
| Square-to-Round Duct Transition Kit | Square-to-Round Duct Transition Kit enable 24–48 size units to be fitted to 14 in. (356 mm) round ductwork. | | X |
| Cabinet leakage | Cabinet air leakage less than 2.0% at 0.5 in. W.C. when tested in accordance with ASHRAE standard 193. | X | |
| Outdoor Coil Dense Metal Wire Grille | 3/8" spacing Dense Metal Wire Grille provide hail and vandalism protection. Factory installed on PGS4, field installed on PGD4. | X | X |
| Low Pressure Switch Kit | This kit is designed for use when a low pressure control is desired. | | X |

*Refer to Price Page for application detail.



ECONOMIZER

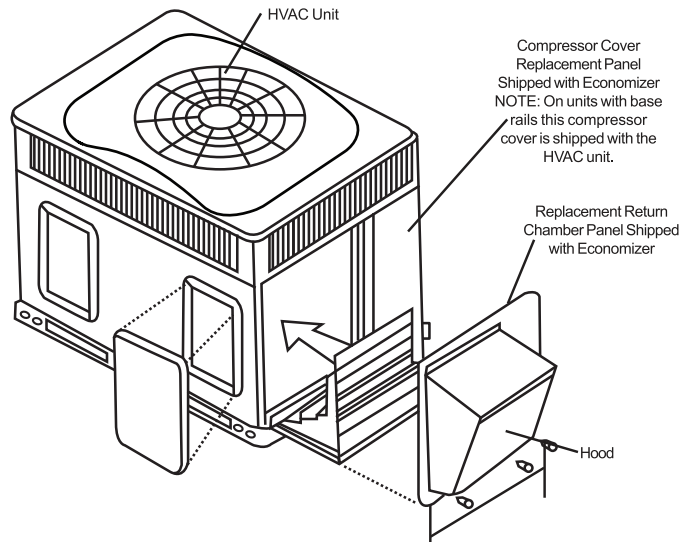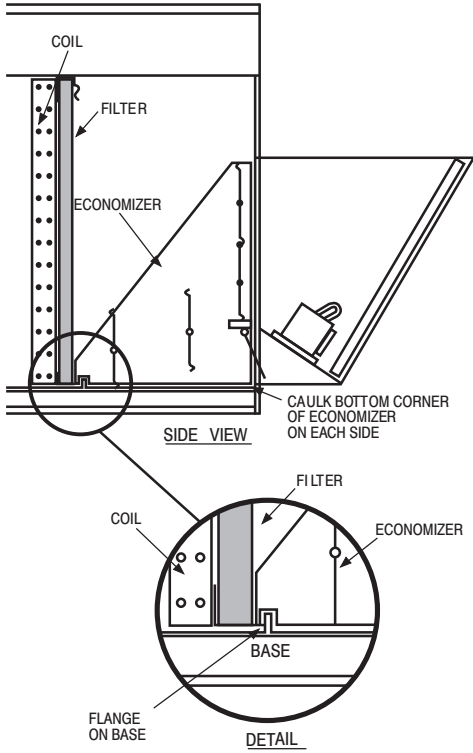

Vertical Economizer

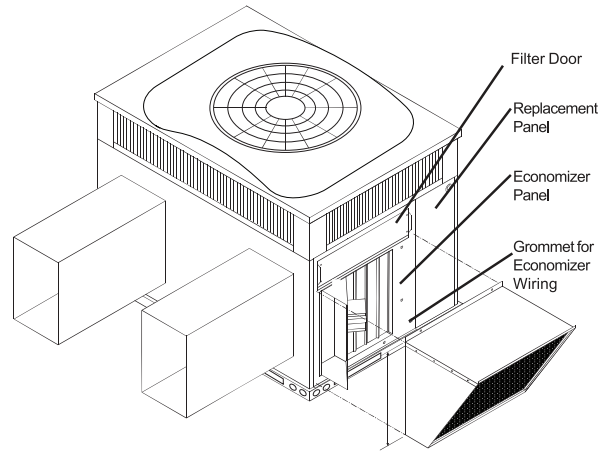

Horizontal Economizer

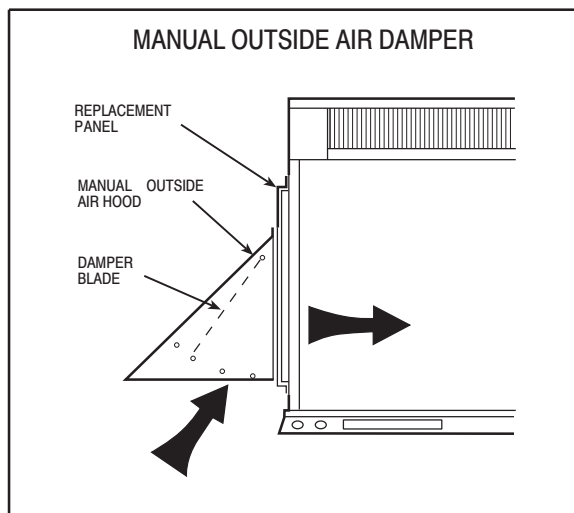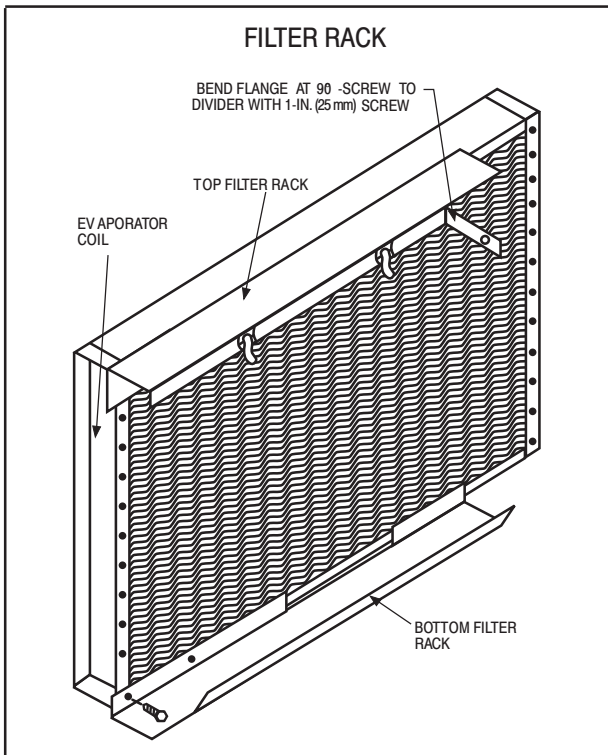


A09375

UNIT DIMENSIONS - 24-36

| UNIT | ELECTRICAL CHARACTERISTICS | | | UNIT WT. | | UNIT HEIGHT | | | CENTER OF GRAVITY | | | | |
|---|----------------------------|------|-------|----------|-------|-------------|------|----------|-------------------|---------|-------|----------|-------|
| | VOLTAGE | AMPS | PHASE | LB | KG | "A" | X | Y | Z | | | | |
| PGD/S1424/040/080/K100/GP/GS/TP10/1/1/G1 | 208/230 | 1-60 | 3 | 304 | 138.0 | 43-3/4 | 1111 | 22-13/16 | 579.4 | 15-5/16 | 388.9 | 15-11/16 | 398.5 |
| PGD/S1430/040/080/K100/GP/GS/TP10/1/1/H1 | 208/230 | 1-60 | 3 | 320 | 145.0 | 45-3/4 | 1162 | 22-13/16 | 579.4 | 15-5/16 | 388.9 | 15-13/16 | 401.6 |
| PGD/S1436/060/090/1K100/GP/GS/TP10/1/1/G1 | 208/230 | 3-60 | 3 | 349 | 158.0 | 51-3/4 | 1315 | 22-13/16 | 579.4 | 15-5/16 | 388.9 | 16-5/8 | 422.3 |
| PGD/S1436/060/090/1K100/GP/GS/TP10/1/1/E1 | 208/230 | 3-60 | 3 | 349 | 158.0 | 51-3/4 | 1315 | 22-13/16 | 579.4 | 15-5/16 | 388.9 | 16-5/8 | 422.3 |

| UNIT | CORNER WEIGHT | | |
|------|---------------|--------------|----------------|
| | LB/KG | INCHES | MM |
| 24 | 45.6 / 20.7 | 60.8 / 24.4 | 1552.4 / 624.8 |
| 30 | 208.7 / 94.5 | 217.6 / 85.8 | 5520.0 / 219.0 |
| 36 | 208.7 / 94.5 | 233.7 / 92.3 | 5922.2 / 234.5 |

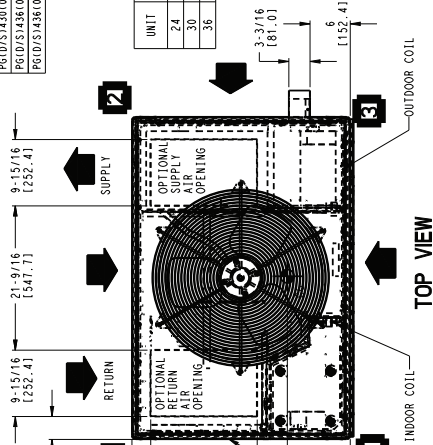

REQUIRED CLEARANCES TO COMBUSTIBLE MATL.

TOP OF UNIT.....14 [355.6] INCHES [MM]
 SIDE OF UNIT.....2 [50.8] INCHES [MM]
 SIDE OPPOSITE DUCTS.....12 [304.8] INCHES [MM]
 BOTTOM OF UNIT.....1/2 [12.7] INCHES [MM]
 FLUE PANEL.....36 [914.4] INCHES [MM]


NEC. REQUIRED CLEARANCES.

BETWEEN UNITS, POWER ENTRY SIDE.....42 [1066.8] INCHES [MM]
 UNIT AND UNGROUNDED SURFACES, POWER ENTRY SIDE.....36 [914.0] INCHES [MM]
 UNIT AND BLOCK OR CONCRETE WALLS AND OTHER GROUNDED SURFACES, POWER ENTRY SIDE.....42 [1066.8] INCHES [MM]

REQUIRED CLEARANCE FOR OPERATION AND SERVICING

EVAP. COIL ACCESS SIDE.....36 [914.0] INCHES [MM]
 UNIT (EXCEPT FOR NEC REQUIREMENTS).....48 [1219.2] INCHES [MM]
 UNIT TOP.....48 [1219.2] INCHES [MM]
 SIDE OPPOSITE DUCTS.....36 [914.0] INCHES [MM]
 DUCT PANEL.....12 [304.8] INCHES [MM]

• MINIMUM DISTANCES: IF UNIT IS PLACED LESS THAN 12 [304.8] FROM WALL SYSTEM, THEN SYSTEM PERFORMANCE MAYBE COMPROMISED.

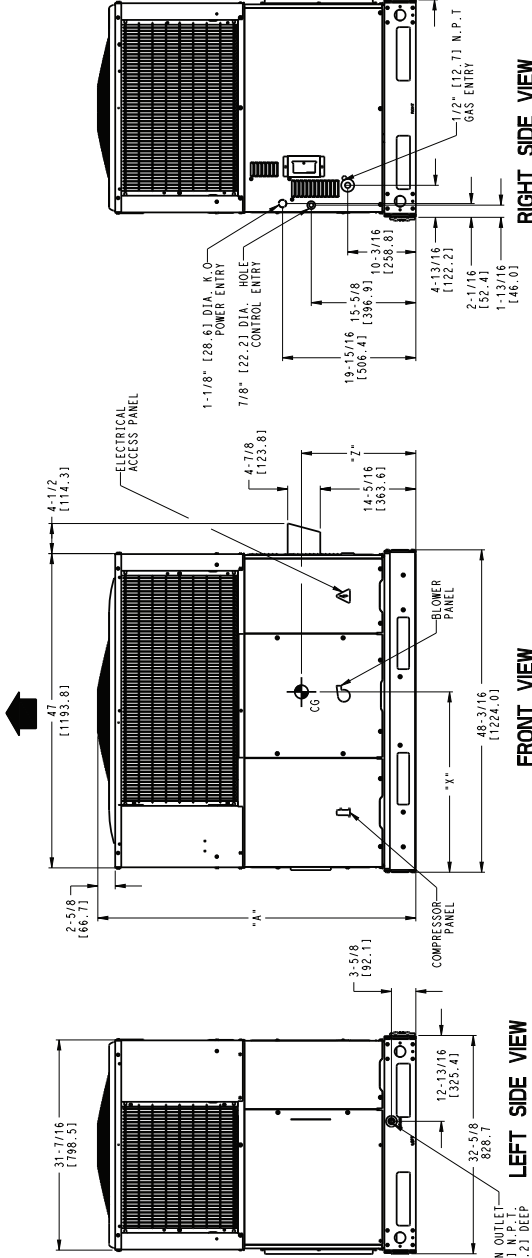


REAR VIEW

344815-4 A

UNIT DIMENSIONS - 42-60

| UNIT | ELECTRICAL CHARACTERISTICS | | UNIT WT. | | UNIT HEIGHT | | CENTER OF GRAVITY | | | |
|--|----------------------------|--------------|----------|-------|-------------|------|-------------------|-------|----|-------|
| | 11" | 12" | LB | KG | "A" | "B" | X | Y | Z | |
| PGD/S1442/080/181/00/6P/6S/TP10/101/61 | 208/230-1-60 | 208/230-1-60 | 413 | 187.0 | 44-3/4 | 1137 | 22-13/16 | 579.4 | 18 | 457.2 |
| PGD/S1448/080/115/130/1K1/00/6P/6S/TP10/101/61 | 208/230-1-60 | 208/230-1-60 | 438 | 198.0 | 52-3/4 | 1340 | 22-13/16 | 579.4 | 18 | 457.2 |
| PGD/S1460/080/115/130/1K1/00/6P/6S/TP10/101/61 | 208/230-1-60 | 208/230-1-60 | 455 | 206.0 | 54-3/4 | 1391 | 22-13/16 | 579.4 | 18 | 457.2 |
| PGD/S1442/080/090/161/1/00/6P/6S/TP10/101/61 | 208/230-3-60 | 460-3-60 | 413 | 187.0 | 44-3/4 | 1137 | 22-13/16 | 579.4 | 18 | 457.2 |
| PGD/S1448/080/115/130/1K1/00/6P/6S/TP10/101/61 | 208/230-3-60 | 460-3-60 | 438 | 198.0 | 52-3/4 | 1340 | 22-13/16 | 579.4 | 18 | 457.2 |
| PGD/S1460/080/115/130/1K1/00/6P/6S/TP10/101/61 | 208/230-3-60 | 460-3-60 | 455 | 206.0 | 54-3/4 | 1391 | 22-13/16 | 579.4 | 18 | 457.2 |

| UNIT | CORNER WEIGHTS | | |
|------|----------------|------|------|
| | 11" | 12" | 14" |
| 42 | 208/230 | 82.0 | 37.5 |
| 48 | 208/230 | 85.7 | 39.7 |
| 60 | 208/230 | 88.3 | 41.3 |

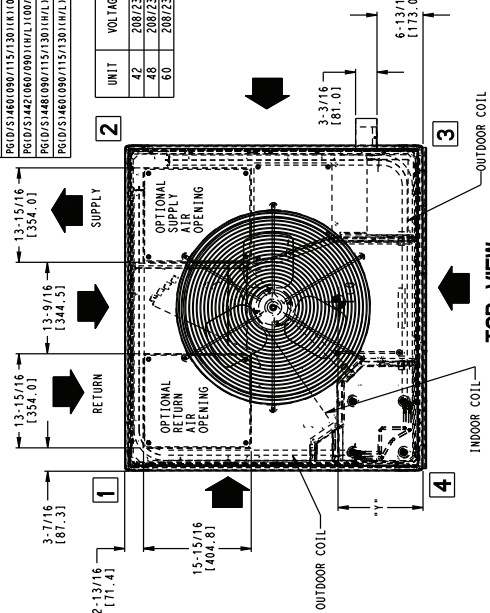

REQUIRED CLEARANCES TO COMBUSTIBLE MATL.

INCHES [MM]

TOP OF UNIT..... 2 [50.8]

DUCT SIDE OF UNIT..... 2 [50.8]

SIDE OPPOSITE DUCTS..... 14 [355.6]

BOTTOM OF UNIT..... 12 [304.8]

FLUE PANEL..... 36 [914.4]

NEC REQUIRED CLEARANCES.

INCHES [MM]

BETWEEN UNITS, POWER ENTRY SIDE..... 42 [1066.8]

BETWEEN UNITS, POWER ENTRY SIDE AND BLOWER PANEL..... 36 [914.0]

UNIT AND BLOWER PANEL TO CONCRETE WALLS AND OTHER GROUNDED SURFACES, POWER ENTRY SIDE..... 42 [1066.8]

REQUIRED CLEARANCE FOR OPERATION AND SERVICE

INCHES [MM]

EVAP. COIL ACCESS SIDE..... 36 [914.0]

POWER ENTRY SIDE..... 42 [1066.8]

DUCT SIDE (FOR NEC REQUIREMENTS)..... 48 [1219.2]


UNIT TOP FOR NEC REQUIREMENTS..... 36 [914.0]

SIDE OPPOSITE DUCTS..... 12 [304.8]

DUCT PANEL..... 12 [304.8]


MINIMUM DISTANCES: IF UNIT IS PLACED LESS THAN 12 (304.8) FROM WALL SYSTEM, THEN SYSTEM PERFORMANCE MAYBE COMPROMISED.

DIMENSIONS IN [] ARE IN MM

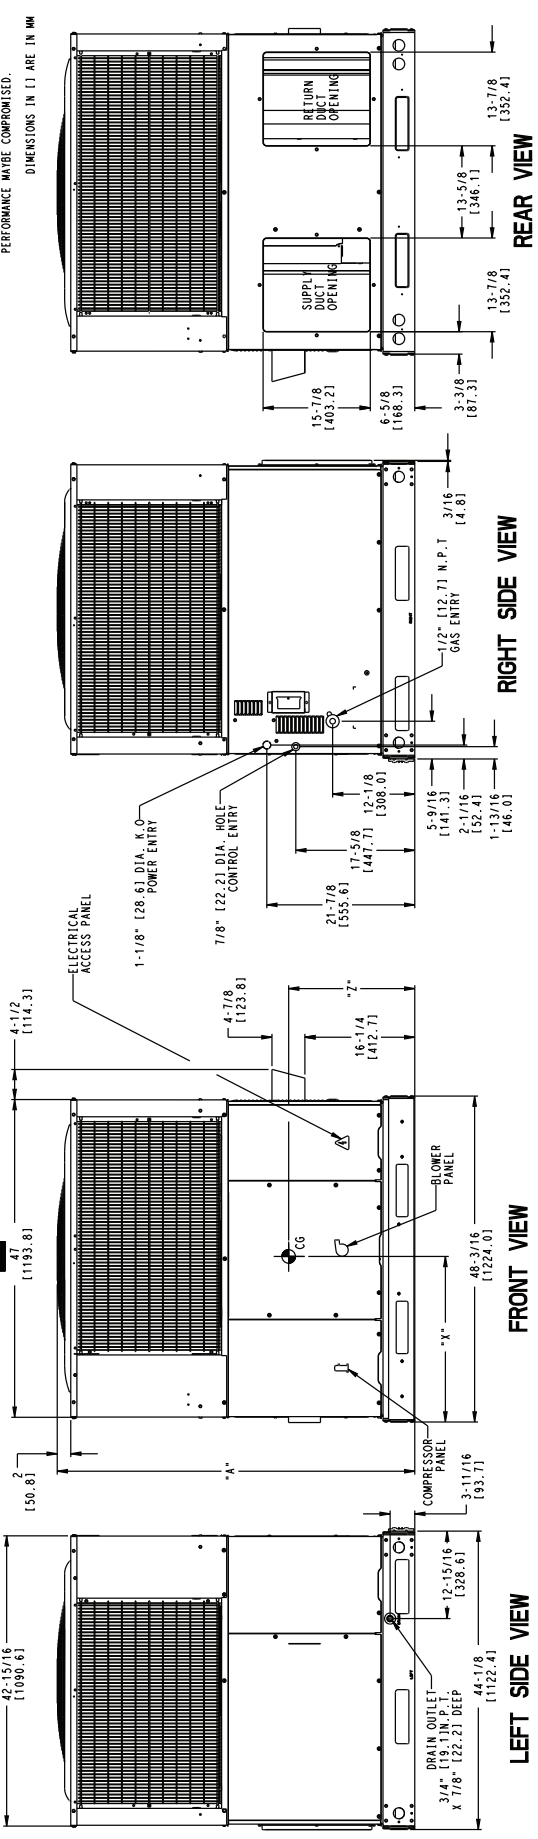

344807-4

ACCESSORY DIMENSIONS

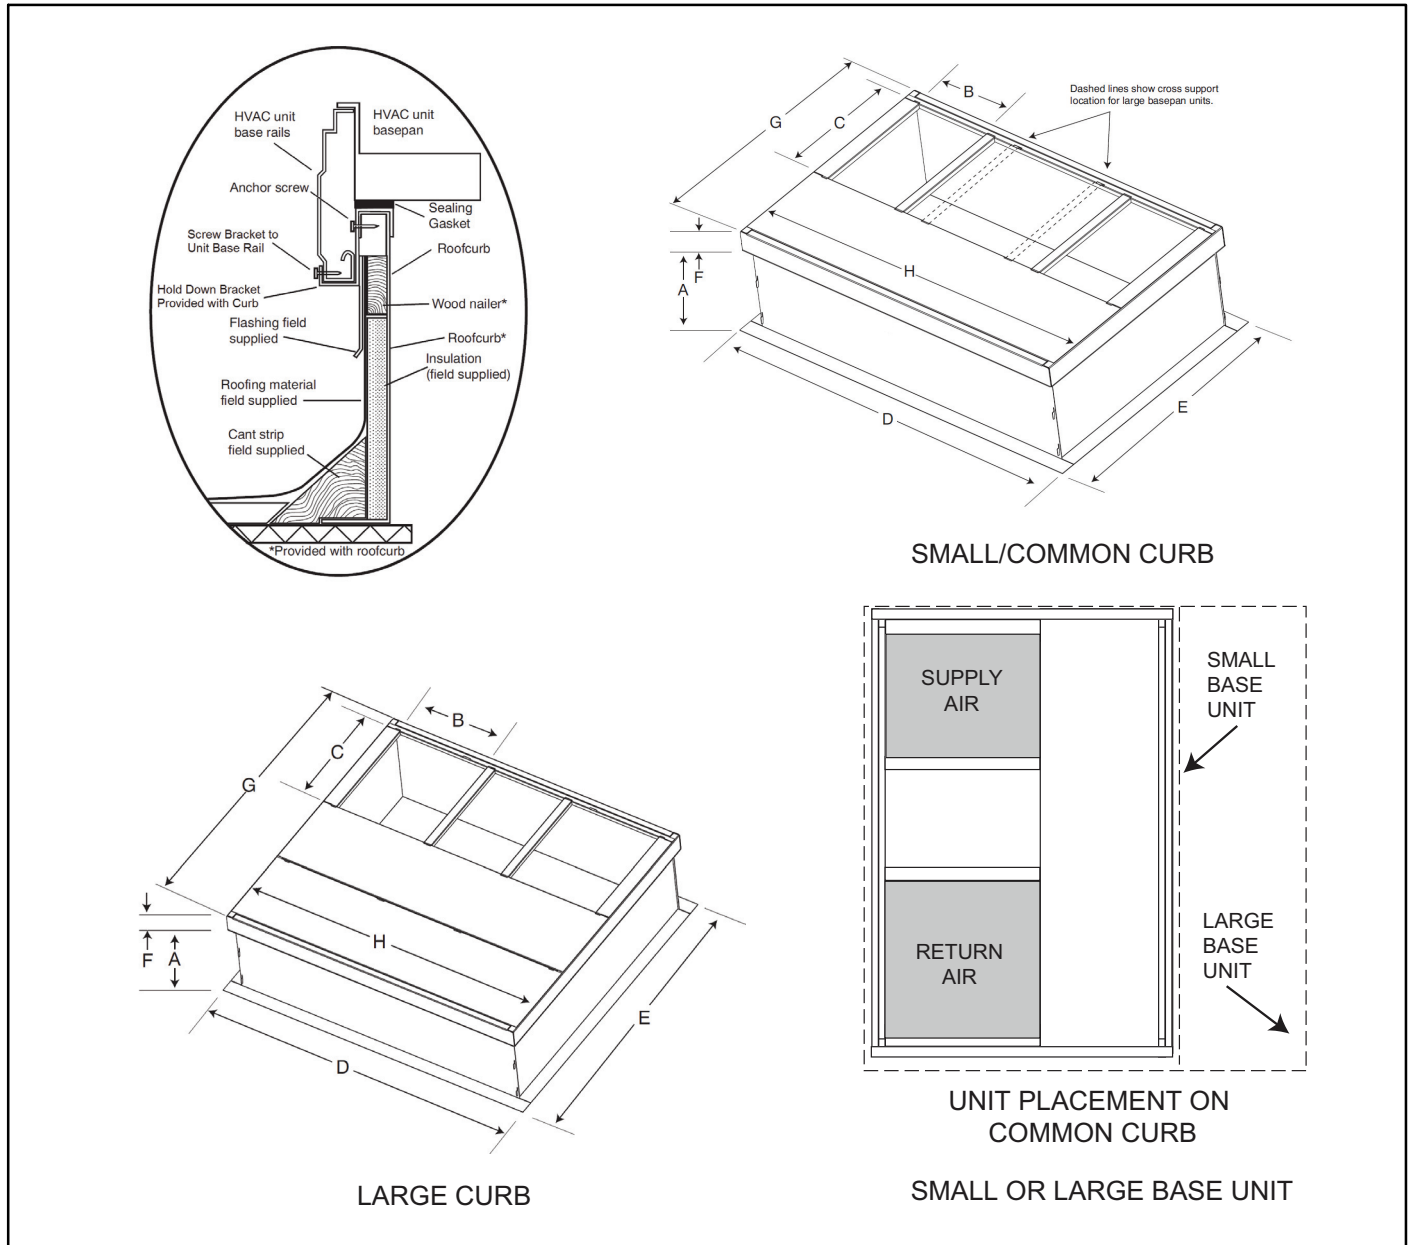

A180216

| UNIT SIZE | CATALOG NUMBER | A IN. (mm) | B (small / common base) IN. (mm)* | B (large base) IN. (mm)* | C IN. (mm) | D IN. (mm) | E IN. (mm) | F IN. (mm) | G IN. (mm) | H IN. (mm) |
|----------------|----------------|------------|-----------------------------------|--------------------------|------------|-------------|-------------|------------|------------|-------------|
| Small or Large | CPRFCURB011B00 | 14 (356) | 10 (254) | 14 (356) | 16 (406) | 47.8 (1214) | 32.4 (822) | 2.7 (69) | 30.6 (778) | 46.1 (1170) |
| | | | | 14 (356) | | | 43.9 (1116) | | | |
| Large | CPRFCURB013B00 | 14 (356) | 14 (356) | | | | | | | |

* Part Number CPRFCURB011B00 can be used on both small and large basepan units. The cross supports must be located based on whether the unit is a small basepan or a large basepan.

NOTES:

1. Roof curb must be set up for unit being installed.
2. Seal strip must be applied, as required, to unit being installed.
3. Roof curb is made of 16-gauge steel.
4. Attach ductwork to curb (flanges of duct rest on curb).
5. Insulated panels: 1-in. (25.4 mm) thick fiberglass 1 lb. density.

SELECTION PROCEDURE (WITH EXAMPLE)

1. Determine cooling and heating requirements at design conditions:

Given:

Required Cooling Capacity (TC) 34,000 Btuh
Sensible Heat Capacity (SHC) 25,000 Btuh
Required Heating Capacity 60,000 Btuh
Condenser Entering Air Temperature . . 95°F (35°C)
Indoor–Air Temperature 80°F (26°C)edb 67°F (19°C)ewb
Evaporator Air Quantity 1200 CFM
External Static Pressure 0.100 IN. W.C.
Electrical Characteristics 208–1–60

2. Select unit based on required cooling capacity.

Enter Net Cooling Capacities table at condenser entering temperature of 95°F (35°C). Unit 036 at 1200 cfm and 67°F (19°C) ewb (entering wet bulb) will provide a total capacity of 34,200 Btuh and a SHC of 27,400 Btuh. Calculate SHC correction, if required, using Note 4 under Cooling Capacities tables.

3. Select heating capacity of unit to provide design condition requirement.

In the Heating Capacities and Efficiencies table, note that the single phase unit 036090 will provide 73,000 Btuh with an input of 90,000 Btuh.

4. Determine fan speed and power requirements at design conditions.

Before entering the air delivery tables, calculate the total static pressure required. From the given example, the Wet Coil Pressure Drop Table, and the Filter Pressure Drop Table:

| | |
|--------------------------|----------------------|
| External Static Pressure | 0.100 IN. W.C |
| Filter | 0.07 IN. W.C |
| Wet Coil Pressure Drop | <u>0.180</u> IN. W.C |
| Total Static Pressure | 0.287 IN. W.C |

Enter the table for Dry Coil Air Delivery—Horizontal and Downflow Discharge. At .287 IN. W.C. ESP, the closest speed to 1200 CFM is Med–Low (pink wire), which delivers 1213 CFM at .3 in ESP.

5. Select unit that corresponds to power source available.

The Electrical Data Table shows that the unit is designed to operate at 208–1–60.

PERFORMANCE DATA

24 SIZE

| EVAPORATOR AIR | | CONDENSER ENTERING AIR TEMPERATURES ° F (° C) | | | | | | | | | | | | | | | | | | | | |
|----------------|-------------|---|--------------|--------------|----------------|--------------|--------------|----------------|--------------|--------------|----------------|--------------|--------------|----------------|--------------|--------------|----------------|--------------|--------------|-------|------|------|
| CFM | EWB F (° C) | 75 (23.9) | | | 85 (29.4) | | | 95 (35) | | | 105 (40.6) | | | 115 (46.1) | | | 125 (51.7) | | | | | |
| | | Capacity MBtuh | Total Sys KW | Total Sys KW | Capacity MBtuh | Total Sys KW | Total Sys KW | Capacity MBtuh | Total Sys KW | Total Sys KW | Capacity MBtuh | Total Sys KW | Total Sys KW | Capacity MBtuh | Total Sys KW | Total Sys KW | Capacity MBtuh | Total Sys KW | Total Sys KW | | | |
| 700 | 57 (13.8) | 23.62 | 1.55 | 21.90 | 21.90 | 20.07 | 20.07 | 1.95 | 17.88 | 17.88 | 15.87 | 15.87 | 2.14 | 2.14 | 15.87 | 15.87 | 2.38 | 2.38 | 14.01 | 14.01 | 2.64 | 2.64 |
| | 62 (16.6) | 24.47 | 1.56 | 22.45 | 20.24 | 19.02 | 20.32 | 1.96 | 17.92 | 17.92 | 15.90 | 15.90 | 2.14 | 2.14 | 15.90 | 15.90 | 2.38 | 2.38 | 14.03 | 14.03 | 2.64 | 2.64 |
| | 63* (17.2) | 24.99 | 1.56 | 22.88 | 16.39 | 15.32 | 20.71 | 1.96 | 18.05 | 14.06 | 15.56 | 12.87 | 2.15 | 2.15 | 15.56 | 12.87 | 2.36 | 2.36 | 13.28 | 11.77 | 2.61 | 2.61 |
| | 67 (19.4) | 27.02 | 1.55 | 24.79 | 17.09 | 16.03 | 22.51 | 1.98 | 19.92 | 14.86 | 17.28 | 13.67 | 2.20 | 2.20 | 17.28 | 13.67 | 2.42 | 2.42 | 14.91 | 12.59 | 2.67 | 2.67 |
| | 72 (22.2) | 29.59 | 1.55 | 27.20 | 13.77 | 12.86 | 24.84 | 1.99 | 22.48 | 11.95 | 19.68 | 10.89 | 2.24 | 2.24 | 19.68 | 10.89 | 2.51 | 2.51 | 17.14 | 9.92 | 2.77 | 2.77 |
| | 57 (13.8) | 24.74 | 1.57 | 22.92 | 22.92 | 21.02 | 21.02 | 1.99 | 18.78 | 18.78 | 16.65 | 16.65 | 2.19 | 2.19 | 16.65 | 16.65 | 2.42 | 2.42 | 14.70 | 14.70 | 2.69 | 2.69 |
| | 62 (16.6) | 25.14 | 1.57 | 23.07 | 21.80 | 21.05 | 21.05 | 1.99 | 18.81 | 18.81 | 16.68 | 16.68 | 2.19 | 2.19 | 16.68 | 16.68 | 2.42 | 2.42 | 14.72 | 14.72 | 2.69 | 2.69 |
| 800 | 63* (17.2) | 25.59 | 1.57 | 23.43 | 17.53 | 16.43 | 21.18 | 1.99 | 18.51 | 15.14 | 15.93 | 13.90 | 2.18 | 2.18 | 15.93 | 13.90 | 2.39 | 2.39 | 13.61 | 12.73 | 2.64 | 2.64 |
| | 67 (19.4) | 27.63 | 1.56 | 25.32 | 18.28 | 17.20 | 23.00 | 2.00 | 20.41 | 16.03 | 17.67 | 14.78 | 2.24 | 2.24 | 17.67 | 14.78 | 2.45 | 2.45 | 15.25 | 13.64 | 2.71 | 2.71 |
| | 72 (22.2) | 30.16 | 1.56 | 27.69 | 14.48 | 13.55 | 25.27 | 2.01 | 22.88 | 12.64 | 20.12 | 11.62 | 2.26 | 2.26 | 20.12 | 11.62 | 2.53 | 2.53 | 17.47 | 10.60 | 2.80 | 2.80 |
| | 57 (13.8) | 25.69 | 1.58 | 23.77 | 23.77 | 21.80 | 21.80 | 1.79 | 19.55 | 19.55 | 17.32 | 17.32 | 2.23 | 2.23 | 17.32 | 17.32 | 2.46 | 2.46 | 15.29 | 15.29 | 2.73 | 2.73 |
| 900 | 62 (16.6) | 25.74 | 1.58 | 23.81 | 23.81 | 21.84 | 21.84 | 1.79 | 19.58 | 19.58 | 17.35 | 17.35 | 2.23 | 2.23 | 17.35 | 17.35 | 2.46 | 2.46 | 15.31 | 15.31 | 2.73 | 2.73 |
| | 63* (17.2) | 26.07 | 1.58 | 23.84 | 18.62 | 17.49 | 21.55 | 1.79 | 18.84 | 16.17 | 16.24 | 14.87 | 2.20 | 2.20 | 16.24 | 14.87 | 2.42 | 2.42 | 13.92 | 13.92 | 2.67 | 2.67 |
| | 67 (19.4) | 28.08 | 1.58 | 25.72 | 19.42 | 18.31 | 23.37 | 1.79 | 20.82 | 17.17 | 17.98 | 15.84 | 2.26 | 2.26 | 17.98 | 15.84 | 2.48 | 2.48 | 15.54 | 14.63 | 2.74 | 2.74 |
| | 72 (22.2) | 30.58 | 1.58 | 28.07 | 15.15 | 14.21 | 25.58 | 1.79 | 23.17 | 13.29 | 20.45 | 12.30 | 2.28 | 2.28 | 20.45 | 12.30 | 2.56 | 2.56 | 17.73 | 11.25 | 2.83 | 2.83 |

See Legend and Notes on Page 18.

PERFORMANCE DATA

30 SIZE

| EVAPORATOR AIR | | CONDENSER ENTERING AIR TEMPERATURES ° F (° C) | | | | | | | | | | | | | | |
|----------------|---------------|---|------------|----------------|--------------|----------------|--------------|----------------|--------------|----------------|--------------|----------------|--------------|----------------|--------------|------|
| | | 75 (23.9) | | | 85 (29.4) | | | 95 (35) | | | 105 (40.6) | | | 115 (46.1) | | |
| | | CFM | EWB F (°C) | Capacity MBtuh | Total Sys KW | Capacity MBtuh | Total Sys KW | Capacity MBtuh | Total Sys KW | Capacity MBtuh | Total Sys KW | Capacity MBtuh | Total Sys KW | Capacity MBtuh | Total Sys KW | |
| 875 | 57 13.9) | 27.39 | 27.39 | 1.98 | 26.29 | 26.29 | 2.20 | 25.01 | 25.01 | 2.44 | 23.52 | 23.52 | 2.69 | 21.57 | 21.57 | 2.94 |
| | 62 16.7) | 28.22 | 26.10 | 1.99 | 26.84 | 25.48 | 2.20 | 25.28 | 24.73 | 2.45 | 23.38 | 23.38 | 2.68 | 21.59 | 21.59 | 2.94 |
| | 63* (17.2) | 28.70 | 21.18 | 1.99 | 27.33 | 20.58 | 2.20 | 25.77 | 19.89 | 2.45 | 23.74 | 19.00 | 2.69 | 21.18 | 17.90 | 2.93 |
| | 67 19.4) | 30.96 | 21.97 | 2.00 | 29.59 | 21.44 | 2.22 | 28.06 | 20.82 | 2.46 | 26.21 | 20.08 | 2.74 | 23.74 | 19.09 | 3.02 |
| | 71 21.7) | 33.22 | 18.60 | 2.02 | 31.86 | 18.10 | 2.24 | 30.33 | 17.53 | 2.48 | 28.62 | 16.90 | 2.76 | 26.55 | 16.13 | 3.08 |
| 1000 | 57 13.9) | 28.61 | 28.61 | 2.01 | 27.47 | 27.47 | 2.22 | 26.20 | 26.20 | 2.47 | 24.68 | 24.68 | 2.75 | 22.66 | 22.66 | 3.00 |
| | 62 16.7) | 28.93 | 28.00 | 2.01 | 27.59 | 27.35 | 2.23 | 26.34 | 26.18 | 2.47 | 24.72 | 24.72 | 2.75 | 22.70 | 22.70 | 3.00 |
| | 63* (17.2) | 29.30 | 22.46 | 2.01 | 27.91 | 21.89 | 2.23 | 26.32 | 21.22 | 2.47 | 24.35 | 20.38 | 2.73 | 21.72 | 19.26 | 2.97 |
| | 67 19.4) | 31.55 | 23.29 | 2.03 | 30.16 | 22.79 | 2.24 | 28.60 | 22.20 | 2.49 | 26.76 | 21.49 | 2.77 | 24.30 | 20.55 | 3.06 |
| | 71 21.7) | 33.80 | 19.48 | 2.05 | 32.41 | 19.01 | 2.26 | 30.84 | 18.46 | 2.51 | 29.10 | 17.84 | 2.79 | 27.04 | 17.11 | 3.11 |
| 1125 | 57 13.9) | 29.58 | 29.58 | 2.03 | 28.44 | 28.44 | 2.25 | 27.15 | 27.15 | 2.50 | 25.62 | 25.62 | 2.78 | 23.61 | 23.61 | 3.06 |
| | 62 16.7) | 29.56 | 29.56 | 2.03 | 28.82 | 27.88 | 2.25 | 27.19 | 27.19 | 2.50 | 25.66 | 25.66 | 2.78 | 23.65 | 23.65 | 3.06 |
| | 63* (17.2) | 29.76 | 23.65 | 2.04 | 28.33 | 23.11 | 2.25 | 26.76 | 22.46 | 2.50 | 24.80 | 21.66 | 2.77 | 22.16 | 20.54 | 3.01 |
| | 67 19.4) | 31.99 | 24.51 | 2.05 | 30.58 | 24.06 | 2.27 | 29.00 | 23.49 | 2.51 | 27.19 | 22.82 | 2.79 | 24.77 | 21.94 | 3.11 |
| | 71 21.7) | 34.23 | 20.29 | 2.07 | 32.81 | 19.85 | 2.29 | 31.24 | 19.31 | 2.54 | 29.45 | 18.71 | 2.82 | 27.39 | 18.01 | 3.13 |

See Legend and Notes on Page 18.

PERFORMANCE DATA (CONT)

36 SIZE

| EVAPORATOR AIR | | CONDENSER ENTERING AIR TEMPERATURES ° F (° C) | | | | | | | | | | | | | | | | | |
|----------------|----------------|---|--------------------|--------------------|-------------------|--------------------|--------------------|-------------------|--------------------|--------------------|-------------------|--------------------|--------------------|-------------------|--------------------|--------------------|-------------------|--------------------|--------------------|
| CFM | EWB F (° C) | 75 (23.9) | | | 85 (29.4) | | | 95 (35) | | | 105 (40.6) | | | 115 (46.1) | | | 125 (51.7) | | |
| | | Capacity MBtuh | Total Sys KW | Total Sys KW | Capacity MBtuh | Total Sys KW | Total Sys KW | Capacity MBtuh | Total Sys KW | Total Sys KW | Capacity MBtuh | Total Sys KW | Total Sys KW | Capacity MBtuh | Total Sys KW | Total Sys KW | Capacity MBtuh | Total Sys KW | Total Sys KW |
| 1000 | 57 (13.8) | 34.58 | 34.58 | 2.40 | 32.46 | 32.46 | 2.66 | 30.31 | 30.31 | 2.94 | 28.08 | 28.08 | 3.27 | 25.78 | 25.78 | 3.65 | 23.44 | 23.44 | 4.08 |
| | 62 (16.6) | 36.10 | 31.44 | 2.41 | 33.65 | 29.92 | 2.67 | 31.16 | 28.38 | 2.95 | 28.62 | 26.75 | 3.27 | 26.05 | 25.03 | 3.65 | 23.48 | 23.48 | 4.08 |
| | 63* (17.2) | 36.53 | 25.60 | 2.42 | 34.01 | 24.25 | 2.67 | 31.48 | 22.90 | 2.95 | 28.86 | 21.49 | 3.28 | 26.20 | 20.05 | 3.65 | 23.49 | 18.58 | 4.08 |
| | 67 (19.4) | 39.44 | 26.70 | 2.43 | 36.74 | 25.34 | 2.69 | 34.00 | 23.95 | 2.97 | 31.20 | 22.53 | 3.30 | 28.34 | 21.07 | 3.67 | 25.45 | 19.58 | 4.09 |
| | 72 (22.2) | 43.05 | 21.95 | 2.46 | 40.11 | 20.71 | 2.72 | 37.12 | 19.45 | 3.00 | 34.07 | 18.16 | 3.32 | 30.95 | 16.85 | 3.69 | 27.81 | 15.51 | 4.11 |
| | 57 (13.8) | 36.19 | 36.19 | 2.46 | 33.98 | 33.98 | 2.71 | 31.67 | 31.67 | 3.00 | 29.30 | 29.30 | 3.32 | 26.84 | 26.84 | 3.70 | 24.34 | 24.34 | 4.12 |
| 1150 | 62 (16.6) | 37.15 | 33.84 | 2.46 | 34.60 | 32.19 | 2.72 | 32.03 | 30.46 | 3.00 | 29.42 | 29.41 | 3.32 | 26.90 | 26.90 | 3.70 | 24.38 | 24.38 | 4.12 |
| | 63* (17.2) | 37.52 | 27.28 | 2.47 | 34.89 | 25.86 | 2.72 | 32.23 | 24.43 | 3.01 | 29.50 | 22.95 | 3.33 | 26.72 | 21.43 | 3.70 | 23.92 | 19.88 | 4.12 |
| | 67 (19.4) | 40.47 | 28.51 | 2.48 | 37.67 | 27.07 | 2.74 | 34.80 | 25.60 | 3.03 | 31.88 | 24.11 | 3.35 | 28.91 | 22.56 | 3.72 | 25.90 | 20.99 | 4.14 |
| | 72 (22.2) | 44.12 | 23.06 | 2.51 | 41.04 | 21.76 | 2.77 | 37.93 | 20.44 | 3.06 | 34.77 | 19.10 | 3.38 | 31.54 | 17.73 | 3.74 | 28.28 | 16.32 | 4.16 |
| 1300 | 57 (13.8) | 37.56 | 37.56 | 2.51 | 35.24 | 35.24 | 2.77 | 32.79 | 32.79 | 3.05 | 30.30 | 30.30 | 3.38 | 27.71 | 27.71 | 3.75 | 25.08 | 25.08 | 4.17 |
| | 62 (16.6) | 38.06 | 35.99 | 2.51 | 35.47 | 34.14 | 2.77 | 32.84 | 32.84 | 3.05 | 30.34 | 30.34 | 3.38 | 27.75 | 27.75 | 3.75 | 25.12 | 25.12 | 4.17 |
| | 63* (17.2) | 38.23 | 28.87 | 2.51 | 35.57 | 27.41 | 2.77 | 32.80 | 25.90 | 3.05 | 29.99 | 24.35 | 3.38 | 27.14 | 22.76 | 3.75 | 24.25 | 21.11 | 4.17 |
| | 67 (19.4) | 41.26 | 30.24 | 2.53 | 38.33 | 28.73 | 2.79 | 35.38 | 27.20 | 3.08 | 32.36 | 25.62 | 3.40 | 29.31 | 24.01 | 3.76 | 26.22 | 22.34 | 4.18 |
| 72 (22.2) | 44.94 | 24.09 | 2.56 | 41.77 | 22.75 | 2.82 | 38.55 | 21.38 | 3.11 | 35.28 | 19.98 | 3.43 | 31.96 | 18.56 | 3.79 | 28.62 | 17.10 | 4.21 | |

See Legend and Notes on Page 18.

PERFORMANCE DATA

42 SIZE

| EVAPORATOR AIR | | CONDENSER ENTERING AIR TEMPERATURES ° F (° C) | | | | | | | | | | | | | | | | | |
|----------------|------------|---|-------------|----------------|--------------|----------------|--------------|----------------|--------------|----------------|--------------|----------------|--------------|----------------|--------------|----------------|--------------|-------|------|
| | | 75 (23.9) | | | 85 (29.4) | | | 95 (35) | | | 105 (40.6) | | | 115 (46.1) | | | 125 (51.7) | | |
| | | CFM | EWB F (° C) | Capacity MBtuh | Total Sys KW | Capacity MBtuh | Total Sys KW | Capacity MBtuh | Total Sys KW | Capacity MBtuh | Total Sys KW | Capacity MBtuh | Total Sys KW | Capacity MBtuh | Total Sys KW | Capacity MBtuh | Total Sys KW | | |
| 1175 | 57 (13.8) | 38.66 | 38.66 | 2.51 | 36.66 | 36.66 | 2.87 | 34.60 | 34.60 | 3.30 | 32.45 | 32.45 | 3.80 | 30.07 | 30.07 | 4.39 | 27.19 | 27.19 | 5.02 |
| | 62 (16.6) | 40.29 | 35.16 | 2.54 | 37.87 | 33.90 | 2.90 | 35.39 | 32.59 | 3.32 | 32.82 | 31.18 | 3.82 | 30.12 | 30.12 | 4.39 | 27.24 | 27.24 | 5.03 |
| | 63* (17.2) | 41.08 | 28.70 | 2.54 | 38.62 | 27.55 | 2.92 | 36.06 | 26.34 | 3.34 | 33.40 | 25.10 | 3.84 | 30.40 | 30.40 | 4.40 | 26.65 | 22.06 | 4.98 |
| | 67 (19.4) | 44.34 | 29.79 | 2.59 | 41.80 | 28.66 | 2.97 | 39.16 | 27.52 | 3.42 | 36.41 | 26.33 | 3.95 | 33.45 | 33.45 | 4.57 | 29.97 | 23.59 | 5.21 |
| | 72 (22.2) | 48.52 | 24.17 | 2.66 | 45.92 | 23.18 | 3.05 | 43.20 | 22.16 | 3.52 | 40.37 | 21.10 | 4.06 | 37.44 | 20.00 | 4.70 | 34.27 | 18.84 | 5.44 |
| | 57 (13.8) | 40.50 | 40.50 | 2.58 | 38.39 | 38.39 | 2.95 | 36.24 | 36.24 | 3.40 | 34.01 | 34.01 | 3.92 | 31.54 | 31.54 | 4.51 | 28.67 | 28.67 | 5.17 |
| | 62 (16.6) | 41.38 | 37.85 | 2.59 | 38.93 | 36.52 | 2.96 | 36.44 | 36.11 | 3.41 | 34.06 | 34.06 | 3.92 | 31.59 | 31.59 | 4.52 | 28.72 | 28.72 | 5.17 |
| 1350 | 63* (17.2) | 42.06 | 30.61 | 2.60 | 39.52 | 29.42 | 2.97 | 36.90 | 28.24 | 3.41 | 34.16 | 26.96 | 3.92 | 31.10 | 25.56 | 4.49 | 27.35 | 23.86 | 5.08 |
| | 67 (19.4) | 45.33 | 31.78 | 2.64 | 42.72 | 30.67 | 3.03 | 40.00 | 29.50 | 3.48 | 37.18 | 28.29 | 4.01 | 34.18 | 27.02 | 4.64 | 30.76 | 25.56 | 5.32 |
| | 72 (22.2) | 49.45 | 25.33 | 2.72 | 46.79 | 24.36 | 3.12 | 44.00 | 23.33 | 3.58 | 41.11 | 22.27 | 4.13 | 38.09 | 21.17 | 4.78 | 34.91 | 20.01 | 5.52 |
| | 57 (13.8) | 41.99 | 41.99 | 2.63 | 39.82 | 39.82 | 3.02 | 37.59 | 37.59 | 3.47 | 35.28 | 35.28 | 4.01 | 32.78 | 32.78 | 4.63 | 29.92 | 29.92 | 5.31 |
| 1525 | 62 (16.6) | 42.32 | 40.26 | 2.64 | 39.90 | 39.90 | 3.02 | 37.64 | 37.64 | 3.47 | 35.33 | 35.33 | 4.01 | 32.82 | 32.82 | 4.64 | 29.97 | 29.97 | 5.31 |
| | 63* (17.2) | 42.81 | 32.42 | 2.65 | 40.22 | 31.23 | 3.02 | 37.53 | 30.01 | 3.47 | 34.76 | 28.74 | 3.99 | 31.66 | 27.29 | 4.56 | 27.97 | 25.57 | 5.17 |
| | 67 (19.4) | 46.08 | 33.66 | 2.70 | 43.40 | 32.57 | 3.08 | 40.64 | 31.35 | 3.54 | 37.75 | 30.14 | 4.07 | 34.73 | 28.86 | 4.70 | 31.38 | 27.42 | 5.42 |
| | 72 (22.2) | 50.14 | 26.41 | 2.78 | 47.44 | 25.44 | 3.18 | 44.60 | 24.44 | 3.64 | 41.64 | 23.37 | 4.20 | 38.57 | 22.27 | 4.85 | 35.35 | 21.11 | 5.59 |

See Legend and Notes on Page 18.

PERFORMANCE DATA (CONT)

48 SIZE

| EVAPORATOR AIR | | CONDENSER ENTERING AIR TEMPERATURES ° F (° C) | | | | | | | | | | | | | | | | | |
|----------------|---------------|---|-------|--------------|----------------|-------|--------------|----------------|-------|--------------|----------------|-------|--------------|----------------|-------|--------------|------------|-------|------|
| | | 75 (23.9) | | | 85 (29.4) | | | 95 (35) | | | 105 (40.6) | | | 115 (46.1) | | | 125 (51.7) | | |
| CFM | EWB F (° C) | Capacity MBtuh | | Total Sys KW | Capacity MBtuh | | Total Sys KW | Capacity MBtuh | | Total Sys KW | Capacity MBtuh | | Total Sys KW | Capacity MBtuh | | Total Sys KW | | | |
| | | Total | Sens | | Total | Sens | | Total | Sens | | Total | Sens | | Total | Sens | | | | |
| 1400 | 57 (13.8) | 45.45 | 45.45 | 3.10 | 42.83 | 42.83 | 3.46 | 40.16 | 40.16 | 3.89 | 37.26 | 37.26 | 4.36 | 33.52 | 33.52 | 4.82 | 29.80 | 29.80 | 5.37 |
| | 62 (16.6) | 47.27 | 42.17 | 3.13 | 44.15 | 40.29 | 3.49 | 41.03 | 38.39 | 3.91 | 37.61 | 36.29 | 4.36 | 33.57 | 33.57 | 4.83 | 29.84 | 29.84 | 5.37 |
| | 63* (17.2) | 48.20 | 34.32 | 3.13 | 45.02 | 32.66 | 3.50 | 41.76 | 30.98 | 3.92 | 38.24 | 29.20 | 4.38 | 33.54 | 26.93 | 4.82 | 28.81 | 24.65 | 5.33 |
| | 67 (19.4) | 52.06 | 35.63 | 3.15 | 48.74 | 34.02 | 3.52 | 45.33 | 32.35 | 3.95 | 41.77 | 30.64 | 4.44 | 37.35 | 28.63 | 4.96 | 32.39 | 26.38 | 5.46 |
| | 72 (22.2) | 56.98 | 28.79 | 3.18 | 53.50 | 27.36 | 3.56 | 49.89 | 25.89 | 3.99 | 46.16 | 24.36 | 4.48 | 42.23 | 22.80 | 5.04 | 37.37 | 21.00 | 5.64 |
| 1550 | 57 (13.8) | 47.02 | 47.02 | 3.17 | 44.27 | 44.27 | 3.54 | 41.50 | 41.50 | 3.96 | 38.53 | 38.53 | 4.44 | 34.79 | 34.79 | 4.92 | 30.91 | 30.91 | 5.46 |
| | 62 (16.6) | 48.16 | 44.46 | 3.17 | 45.01 | 42.51 | 3.55 | 41.85 | 40.45 | 3.97 | 38.60 | 38.60 | 4.44 | 34.83 | 34.83 | 4.92 | 30.95 | 30.95 | 5.46 |
| | 63* (17.2) | 49.02 | 35.96 | 3.18 | 45.75 | 34.27 | 3.55 | 42.41 | 32.55 | 3.98 | 38.87 | 30.75 | 4.45 | 34.15 | 28.45 | 4.89 | 29.32 | 26.09 | 5.40 |
| | 67 (19.4) | 52.88 | 37.35 | 3.20 | 49.49 | 35.71 | 3.57 | 46.00 | 34.00 | 4.00 | 42.38 | 32.25 | 4.49 | 38.03 | 30.31 | 5.04 | 32.93 | 27.95 | 5.53 |
| | 72 (22.2) | 57.73 | 29.76 | 3.23 | 54.20 | 28.31 | 3.61 | 50.51 | 26.84 | 4.04 | 46.68 | 25.28 | 4.53 | 42.70 | 23.71 | 5.09 | 37.92 | 21.96 | 5.70 |
| 1800 | 57 (13.8) | 49.14 | 49.14 | 3.25 | 46.25 | 46.25 | 3.63 | 43.34 | 43.34 | 4.06 | 40.29 | 40.29 | 4.55 | 36.55 | 36.55 | 5.07 | 32.46 | 32.46 | 5.60 |
| | 62 (16.6) | 49.49 | 47.88 | 3.25 | 46.34 | 46.34 | 3.63 | 43.39 | 43.39 | 4.06 | 40.34 | 40.34 | 4.55 | 36.60 | 36.60 | 5.07 | 32.49 | 32.49 | 5.61 |
| | 63* (17.2) | 50.04 | 38.56 | 3.25 | 46.70 | 36.84 | 3.63 | 43.27 | 35.06 | 4.06 | 39.66 | 33.20 | 4.54 | 34.96 | 30.85 | 5.00 | 30.05 | 28.30 | 5.51 |
| | 67 (19.4) | 53.94 | 40.13 | 3.28 | 50.43 | 38.42 | 3.65 | 46.85 | 36.63 | 4.08 | 43.16 | 34.80 | 4.57 | 38.95 | 32.92 | 5.12 | 33.66 | 30.41 | 5.65 |
| | 72 (22.2) | 58.67 | 31.28 | 3.31 | 55.06 | 29.83 | 3.69 | 51.26 | 28.32 | 4.12 | 47.34 | 26.73 | 4.62 | 43.27 | 25.12 | 5.18 | 38.61 | 23.50 | 5.78 |

See Legend and Notes on Page 18.

PERFORMANCE DATA

60 SIZE

| EVAPORATOR AIR | | CONDENSER ENTERING AIR TEMPERATURES ° F (° C) | | | | | | | | | | | | | | | | | |
|----------------|------------|---|---------------|----------------|--------------|----------------|--------------|----------------|--------------|----------------|--------------|----------------|--------------|----------------|--------------|----------------|--------------|-------|------|
| | | 75 (23.9) | | | 85 (29.4) | | | 95 (35) | | | 105 (40.6) | | | 115 (46.1) | | | 125 (51.7) | | |
| | | CFM | EWB ° F (° C) | Capacity MBtuh | Total Sys KW | Capacity MBtuh | Total Sys KW | Capacity MBtuh | Total Sys KW | Capacity MBtuh | Total Sys KW | Capacity MBtuh | Total Sys KW | Capacity MBtuh | Total Sys KW | Capacity MBtuh | Total Sys KW | | |
| 1750 | 57 (13.8) | 57.04 | 57.04 | 3.68 | 53.71 | 53.71 | 4.20 | 50.37 | 50.37 | 4.81 | 46.94 | 46.94 | 5.51 | 42.94 | 42.94 | 6.27 | 38.22 | 38.22 | 7.08 |
| | 62 (16.6) | 58.59 | 49.98 | 3.70 | 54.72 | 48.26 | 4.22 | 50.83 | 46.41 | 4.82 | 47.02 | 47.02 | 5.51 | 43.00 | 43.00 | 6.28 | 38.29 | 38.29 | 7.08 |
| | 63* (17.2) | 59.69 | 40.44 | 3.70 | 55.67 | 38.90 | 4.23 | 51.62 | 37.32 | 4.83 | 47.50 | 35.70 | 5.52 | 42.48 | 33.69 | 6.25 | 36.58 | 31.27 | 7.00 |
| | 67 (19.4) | 64.43 | 42.04 | 3.73 | 60.26 | 40.56 | 4.26 | 56.00 | 39.00 | 4.87 | 51.67 | 37.39 | 5.57 | 47.05 | 35.71 | 6.38 | 41.05 | 33.47 | 7.21 |
| | 72 (22.2) | 70.39 | 33.58 | 3.78 | 66.06 | 32.25 | 4.31 | 61.55 | 30.87 | 4.93 | 56.94 | 29.39 | 5.64 | 52.21 | 27.88 | 6.45 | 47.19 | 26.29 | 7.37 |
| | 57 (13.8) | 59.44 | 59.44 | 3.78 | 55.93 | 55.93 | 4.31 | 52.41 | 52.41 | 4.92 | 48.83 | 48.83 | 5.62 | 44.92 | 44.92 | 6.44 | 39.97 | 39.97 | 7.26 |
| 2000 | 62 (16.6) | 60.04 | 53.50 | 3.78 | 56.07 | 56.07 | 4.31 | 52.48 | 52.48 | 4.92 | 48.90 | 48.90 | 5.62 | 44.98 | 44.98 | 6.44 | 40.04 | 40.04 | 7.26 |
| | 63* (17.2) | 60.84 | 43.04 | 3.78 | 56.74 | 41.49 | 4.31 | 52.56 | 39.87 | 4.92 | 48.32 | 38.18 | 5.62 | 43.48 | 36.25 | 6.39 | 37.36 | 33.66 | 7.13 |
| | 67 (19.4) | 65.61 | 44.79 | 3.81 | 61.36 | 43.29 | 4.34 | 56.95 | 41.68 | 4.96 | 52.51 | 40.02 | 5.66 | 47.83 | 38.30 | 6.47 | 41.86 | 36.09 | 7.35 |
| | 72 (22.2) | 71.45 | 35.11 | 3.87 | 67.02 | 33.78 | 4.40 | 62.40 | 32.37 | 5.02 | 57.67 | 30.89 | 5.73 | 52.81 | 29.36 | 6.55 | 47.75 | 27.77 | 7.47 |
| | 57 (13.8) | 61.37 | 61.37 | 3.86 | 57.76 | 57.76 | 4.39 | 54.09 | 54.09 | 5.01 | 50.36 | 50.36 | 5.72 | 46.38 | 46.38 | 6.54 | 41.44 | 41.44 | 7.43 |
| | 62 (16.6) | 61.42 | 61.42 | 3.86 | 57.83 | 57.83 | 4.40 | 54.15 | 54.15 | 5.01 | 50.42 | 50.42 | 5.72 | 46.44 | 46.44 | 6.54 | 41.51 | 41.51 | 7.43 |
| 2250 | 63* (17.2) | 61.75 | 45.60 | 3.86 | 57.57 | 43.99 | 4.39 | 53.29 | 42.29 | 5.00 | 48.99 | 40.55 | 5.71 | 44.27 | 38.64 | 6.52 | 38.08 | 35.80 | 7.26 |
| | 67 (19.4) | 66.46 | 47.42 | 3.89 | 62.10 | 45.93 | 4.43 | 57.67 | 44.25 | 5.04 | 53.13 | 42.53 | 5.75 | 48.44 | 40.74 | 6.56 | 42.58 | 38.56 | 7.48 |
| | 72 (22.2) | 72.23 | 36.56 | 3.95 | 67.73 | 35.23 | 4.48 | 63.02 | 33.84 | 5.11 | 58.17 | 32.33 | 5.82 | 53.23 | 30.78 | 6.65 | 48.12 | 29.19 | 7.57 |

See Legend and Notes on Page 18.

PERFORMANCE DATA (CONT)

* At 75°F (24°C) entering dry bulb—Tennessee Valley Authority (TVA) rating conditions; all others at 80°F dry bulb.

LEGEND

BF— Bypass Factor
edb— Entering Dry-Bulb
Ewb— Entering Wet-Bulb
kW — Total Unit Power Input
SHC— Sensible Heat Capacity (1000 Btu/h)
TC — Total Capacity (1000 Btu/h) (net)
rh—Relative Humidity

COOLING NOTES:

1. Ratings are net; they account for the effects of the evaporator-fan motor power and heat.
2. Direct interpolation is permissible. Do not extrapolate.
3. The following formulas may be used:

$$t_{db} = t_{edb} - \frac{\text{Sensible capacity (Btu/h)}}{1.10 \times \text{cfm}}$$

$$t_{wb} = \text{Wet-bulb temperature corresponding to enthalpy air leaving evaporator coil (} t_{wlb} \text{)}$$

$$h_{wlb} = h_{ewb} - \frac{\text{total capacity (Btu/h)}}{4.5 \times \text{cfm}}$$

Where: h_{wlb} = Enthalpy of air entering evaporator coil

4. The SHC is based on 80°F (26.6°C) edb temperature of air entering evaporator coil. Below 80°F (26.6°C) edb, subtract (corr factor x cfm) from SHC.

Above 80°F (26.6°C) edb, add (corr factor x cfm) to SHC.

Correction Factor = $1.10 \times (1 + \text{BF}) \times (\text{edb} - 80)$.

5. Integrated capacity is maximum (instantaneous) capacity less the effect of frost on the outdoor coil and the heat required to defrost it.

PERFORMANCE DATA (CONT)

GAS ADJUSTMENT

Natural Gas Orifice Sizes and Manifold Pressure – Single Phase Models

| Nameplate Input (Btu/hr) | | ALTITUDE OF INSTALLATION (FT. ABOVE SEA LEVEL) U.S.A.* | | | | |
|-----------------------------|-------------------------------|--|---------------------------------|---------------------------------|----------------------------------|----------------------------------|
| | | 0 to 2000 (0–610 m) | 2001 to 3000* (611 to 914 m) | 3001 to 4000 (915 to 1219 m) | 4001 to 5000 (1220 to 1524 m) | 5001 to 6000 (1524 to 1829 m) |
| 40000 | Orifice No. (Qty) | 44 (2) | 45 (2)† | 48 (2)† | 48 (2)† | 48 (2)† |
| | Manifold Press. (in. W.C.) | 3.2 | 3.2 | 3.8 | 3.5 | 3.2 |
| 60000 | Orifice No. (Qty) | 44 (3) | 45 (3)† | 48 (3)† | 48 (3)† | 48 (3)† |
| | Manifold Press. (in. W.C.) | 3.2 | 3.2 | 3.8 | 3.5 | 3.2 |
| 90000 | Orifice No. (Qty) | 38 (3) | 41 (3)† | 41 (3)† | 42 (3)† | 42 (3)† |
| | Manifold Press. (in. W.C.) | 3.6 | 3.8 | 3.4 | 3.4 | 3.2 |
| 115000 | Orifice No. (Qty) | 33 (3) | 36 (3)† | 36 (3)† | 36 (3)† | 38 (3)† |
| | Manifold Press. (in. W.C.) | 3.8 | 3.8 | 3.6 | 3.3 | 3.6 |
| 127000 | Orifice No. (Qty) | 31 (3) | 31 (3) | 33 (3)† | 33 (3)† | 34 (3)† |
| | Manifold Press. (in. W.C.) | 3.7 | 3.2 | 3.5 | 3.2 | 3.2 |

*In the U.S.A., the input rating for altitudes above 2000 ft (610m) must be reduced by 4% for each 1000 ft (305 m) above sea level.

In Canada, the input rating for altitudes from 2001 to 4500 ft (611 to 1372 m) above sea level must be derated by 10% by an authorized gas conversion station or dealer. For Canadian Installations from 2000 to 4500 ft, use U.S.A. column 2001 to 3000 ft.

Note: Orifice sizes and manifold pressure settings are based on natural gas with a heating value of 1025 Btu/ft3 and a specific gravity of .6.

† Orifices available through your distributor.

Natural Gas Orifice Sizes and Manifold Pressure – Three Phase Models

| Nameplate Input (Btu/hr) | | ALTITUDE OF INSTALLATION (FT. ABOVE SEA LEVEL) U.S.A.* | | | | |
|-----------------------------|-------------------------------|--|---------------------------------|---------------------------------|----------------------------------|----------------------------------|
| | | 0 to 2000 (0–610 m) | 2001 to 3000* (611 to 914 m) | 3001 to 4000 (915 to 1219 m) | 4001 to 5000 (1220 to 1524 m) | 5001 to 6000 (1524 to 1829 m) |
| 40000 | Orifice No. (Qty) | 44 (2) | 45 (2)† | 48 (2)† | 48 (2)† | 48 (2)† |
| | Manifold Press. (in. W.C.) | 3.2 | 3.2 | 3.8 | 3.5 | 3.2 |
| 60000 | Orifice No. (Qty) | 38 (2) | 41 (2)† | 41 (2)† | 42 (2)† | 42 (2)† |
| | Manifold Press. (in. W.C.) | 3.6 | 3.8 | 3.4 | 3.4 | 3.2 |
| 90000 | Orifice No. (Qty) | 38 (3) | 41 (3)† | 41 (3)† | 42 (3)† | 42 (3)† |
| | Manifold Press. (in. W.C.) | 3.6 | 3.8 | 3.4 | 3.4 | 3.2 |
| 115000 | Orifice No. (Qty) | 33 (3) | 36 (3)† | 36 (3)† | 36 (3)† | 38 (3)† |
| | Manifold Press. (in. W.C.) | 3.8 | 3.8 | 3.6 | 3.3 | 3.6 |
| 130000 | Orifice No. (Qty) | 31 (3) | 31 (3) | 33 (3)† | 33 (3)† | 34 (3)† |
| | Manifold Press. (in. W.C.) | 3.8 | 3.2 | 3.7 | 3.4 | 3.3 |

*In the U.S.A., the input rating for altitudes above 2000 ft (610m) must be reduced by 4% for each 1000 ft (305 m) above sea level.

In Canada, the input rating for altitudes from 2001 to 4500 ft (611 to 1372 m) above sea level must be derated by 10% by an authorized gas conversion station or dealer. For Canadian Installations from 2000 to 4500 ft, use U.S.A. column 2001 to 3000 ft.

Note: Orifice sizes and manifold pressure settings are based on natural gas with a heating value of 1025 Btu/ft3 and a specific gravity of .6.

† Orifices available through your distributor.

Propane Gas Orifice Sizes and Manifold Pressure – Single Phase Models

| Nameplate Input (Btu/hr) | | ALTITUDE OF INSTALLATION (FT. ABOVE SEA LEVEL) U.S.A.* | | | | |
|-----------------------------|-------------------------------|--|---------------------------------|---------------------------------|----------------------------------|----------------------------------|
| | | 0 to 2000 (0–610 m) | 2001 to 3000* (611 to 914 m) | 3001 to 4000 (915 to 1219 m) | 4001 to 5000 (1220 to 1524 m) | 5001 to 6000 (1524 to 1829 m) |
| 40000 | Orifice No. (Qty) | 55 (2) | 56 (2) | 56 (2) | 56 (2) | 56 (2) |
| | Manifold Press. (in. W.C.) | 10.0 | 11.0 | 11.0 | 11.0 | 10.7 |
| 60000 | Orifice No. (Qty) | 55 (3) | 56 (3) | 56 (3) | 56 (3) | 56 (3) |
| | Manifold Press. (in. W.C.) | 10.0 | 11.0 | 11.0 | 11.0 | 10.7 |
| 90000 | Orifice No. (Qty) | 53 (3) | 54 (3) | 54 (3) | 54 (3) | 54 (3) |
| | Manifold Press. (in. W.C.) | 10.0 | 11.0 | 11.0 | 11.0 | 11.0 |
| 115000 | Orifice No. (Qty) | 51 (3) | 52 (3) | 52 (3) | 53 (3) | 53 (3) |
| | Manifold Press. (in. W.C.) | 10.0 | 11.0 | 10.6 | 11.0 | 11.0 |
| 127000 | Orifice No. (Qty) | 49 (3) | 50 (3) | 51 (3) | 52 (3) | 52 (3) |
| | Manifold Press. (in. W.C.) | 10.0 | 11.0 | 11.0 | 11.0 | 11.0 |

*In the U.S.A., the input rating for altitudes above 2000 ft (610m) must be reduced by 4% for each 1000 ft (305 m) above sea level.

In Canada, the input rating for altitudes from 2001 to 4500 ft (611 to 1372 m) above sea level must be derated by 10% by an authorized gas conversion station or dealer. For Canadian Installations from 2000 to 4500 ft (610–1372 m), use U.S.A. column 2001 to 3000 ft (611 to 914 m).

† Use Kit No. NPLPCONV013C00 (0–2000 ft [0–610 m] above sea level). Use Kit No. NPLPCONV014C00 (2001–6000 ft [611–1829 m] above sea level).

Propane Gas Orifice Sizes and Manifold Pressure – Three Phase Models

| Nameplate Input (Btu/hr) | | ALTITUDE OF INSTALLATION (FT. ABOVE SEA LEVEL) U.S.A.* | | | | |
|--------------------------|-------------------------------|--|---------------------------------|---------------------------------|----------------------------------|----------------------------------|
| | | 0 to 2000 (0–610 m) | 2001 to 3000* (611 to 914 m) | 3001 to 4000 (915 to 1219 m) | 4001 to 5000 (1220 to 1524 m) | 5001 to 6000 (1524 to 1829 m) |
| 40000 | Orifice No. (Qty) | 55 (2) | 56 (2) | 56 (2) | 56 (2) | 56 (2) |
| | Manifold Press. (in. W.C.) | 10.0 | 11.0 | 11.0 | 11.0 | 10.7 |
| 60000 | Orifice No. (Qty) | 53 (2) | 54 (2) | 54 (2) | 54 (2) | 54 (2) |
| | Manifold Press. (in. W.C.) | 10.0 | 11.0 | 11.0 | 11.0 | 11.0 |
| 90000 | Orifice No. (Qty) | 53 (3) | 54 (3) | 54 (3) | 54 (3) | 54 (3) |
| | Manifold Press. (in. W.C.) | 10.0 | 11.0 | 11.0 | 11.0 | 11.0 |
| 115000 | Orifice No. (Qty) | 51 (3) | 52 (3) | 52 (3) | 53 (3) | 53 (3) |
| | Manifold Press. (in. W.C.) | 10.0 | 11.0 | 10.6 | 11.0 | 11.0 |
| 130000 | Orifice No. (Qty) | 49 (3) | 50 (3) | 51 (3) | 52 (3) | 52 (3) |
| | Manifold Press. (in. W.C.) | 10.0 | 11.0 | 11.0 | 11.0 | 11.0 |

*In the U.S.A., the input rating for altitudes above 2000 ft (610m) must be reduced by 4% for each 1000 ft (305 m) above sea level.

In Canada, the input rating for altitudes from 2001 to 4500 ft (611 to 1372 m) above sea level must be derated by 10% by an authorized gas conversion station or dealer.

For Canadian Installations from 2000 to 4500 ft (610–1372 m), use U.S.A. column 2001 to 3000 ft (611 to 914 m).

†Use Kit No. NPLPCONV013*00 (0–2000 ft [0–610 m] above sea level). Use Kit No. NPLPCONV014*00 (2001–6000 ft [611–1829 m] above sea level).

High Altitude Compensation, Propane Gas – Single Phase Models

| Nameplate Input (Btu/hr) | Rated Heating Input (Btu/hr), LP Gas at Installation Altitude Above Sea Level, U.S.A.* | | | | |
|--------------------------|--|------------------------------------|------------------------------------|-------------------------------------|-------------------------------------|
| | 0 to 2000 ft (0–610 m) | 2001 to 3000 ft* (611 to 914 m) | 3001 to 4000 ft (915 to 1219 m) | 4001 to 5000 ft (1220 to 1524 m) | 5001 to 6000 ft (1524 to 1829 m) |
| 40000 | 38000 | 31700 | 31700 | 31700 | 31200 |
| 60000 | 57000 | 47500 | 47500 | 47500 | 46900 |
| 90000 | 79000 | 68900 | 68900 | 68600 | 68600 |
| 115000 | 103000 | 100400 | 98900 | 83000 | 83000 |
| 127000 | 116000 | 115500 | 111800 | 101300 | 100400 |

*In the U.S.A., the input rating for altitudes above 2000 ft (610m) must be reduced by 4% for each 1000 ft (305 m) above sea level.

In Canada, the input rating for altitudes from 2001 to 4500 ft (611 to 1372 m) above sea level must be derated by 10% by an authorized gas conversion station or dealer.

For Canadian Installations from 2000 to 4500 ft (610–1372 m), use U.S.A. column 2001 to 3000 ft (611 to 914 m).

High Altitude Compensation, Propane Gas – Three Phase Models

| Nameplate Input (Btu/hr) | Rated Heating Input (Btu/hr), LP Gas at Installation Altitude Above Sea Level, U.S.A.* | | | | |
|--------------------------|--|------------------------------------|------------------------------------|-------------------------------------|-------------------------------------|
| | 0 to 2000 ft (0–610 m) | 2001 to 3000 ft* (611 to 914 m) | 3001 to 4000 ft (915 to 1219 m) | 4001 to 5000 ft (1220 to 1524 m) | 5001 to 6000 ft (1524 to 1829 m) |
| 40000 | 38000 | 31700 | 31700 | 31700 | 31200 |
| 60000 | 53000 | 45900 | 45900 | 45800 | 45800 |
| 90000 | 79000 | 68900 | 68900 | 68600 | 68600 |
| 115000 | 103000 | 100400 | 98900 | 83000 | 83000 |
| 130000 | 116000 | 115500 | 111800 | 101300 | 100400 |

*In the U.S.A., the input rating for altitudes above 2000 ft (610m) must be reduced by 4% for each 1000 ft (305 m) above sea level.

In Canada, the input rating for altitudes from 2001 to 4500 ft (611 to 1372 m) above sea level must be derated by 10% by an authorized gas conversion station or dealer.

For Canadian Installations from 2000 to 4500 ft (610–1372 m), use U.S.A. column 2001 to 3000 ft (611 to 914 m).

High Altitude Compensation, Natural Gas – Single Phase Models

| Nameplate Input (Btu/hr) | Rated Heating Input (Btu/hr), Natural Gas at Installation Altitude Above Sea Level, U.S.A.* | | | | |
|--------------------------|---|------------------------------------|------------------------------------|-------------------------------------|-------------------------------------|
| | 0 to 2000 ft (0–610 m) | 2001 to 3000 ft* (611 to 914 m) | 3001 to 4000 ft (915 to 1219 m) | 4001 to 5000 ft (1220 to 1524 m) | 5001 to 6000 ft (1524 to 1829 m) |
| 40000 | 40000 | 36000 | 34400 | 32800 | 31200 |
| 60000 | 60000 | 54000 | 51600 | 49200 | 46800 |
| 90000 | 90000 | 81000 | 77400 | 73800 | 70200 |
| 115000 | 115000 | 103500 | 98900 | 94300 | 89700 |
| 127000 | 127000 | 114300 | 109200 | 104100 | 99100 |

*In the U.S.A., the input rating for altitudes above 2000 ft (610m) must be reduced by 4% for each 1000 ft (305 m) above sea level.

In Canada, the input rating for altitudes from 2001 to 4500 ft (611 to 1372 m) above sea level must be derated by 10% by an authorized gas conversion station or dealer.

For Canadian Installations from 2000 to 4500 ft (610–1372 m), use U.S.A. column 2001 to 3000 ft (611 to 914 m).

High Altitude Compensation, Natural Gas – Three Phase

| Nameplate Input (Btu/hr) | Rated Heating Input (Btu/hr), Natural Gas at Installation Altitude Above Sea Level, U.S.A.* | | | | |
|--------------------------|---|------------------------------------|------------------------------------|-------------------------------------|-------------------------------------|
| | 0 to 2000 ft (0–610 m) | 2001 to 3000 ft* (611 to 914 m) | 3001 to 4000 ft (915 to 1219 m) | 4001 to 5000 ft (1220 to 1524 m) | 5001 to 6000 ft (1524 to 1829 m) |
| 40000 | 40000 | 36000 | 34400 | 32800 | 31200 |
| 60000 | 60000 | 54000 | 51600 | 49200 | 46800 |
| 90000 | 90000 | 81000 | 77400 | 73800 | 70200 |
| 115000 | 115000 | 103500 | 98900 | 94300 | 89700 |
| 130000 | 130000 | 117000 | 111800 | 106600 | 101400 |

*In the U.S.A., the input rating for altitudes above 2000 ft (610m) must be reduced by 4% for each 1000 ft (305 m) above sea level.

In Canada, the input rating for altitudes from 2001 to 4500 ft (611 to 1372 m) above sea level must be derated by 10% by an authorized gas conversion station or dealer.

For Canadian Installations from 2000 to 4500 ft (610–1372 m), use U.S.A. column 2001 to 3000 ft (611 to 914 m).

Dry Coil Air Delivery* – Horizontal and Downflow Discharge Sizes 24–60 208/230VAC – 1 Phase

| Unit Size | Heating Rise °F (°C) | Motor Speed | Tap | Allowable Functions | ESP (in. W.C.) | | | | | | | | | | | | |
|-----------|----------------------|-----------------------------|-------|--|--------------------|------|------|------|------|------|------|------|------|------|------|----|----|
| | | | | | 0.1 | 0.2 | 0.3 | 0.4 | 0.5 | 0.6 | 0.7 | 0.8 | 0.9 | 1 | | | |
| 24040 | 25 – 55 (14 – 31) | Low ³ | Blue | Alternate Heating | CFM | 654 | 552 | 454 | 338 | x | x | x | x | x | x | x | |
| | | | | | BHP | 0.09 | 0.10 | 0.10 | 0.11 | x | x | x | x | x | x | x | |
| | | | | | Gas Heat Rise (°F) | 45 | 54 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| | | Med – Low ¹ | Pink | Heating Alternate Cooling | CFM | 840 | 759 | 677 | 600 | 505 | 411 | 293 | x | x | x | x | x |
| | | | | | BHP | 0.14 | 0.15 | 0.16 | 0.16 | 0.17 | 0.17 | 0.18 | x | x | x | x | x |
| | | | | | Gas Heat Rise (°F) | 35 | 39 | 44 | 50 | NA | NA | NA | NA | NA | NA | NA | NA |
| | High | High Static Cooling Only | Black | High Static Cooling Only | CFM | 888 | 818 | 750 | 679 | 606 | 511 | 425 | 320 | 238 | x | x | |
| | | | | | BHP | 0.18 | 0.18 | 0.19 | 0.19 | 0.20 | 0.20 | 0.21 | 0.21 | 0.21 | 0.22 | x | |
| | | | | | Gas Heat Rise (°F) | 34 | 36 | 40 | 44 | 49 | NA | NA | NA | NA | NA | NA | NA |
| | | | | | Gas Heat Rise (°C) | 19 | 20 | 22 | 24 | 27 | NA | NA | NA | NA | NA | NA | NA |
| | | | | | CFM | 1133 | 1069 | 995 | 930 | 854 | 784 | 701 | 628 | 549 | 464 | x | x |
| | | | | | BHP | 0.26 | 0.27 | 0.28 | 0.29 | 0.30 | 0.30 | 0.31 | 0.31 | 0.32 | 0.33 | x | x |
| 24060 | 25 – 55 (14 – 31) | Low ³ | Blue | Alternate Cooling Alternate Heating | CFM | 654 | 552 | 454 | 338 | x | x | x | x | x | x | | |
| | | | | | BHP | 0.09 | 0.10 | 0.10 | 0.11 | x | x | x | x | x | x | x | |
| | | | | | Gas Heat Rise (°F) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| | | Med – Low | Pink | Alternate Cooling Alternate Heating | CFM | 840 | 759 | 677 | 600 | 505 | 411 | 293 | x | x | x | | |
| | | | | | BHP | 0.14 | 0.15 | 0.16 | 0.16 | 0.17 | 0.17 | 0.18 | x | x | x | | |
| | | | | | Gas Heat Rise (°F) | 53 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | |
| | High | High Static Cooling Only | Black | High Static Cooling Only | CFM | 888 | 818 | 750 | 679 | 606 | 511 | 425 | 320 | 238 | x | | |
| | | | | | BHP | 0.18 | 0.18 | 0.19 | 0.19 | 0.20 | 0.20 | 0.21 | 0.21 | 0.21 | 0.22 | x | |
| | | | | | Gas Heat Rise (°F) | 30 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | |
| | | | | | Gas Heat Rise (°C) | 30 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | |
| | | | | | CFM | 1133 | 1069 | 995 | 930 | 854 | 784 | 701 | 628 | 549 | 464 | x | |
| | | | | | BHP | 0.26 | 0.27 | 0.28 | 0.29 | 0.30 | 0.30 | 0.31 | 0.31 | 0.32 | 0.33 | x | |

*Air delivery values are without air filter and are for dry coil (See Wet Coil Pressure Drop table).

"High Static Cooling" = Only to be used for cooling function (not allowed for heating function)

1 Factory-shipped heating speed

2 Factory-shipped cooling speed

3 Factory-shipped continuous fan speed

"NA" = Not allowed for heating speed

NOTE: Ductwork field-supplied air filter pressure drop and wet coil pressure drop to obtain static pressure available for ducting.

Shaded areas indicate speed/static combinations that are not permitted for dehumidification speed.

Dry Coil Air Delivery* – Horizontal and Downflow Discharge Sizes 24–60 208/230VAC – 1 Phase (Cont.)

| Unit Size | Heating Rise °F (°C) | Motor Speed | Tap | Allowable Functions | ESP (in. W.C.) | | | | | | | | | | | | |
|-----------|----------------------|----------------------|--|--|--------------------|------|------|------|------|------|------|------|------|------|------|----|----|
| | | | | | 0.1 | 0.2 | 0.3 | 0.4 | 0.5 | 0.6 | 0.7 | 0.8 | 0.9 | 1 | | | |
| 30040 | 25 – 55 (14 – 31) | Low ³ | Blue | Alternate Heating | CFM | 654 | 552 | 454 | 338 | x | x | x | x | x | x | x | |
| | | | | | BHP | 0.09 | 0.10 | 0.10 | 0.11 | x | x | x | x | x | x | x | |
| | | Low ³ | Blue | Alternate Heating | Gas Heat Rise (°F) | 45 | 54 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| | | | | | Gas Heat Rise (°C) | 25 | 30 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| | | Med–Low ¹ | Pink | Heating Alternate Cooling | CFM | 840 | 759 | 677 | 600 | 505 | 411 | 293 | x | x | x | x | |
| | | | | | BHP | 0.14 | 0.15 | 0.16 | 0.16 | 0.17 | 0.17 | 0.18 | x | x | x | x | |
| | Medium ² | Red | Cooling Alternate Heating | CFM | 1104 | 1038 | 979 | 915 | 844 | 782 | 712 | 639 | 532 | 452 | | | |
| | | | | BHP | 0.26 | 0.27 | 0.28 | 0.28 | 0.29 | 0.30 | 0.30 | 0.30 | 0.31 | 0.31 | 0.32 | | |
| | Med–High | Orange | Alternate Cooling Alternate Heating | Gas Heat Rise (°F) | 27 | 29 | 30 | 33 | 35 | 38 | 42 | 47 | 54 | NA | | | |
| | | | | Gas Heat Rise (°C) | 15 | 16 | 17 | 18 | 20 | 21 | 23 | 26 | NA | NA | | | |
| | High | Black | High Static Cooling Only | CFM | 1133 | 1069 | 995 | 930 | 854 | 784 | 701 | 628 | 549 | 464 | | | |
| | | | | BHP | 0.26 | 0.27 | 0.28 | 0.29 | 0.30 | 0.30 | 0.31 | 0.31 | 0.32 | 0.32 | | | |
| 30060 | 25 – 55 (14 – 31) | Low ³ | Blue | Alternate Cooling Alternate Heating | CFM | 654 | 552 | 454 | 338 | x | x | x | x | x | x | | |
| | | | | | BHP | 0.09 | 0.10 | 0.10 | 0.11 | x | x | x | x | x | x | | |
| | | Med–Low | Pink | Alternate Cooling Alternate Heating | Gas Heat Rise (°F) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | | |
| | | | | | Gas Heat Rise (°C) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | | |
| | | Medium ² | Red | Cooling Alternate Heating | CFM | 840 | 759 | 677 | 600 | 505 | 411 | 293 | x | x | | | |
| | | | | | BHP | 0.14 | 0.15 | 0.16 | 0.16 | 0.17 | 0.17 | 0.18 | x | x | x | | |
| | High | Black | High Static Cooling Only | CFM | 1291 | 1241 | 1190 | 1131 | 1081 | 1028 | 949 | 854 | 742 | 616 | | | |
| | | | | BHP | 0.41 | 0.42 | 0.43 | 0.43 | 0.44 | 0.45 | 0.44 | 0.42 | 0.40 | 0.38 | | | |

*Air delivery values are without air filter and are for dry coil (See Wet Coil Pressure Drop table).

"High Static Cooling" = Only to be used for cooling function (not allowed for heating function)

1 Factory-shipped heating speed

2 Factory-shipped cooling speed

3 Factory-shipped continuous fan speed

"NA" = Not allowed for heating speed

NOTE: Ductwork field-supplied air filter pressure drop and wet coil pressure drop to obtain static pressure available for ducting.

Shaded areas indicate speed/static combinations that are not permitted for dehumidification speed.

Dry Coil Air Delivery* – Horizontal and Downflow Discharge Sizes 24–60 208/230VAC – 1 Phase (Cont.)

| Unit Size | Heating Rise °F (°C) | Motor Speed | Tap | Allowable Functions | ESP (in. W.C.) | | | | | | | | | | | |
|---------------------------|----------------------|--|------------------------------|------------------------------|--------------------|--------------------|------|------|------|------|------|------|------|------|------|------|
| | | | | | 0.1 | 0.2 | 0.3 | 0.4 | 0.5 | 0.6 | 0.7 | 0.8 | 0.9 | 1 | | |
| 36060 | 25 – 55 (14 – 31) | Low ³ | Blue | Heating Alternate Cooling | CFM | 650 | 587 | 517 | 442 | 381 | 320 | 259 | x | x | x | |
| | | | | | BHP | 0.08 | 0.08 | 0.09 | 0.09 | 0.10 | 0.10 | 0.11 | x | x | x | |
| | | | | | Gas Heat Rise (°F) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| | | Med– Low ¹ | Pink | Heating Alternate Cooling | CFM | 1144 | 1105 | 1066 | 1026 | 984 | 941 | 895 | 850 | 806 | 763 | |
| | | | | | BHP | 0.28 | 0.28 | 0.29 | 0.30 | 0.31 | 0.31 | 0.32 | 0.33 | 0.34 | | |
| | | | | | Gas Heat Rise (°F) | 39 | 41 | 42 | 44 | 46 | 48 | 50 | 53 | NA | NA | |
| | Medium ² | Red | Cooling Alternate Heating | CFM | 1223 | 1186 | 1151 | 1115 | 1075 | 1039 | 1001 | 957 | 914 | 870 | | |
| | | | | BHP | 0.34 | 0.34 | 0.35 | 0.36 | 0.37 | 0.37 | 0.38 | 0.39 | 0.40 | | | |
| | | | | Gas Heat Rise (°F) | 20 | 21 | 22 | 22 | 23 | 24 | 25 | 26 | 27 | 29 | | |
| | 36090 | 35 – 65 (19 – 36) | Med– High | Orange | Alternate Cooling | CFM | 1356 | 1321 | 1288 | 1251 | 1216 | 1181 | 1149 | 1109 | 1071 | 1034 |
| | | | | | | BHP | 0.43 | 0.44 | 0.45 | 0.46 | 0.46 | 0.47 | 0.48 | 0.49 | 0.50 | |
| | | | | | | Gas Heat Rise (°F) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| High | | | Black | High Static Cooling Only | CFM | 1520 | 1487 | 1459 | 1429 | 1394 | 1364 | 1331 | 1295 | 1261 | 1225 | |
| | | | | | BHP | 0.60 | 0.60 | 0.61 | 0.62 | 0.63 | 0.64 | 0.65 | 0.66 | 0.66 | | |
| | | | | | CFM | 650 | 587 | 517 | 442 | 381 | 320 | 259 | x | x | x | |
| Low ³ | Blue | Alternate Cooling Alternate Heating | BHP | 0.08 | 0.08 | 0.09 | 0.09 | 0.10 | 0.10 | 0.10 | 0.11 | x | x | | | |
| | | | Gas Heat Rise (°F) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | | | |
| | | | Gas Heat Rise (°C) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | | | |
| Med– Low | Pink | Cooling Alternate Heating | CFM | 1144 | 1105 | 1066 | 1026 | 984 | 941 | 895 | 850 | 806 | 763 | | | |
| | | | BHP | 0.28 | 0.28 | 0.29 | 0.30 | 0.31 | 0.31 | 0.32 | 0.33 | 0.34 | | | | |
| | | | Gas Heat Rise (°F) | 58 | 61 | 63 | 65 | NA | NA | NA | NA | NA | NA | | | |
| Medium ² | Red | Cooling Alternate Heating | CFM | 1223 | 1186 | 1151 | 1115 | 1075 | 1039 | 1001 | 957 | 914 | 870 | | | |
| | | | BHP | 0.34 | 0.34 | 0.35 | 0.36 | 0.37 | 0.37 | 0.38 | 0.39 | 0.40 | | | | |
| | | | Gas Heat Rise (°F) | 55 | 56 | 58 | 60 | 62 | 64 | NA | NA | NA | NA | | | |
| Med– High ¹ | Orange | Heating Alternate Cooling | CFM | 1356 | 1321 | 1288 | 1251 | 1216 | 1181 | 1149 | 1109 | 1071 | 1034 | | | |
| | | | BHP | 0.43 | 0.44 | 0.45 | 0.46 | 0.46 | 0.47 | 0.48 | 0.49 | 0.50 | | | | |
| | | | Gas Heat Rise (°F) | 49 | 51 | 52 | 53 | 55 | 57 | 58 | 60 | 62 | 65 | | | |
| High | Black | High Static Cooling Only | CFM | 1520 | 1487 | 1459 | 1429 | 1394 | 1364 | 1331 | 1295 | 1261 | 1225 | | | |
| | | | BHP | 0.60 | 0.60 | 0.61 | 0.62 | 0.63 | 0.64 | 0.65 | 0.66 | 0.66 | | | | |

*Air delivery values are without air filter and are for dry coil (See Wet Coil Pressure Drop table).

"High Static Cooling" = Only to be used for cooling function (not allowed for heating function)

¹ Factory-shipped heating speed

² Factory-shipped cooling speed

³ Factory-shipped continuous fan speed

"NA" = Not allowed for heating speed

NOTE: Deduct field-supplied air filter pressure drop and wet coil pressure drop to obtain static pressure available for ducting.

Shaded areas indicate speed/static combinations that are not permitted for dehumidification speed.

Dry Coil Air Delivery* – Horizontal and Downflow Discharge Sizes 24–60 208/230VAC – 1 Phase (Cont.)

| Unit Size | Heating Rise °F (°C) | Motor Speed | Tap | Allowable Functions | ESP (in. W.C.) | | | | | | | | | | | |
|-----------------------|----------------------|------------------------------|--|------------------------------|------------------------------|------|------|------|------|------|------|------|------|------|------|------|
| | | | | | 0.1 | 0.2 | 0.3 | 0.4 | 0.5 | 0.6 | 0.7 | 0.8 | 0.9 | 1 | | |
| 42060 | 25 – 55 (14 – 31) | Low ³ | Blue | Alternate Heating | CFM | 1001 | 902 | 833 | 777 | 717 | 650 | 575 | 527 | 466 | 419 | |
| | | | | | BHP | 0.13 | 0.13 | 0.14 | 0.14 | 0.15 | 0.16 | 0.17 | 0.18 | 0.19 | 0.20 | |
| | | Med–Low ¹ | Pink | Heating | Gas Heat Rise (°F) | 45 | 50 | 54 | NA | NA | NA | NA | NA | NA | NA | NA |
| | | | | | Gas Heat Rise (°C) | 25 | 28 | 30 | NA | NA | NA | NA | NA | NA | NA | NA |
| | | Medium ² | Red | Cooling Alternate Heating | CFM | 1016 | 950 | 902 | 842 | 783 | 721 | 655 | 590 | 541 | 480 | |
| | | | | | BHP | 0.13 | 0.14 | 0.15 | 0.16 | 0.17 | 0.18 | 0.19 | 0.20 | 0.21 | 0.22 | |
| | Med–High | Orange | Alternate Cooling Alternate Heating | Gas Heat Rise (°F) | 44 | 47 | 50 | 53 | NA | NA | NA | NA | NA | NA | | |
| | | | | Gas Heat Rise (°C) | 25 | 26 | 28 | 30 | NA | NA | NA | NA | NA | NA | | |
| | High | Black | High Static Cooling Only | CFM | 1403 | 1358 | 1316 | 1265 | 1217 | 1167 | 1116 | 1067 | 1012 | 956 | | |
| | | | | BHP | 0.29 | 0.30 | 0.31 | 0.33 | 0.34 | 0.35 | 0.36 | 0.37 | 0.38 | 0.39 | | |
| | 42090 | 35 – 65 (19 – 36) | Low ³ | Blue | Cooling Alternate Heating | CFM | 1461 | 1411 | 1367 | 1327 | 1275 | 1220 | 1174 | 1127 | 1074 | 1022 |
| | | | | | | BHP | 0.32 | 0.33 | 0.35 | 0.36 | 0.37 | 0.38 | 0.39 | 0.40 | 0.41 | 0.42 |
| Med–Low | | | Pink | Heating | Gas Heat Rise (°F) | 31 | 32 | 33 | 34 | 35 | 37 | 38 | 40 | 42 | 44 | |
| | | | | | Gas Heat Rise (°C) | 17 | 18 | 18 | 19 | 20 | 21 | 22 | 23 | 25 | 26 | |
| Medium ² | | | Red | Cooling Alternate Heating | CFM | 1575 | 1528 | 1488 | 1447 | 1406 | 1360 | 1314 | 1264 | 1213 | 1159 | |
| | | | | | BHP | 0.40 | 0.42 | 0.43 | 0.44 | 0.45 | 0.46 | 0.47 | 0.48 | 0.49 | 0.50 | |
| High | | Black | High Static Cooling Only | CFM | 1001 | 902 | 833 | 777 | 717 | 650 | 575 | 527 | 466 | 419 | | |
| | | | | BHP | 0.13 | 0.13 | 0.14 | 0.14 | 0.15 | 0.16 | 0.17 | 0.18 | 0.19 | 0.20 | | |
| Med–High ¹ | | Orange | Alternate Cooling | Gas Heat Rise (°F) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | | |
| | | | | Gas Heat Rise (°C) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | | |
| High | | Black | High Static Cooling Only | CFM | 1016 | 950 | 902 | 842 | 783 | 721 | 655 | 590 | 541 | 480 | | |
| | | | | BHP | 0.13 | 0.14 | 0.15 | 0.16 | 0.17 | 0.18 | 0.19 | 0.20 | 0.21 | 0.22 | | |
| Medium ² | Red | Cooling Alternate Heating | Gas Heat Rise (°F) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | | | |
| | | | Gas Heat Rise (°C) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | | | |
| High | Black | High Static Cooling Only | CFM | 1403 | 1358 | 1316 | 1265 | 1217 | 1167 | 1116 | 1067 | 1012 | 956 | | | |
| | | | BHP | 0.29 | 0.30 | 0.31 | 0.33 | 0.34 | 0.35 | 0.36 | 0.37 | 0.38 | 0.39 | | | |
| Med–High ¹ | Orange | Alternate Cooling | Gas Heat Rise (°F) | 48 | 50 | 51 | 53 | 56 | 58 | 61 | 63 | 63 | 63 | | | |
| | | | Gas Heat Rise (°C) | 27 | 28 | 29 | 30 | 31 | 32 | 34 | 35 | 35 | 35 | | | |
| High | Black | High Static Cooling Only | CFM | 1461 | 1411 | 1367 | 1327 | 1275 | 1220 | 1174 | 1127 | 1074 | 1022 | | | |
| | | | BHP | 0.32 | 0.33 | 0.35 | 0.36 | 0.37 | 0.38 | 0.39 | 0.40 | 0.41 | 0.42 | | | |
| Medium ² | Red | Cooling Alternate Heating | Gas Heat Rise (°F) | 46 | 48 | 49 | 51 | 53 | 55 | 58 | 60 | 63 | 63 | | | |
| | | | Gas Heat Rise (°C) | 26 | 27 | 27 | 28 | 29 | 31 | 32 | 33 | 35 | 35 | | | |
| High | Black | High Static Cooling Only | CFM | 1575 | 1528 | 1488 | 1447 | 1406 | 1360 | 1314 | 1264 | 1213 | 1159 | | | |
| | | | BHP | 0.40 | 0.42 | 0.43 | 0.44 | 0.45 | 0.46 | 0.47 | 0.48 | 0.49 | 0.50 | | | |

*Air delivery values are without air filter and are for dry coil (See Wet Coil Pressure Drop table).

"High Static Cooling" = Only to be used for cooling function (not allowed for heating function)

1 Factory-shipped heating speed

2 Factory-shipped cooling speed

3 Factory-shipped continuous fan speed

"NA" = Not allowed for heating speed

NOTE: Ductwork field-supplied air filter pressure drop and wet coil pressure drop to obtain static pressure available for ducting.

Shaded areas indicate speed/static combinations that are not permitted for dehumidification speed.

Dry Coil Air Delivery* – Horizontal and Downflow Discharge Sizes 24–60 208/230VAC – 1 Phase (Cont.)

| Unit Size | Heating Rise °F (°C) | Motor Speed | Tap | Allowable Functions | ESP (in. W.C.) | | | | | | | | | | | |
|-----------------------|----------------------|--|------------------------------|------------------------------|-----------------------------|------|------|------|------|------|------|------|------|------|------|------|
| | | | | | 0.1 | 0.2 | 0.3 | 0.4 | 0.5 | 0.6 | 0.7 | 0.8 | 0.9 | 1 | | |
| 48090 | 35 – 65 (19 – 36) | Low ³ | Blue | Heating Alternate Cooling | CFM | 644 | 552 | 461 | 376 | 301 | 235 | x | x | x | x | |
| | | | | | BHP | 0.06 | 0.07 | 0.07 | 0.08 | 0.08 | 0.09 | x | x | x | x | |
| | | | | | Gas Heat Rise (°F) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| | | Med–Low ¹ | Pink | Heating Alternate Cooling | CFM | 1430 | 1386 | 1347 | 1302 | 1258 | 1208 | 1160 | 1114 | 1065 | 1014 | |
| | | | | | BHP | 0.26 | 0.27 | 0.28 | 0.29 | 0.30 | 0.30 | 0.32 | 0.33 | 0.34 | 0.35 | |
| | | | | | Gas Heat Rise (°F) | 47 | 49 | 50 | 52 | 54 | 56 | 58 | 61 | 64 | NA | |
| | Medium ² | Red | Cooling Alternate Heating | CFM | 1658 | 1622 | 1585 | 1549 | 1512 | 1476 | 1442 | 1402 | 1360 | 1322 | | |
| | | | | BHP | 0.39 | 0.40 | 0.41 | 0.42 | 0.44 | 0.45 | 0.46 | 0.47 | 0.48 | 0.49 | | |
| | | | | Gas Heat Rise (°F) | 41 | 42 | 43 | 44 | 45 | 46 | 47 | 48 | 50 | 51 | | |
| | 48115 | 30 – 60 (17 – 33) | High | Black | High Static Cooling Only | CFM | 2201 | 2172 | 2138 | 2108 | 2074 | 2041 | 1970 | 1867 | 1764 | 1634 |
| | | | | | | BHP | 0.83 | 0.84 | 0.87 | 0.88 | 0.89 | 0.91 | 0.89 | 0.83 | 0.79 | 0.74 |
| | | | | | | CFM | 644 | 552 | 461 | 376 | 301 | 235 | x | x | x | x |
| Low ³ | | | Blue | Heating Alternate Heating | BHP | 0.06 | 0.07 | 0.07 | 0.08 | 0.08 | 0.09 | 0.09 | x | x | x | |
| | | | | | Gas Heat Rise (°F) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| | | | | | Gas Heat Rise (°C) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| Med–Low | Pink | Alternate Cooling Alternate Heating | CFM | 1430 | 1386 | 1347 | 1302 | 1258 | 1208 | 1160 | 1114 | 1065 | 1014 | | | |
| | | | BHP | 0.26 | 0.27 | 0.28 | 0.29 | 0.30 | 0.30 | 0.32 | 0.33 | 0.34 | 0.35 | | | |
| | | | Gas Heat Rise (°F) | 60 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | | |
| Medium ² | Red | Cooling Alternate Heating | CFM | 1658 | 1622 | 1585 | 1549 | 1512 | 1476 | 1442 | 1402 | 1360 | 1322 | | | |
| | | | BHP | 0.39 | 0.40 | 0.41 | 0.42 | 0.44 | 0.45 | 0.46 | 0.47 | 0.48 | 0.49 | | | |
| | | | Gas Heat Rise (°F) | 52 | 53 | 55 | 56 | 57 | 59 | 60 | NA | NA | NA | | | |
| Med–High ¹ | Orange | Heating Alternate Cooling | CFM | 1945 | 1913 | 1867 | 1829 | 1792 | 1758 | 1717 | 1688 | 1645 | 1603 | | | |
| | | | BHP | 0.58 | 0.59 | 0.61 | 0.63 | 0.64 | 0.65 | 0.67 | 0.68 | 0.69 | 0.71 | | | |
| | | | Gas Heat Rise (°F) | 44 | 45 | 46 | 47 | 48 | 49 | 50 | 51 | 53 | 54 | | | |
| High | Black | High Static Cooling Only | CFM | 2201 | 2172 | 2138 | 2108 | 2074 | 2041 | 1970 | 1867 | 1764 | 1634 | | | |
| | | | BHP | 0.83 | 0.84 | 0.87 | 0.88 | 0.89 | 0.91 | 0.89 | 0.83 | 0.79 | 0.74 | | | |

*Air delivery values are without air filter and are for dry coil (See Wet Coil Pressure Drop table).

"High Static Cooling" = Only to be used for cooling function (not allowed for heating function)

¹ Factory-shipped heating speed

² Factory-shipped cooling speed

³ Factory-shipped continuous fan speed

"NA" = Not allowed for heating speed

NOTE: Deduct field-supplied air filter pressure drop and wet coil pressure drop to obtain static pressure available for ducting.

Shaded areas indicate speed/static combinations that are not permitted for dehumidification speed.

Dry Coil Air Delivery* – Horizontal and Downflow Discharge Sizes 24–60 208/230VAC – 1 Phase (Cont.)

| Unit Size | Heating Rise °F (°C) | Motor Speed | Tap | Allowable Functions | ESP (in. W.C.) | | | | | | | | | | | | |
|-----------|----------------------|----------------------|-----------------------|---------------------------|---------------------------|---------------------------|--------------------|------|------|------|------|------|------|------|------|------|------|
| | | | | | 0.1 | 0.2 | 0.3 | 0.4 | 0.5 | 0.6 | 0.7 | 0.8 | 0.9 | 1 | | | |
| 48130 | | Low ³ | Blue | Alternate Cooling | CFM | 644 | 552 | 461 | 376 | 301 | 235 | x | x | x | x | | |
| | | | | | BHP | 0.06 | 0.07 | 0.07 | 0.08 | 0.08 | 0.09 | x | x | x | x | | |
| | | Med–Low | Pink | Alternate Cooling | Gas Heat Rise (°F) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| | | | | | Gas Heat Rise (°C) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| | | 35 – 65 (19 – 36) | | | Red | Cooling Alternate Heating | CFM | 1430 | 1386 | 1347 | 1302 | 1258 | 1208 | 1160 | 1114 | 1065 | 1014 |
| | | | | | | | BHP | 0.26 | 0.27 | 0.28 | 0.29 | 0.30 | 0.30 | 0.32 | 0.33 | 0.34 | 0.35 |
| | | | | Orange | Heating Alternate Cooling | Gas Heat Rise (°F) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| | | | | | | Gas Heat Rise (°C) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| | 60090 | 35 – 65 (19 – 36) | High | Black | High Static Cooling Only | CFM | 1658 | 1622 | 1585 | 1549 | 1512 | 1476 | 1442 | 1402 | 1360 | 1322 | |
| | | | | | | BHP | 0.39 | 0.40 | 0.41 | 0.42 | 0.44 | 0.45 | 0.46 | 0.47 | 0.48 | 0.49 | |
| | | | Med–High ¹ | Orange | Heating Alternate Cooling | Gas Heat Rise (°F) | 58 | 59 | 61 | 62 | 63 | 65 | NA | NA | NA | NA | |
| | | | | | | Gas Heat Rise (°C) | 32 | 33 | 34 | 34 | 35 | 36 | NA | NA | NA | NA | |
| | | | | | Black | High Static Cooling Only | CFM | 1945 | 1913 | 1867 | 1829 | 1792 | 1758 | 1717 | 1688 | 1645 | 1603 |
| | | | | | | | BHP | 0.58 | 0.59 | 0.61 | 0.63 | 0.64 | 0.65 | 0.67 | 0.68 | 0.69 | 0.71 |
| | | Low ³ | Blue | Heating Alternate Cooling | Gas Heat Rise (°F) | 49 | 50 | 51 | 52 | 54 | 55 | 56 | 57 | 58 | 60 | | |
| | | | | | Gas Heat Rise (°C) | 27 | 28 | 29 | 29 | 30 | 30 | 31 | 32 | 32 | 33 | | |
| 60090 | 35 – 65 (19 – 36) | Med–Low ¹ | Pink | Heating | CFM | 2201 | 2172 | 2138 | 2108 | 2074 | 2041 | 1970 | 1867 | 1764 | 1634 | | |
| | | | | | BHP | 0.83 | 0.84 | 0.87 | 0.88 | 0.89 | 0.91 | 0.89 | 0.83 | 0.79 | 0.74 | | |
| | | | | | Red | Cooling Alternate Heating | CFM | 839 | 768 | 697 | 625 | 551 | 486 | 422 | 360 | 306 | x |
| | | | | | | | BHP | 0.09 | 0.10 | 0.10 | 0.11 | 0.12 | 0.12 | 0.13 | 0.14 | 0.14 | x |
| | | | | | Black | High Static Cooling Only | Gas Heat Rise (°F) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| | | | | | | | Gas Heat Rise (°C) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| | | High | Black | High Static Cooling Only | CFM | 1403 | 1361 | 1320 | 1276 | 1236 | 1192 | 1145 | 1099 | 1054 | 1012 | | |
| | | | | | BHP | 0.28 | 0.29 | 0.30 | 0.31 | 0.31 | 0.33 | 0.34 | 0.35 | 0.36 | 0.37 | | |

*Air delivery values are without air filter and are for dry coil (See Wet Coil Pressure Drop table).

"High Static Cooling" = Only to be used for cooling function (not allowed for heating function)

1 Factory-shipped heating speed

2 Factory-shipped cooling speed

3 Factory-shipped continuous fan speed

"NA" = Not allowed for heating speed

NOTE: Deduct field-supplied air filter pressure drop and wet coil pressure drop to obtain static pressure available for ducting.

Shaded areas indicate speed/static combinations that are not permitted for dehumidification speed.

Dry Coil Air Delivery* – Horizontal and Downflow Discharge Sizes 24–60 208/230VAC – 1 Phase (Cont.)

| Unit Size | Heating Rise °F (°C) | Motor Speed | Tap | Allowable Functions | ESP (in. W.C.) | | | | | | | | | | | |
|-----------|----------------------|-----------------------|--------|---------------------------|--------------------|-------|-------|-------|-------|-------|-------|-------|-------|-------|------|----|
| | | | | | 0.1 | 0.2 | 0.3 | 0.4 | 0.5 | 0.6 | 0.7 | 0.8 | 0.9 | 1 | | |
| 60115 | 30 – 60 (17 – 33) | Low ³ | Blue | | CFM | 839 | 768 | 697 | 625 | 551 | 486 | 422 | 360 | 306 | x | |
| | | | | | BHP | 0.09 | 0.10 | 0.10 | 0.11 | 0.12 | 0.12 | 0.13 | 0.14 | x | | |
| | | | | | Gas Heat Rise (°F) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | |
| | | | | | Gas Heat Rise (°C) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | |
| | | | | | CFM | 1403 | 1361 | 1320 | 1276 | 1236 | 1192 | 1145 | 1099 | 1054 | 1012 | |
| | | | | | BHP | 0.28 | 0.29 | 0.30 | 0.31 | 0.31 | 0.33 | 0.34 | 0.35 | 0.36 | 0.37 | |
| | | Med–Low | Pink | | Rise (°F) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| | | | | | Rise (°C) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | |
| | | | | | CFM | 1822 | 1788 | 1757 | 1726 | 1690 | 1657 | 1623 | 1589 | 1553 | 1518 | |
| | | | | | BHP | 0.54 | 0.55 | 0.56 | 0.57 | 0.59 | 0.60 | 0.61 | 0.62 | 0.63 | 0.64 | |
| | | | | | Gas Heat Rise (°F) | 47 | 48 | 49 | 50 | 51 | 52 | 53 | 54 | 56 | 57 | |
| | | | | | Gas Heat Rise (°C) | 26 | 27 | 27 | 28 | 28 | 29 | 30 | 30 | 31 | 32 | |
| 60130 | 35 – 65 (19 – 36) | Med–High ¹ | Orange | Heating Alternate Cooling | CFM | 1982 | 1940 | 1900 | 1859 | 1816 | 1775 | 1739 | 1701 | 1655 | 1596 | |
| | | | | | BHP | 0.61 | 0.62 | 0.63 | 0.65 | 0.66 | 0.67 | 0.69 | 0.70 | 0.71 | 0.73 | |
| | | | | | Gas Heat Rise (°F) | 44 | 45 | 45 | 46 | 48 | 49 | 50 | 51 | 52 | 54 | |
| | | | | | Gas Heat Rise (°C) | 24 | 25 | 25 | 26 | 26 | 27 | 28 | 28 | 29 | 30 | |
| | | | | | CFM | 2271 | 2241 | 2206 | 2171 | 2134 | 2080 | 1973 | 1857 | 1746 | 1596 | |
| | | | | | BHP | 0.90 | 0.91 | 0.93 | 0.95 | 0.96 | 0.95 | 0.90 | 0.84 | 0.78 | 0.73 | |
| | | High | Black | High Static Cooling Only | CFM | 839.2 | 768.3 | 696.8 | 625.4 | 551.4 | 485.6 | 421.7 | 360.2 | 305.8 | x | |
| | | | | | BHP | 0.09 | 0.10 | 0.10 | 0.11 | 0.12 | 0.12 | 0.13 | 0.14 | 0.14 | x | |
| | | | | | Gas Heat Rise (°F) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | |
| | | | | | Gas Heat Rise (°C) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | |
| | | | | | CFM | 1403 | 1361 | 1320 | 1276 | 1236 | 1192 | 1145 | 1099 | 1054 | 1012 | |
| | | | | | BHP | 0.28 | 0.29 | 0.30 | 0.31 | 0.31 | 0.33 | 0.34 | 0.35 | 0.36 | 0.37 | |
| 60130 | 35 – 65 (19 – 36) | Med–Low | Pink | | Rise (°F) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | |
| | | | | | Rise (°C) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | |
| | | | | | CFM | 1822 | 1788 | 1757 | 1726 | 1690 | 1657 | 1623 | 1589 | 1553 | 1518 | |
| | | | | | BHP | 0.54 | 0.55 | 0.56 | 0.57 | 0.59 | 0.60 | 0.61 | 0.62 | 0.63 | 0.64 | |
| | | | | | Gas Heat Rise (°F) | 53 | 54 | 55 | 56 | 57 | 58 | 59 | 60 | 62 | 63 | |
| | | | | | Gas Heat Rise (°C) | 29 | 30 | 30 | 31 | 32 | 32 | 33 | 34 | 34 | 35 | |
| | | Medium ² | Red | Cooling Alternate Heating | CFM | 1982 | 1940 | 1900 | 1859 | 1816 | 1775 | 1739 | 1701 | 1655 | 1596 | |
| | | | | | BHP | 0.61 | 0.62 | 0.63 | 0.65 | 0.66 | 0.67 | 0.69 | 0.70 | 0.71 | 0.73 | |
| | | | | | Gas Heat Rise (°F) | 48 | 49 | 50 | 52 | 53 | 54 | 55 | 56 | 58 | 60 | |
| | | | | | Gas Heat Rise (°C) | 27 | 27 | 28 | 29 | 29 | 30 | 31 | 31 | 32 | 33 | |
| | | | | | CFM | 2271 | 2241 | 2206 | 2171 | 2134 | 2080 | 1973 | 1857 | 1746 | 1596 | |
| | | | | | BHP | 0.90 | 0.91 | 0.93 | 0.95 | 0.96 | 0.95 | 0.90 | 0.84 | 0.78 | 0.73 | |

*Air delivery values are without air filter and are for dry coil (See Wet Coil Pressure Drop table).

"High Static Cooling" = Only to be used for cooling function (not allowed for heating function)

¹ Factory-shipped heating speed

² Factory-shipped cooling speed

³ Factory-shipped continuous fan speed

"NA" = Not allowed for heating speed

NOTE: Deduct field-supplied air filter pressure drop and wet coil pressure drop to obtain static pressure available for ducting.

Shaded areas indicate speed/static combinations that are not permitted for dehumidification speed.

Dry Coil Air Delivery* – Horizontal Discharge Sizes 36–60 3 Phase Models Only

| Unit | Heating Rise Range | Motor Speed | Wire Color | | External Static Pressure (IN. W.C.) | | | | | | | | | |
|-------|--------------------------|-----------------------|------------|-------------------|-------------------------------------|------|------|------|------|------|------|------|-----|----|
| | | | | | 0.1 | 0.2 | 0.3 | 0.4 | 0.5 | 0.6 | 0.7 | 0.8 | 0.9 | |
| 36060 | 25 – 55°F (14 – 31°C) | Low | Blue | CFM | 979 | 912 | 859 | 789 | 731 | 654 | 556 | 454 | 374 | |
| | | | | Heating Rise (°F) | 45 | 48 | 51 | NA | NA | NA | NA | NA | NA | NA |
| | | Med–Low ¹ | Pink | CFM | 1136 | 1080 | 1015 | 957 | 912 | 861 | 808 | 723 | 633 | |
| | | | | Heating Rise (°F) | 39 | 41 | 43 | 46 | 48 | 51 | 54 | NA | NA | |
| | | Medium ² | Red | CFM | 1208 | 1144 | 1091 | 1025 | 964 | 902 | 886 | 830 | 746 | |
| | | | | Heating Rise (°F) | 36 | 38 | 40 | 43 | 46 | 49 | 50 | 53 | NA | |
| | | Med–High | Orange | CFM | 1495 | 1439 | 1376 | 1303 | 1221 | 1207 | 1137 | 1052 | 981 | |
| | | | | Heating Rise (°F) | 29 | 31 | 32 | 34 | 36 | 36 | 39 | 42 | 45 | |
| | | High | Black | CFM | 1560 | 1491 | 1416 | 1337 | 1255 | 1233 | 1160 | 1082 | 998 | |
| | | | | Heating Rise (°F) | 28 | 30 | 31 | 33 | 35 | 36 | 38 | 41 | 44 | |
| 36090 | 35 – 65°F (19 – 36°C) | Low | Blue | CFM | 979 | 912 | 859 | 789 | 731 | 654 | 556 | 454 | 374 | |
| | | | | Heating Rise (°F) | NA | NA | NA | NA | NA | NA | NA | NA | NA | |
| | | Med–Low | Pink | CFM | 1136 | 1080 | 1015 | 957 | 912 | 861 | 808 | 723 | 633 | |
| | | | | Heating Rise (°F) | 58 | 61 | 65 | NA | NA | NA | NA | NA | NA | |
| | | Medium ² | Red | CFM | 1208 | 1144 | 1091 | 1025 | 964 | 902 | 886 | 830 | 746 | |
| | | | | Heating Rise (°F) | 54 | 58 | 60 | 64 | NA | NA | NA | NA | NA | |
| | | Med–High ¹ | Orange | CFM | 1495 | 1439 | 1376 | 1303 | 1221 | 1207 | 1137 | 1052 | 981 | |
| | | | | Heating Rise (°F) | 44 | 46 | 48 | 51 | 54 | 55 | 58 | 63 | NA | |
| | | High | Black | CFM | 1560 | 1491 | 1416 | 1337 | 1255 | 1233 | 1160 | 1082 | 998 | |
| | | | | Heating Rise (°F) | 42 | 44 | 46 | 49 | 52 | 53 | 57 | 61 | NA | |
| | | | | | 23 | 25 | 26 | 27 | 29 | 29 | 30 | 30 | 32 | 34 |

Specifications subject to change without notice.

Dry Coil Air Delivery* – Horizontal Discharge Sizes 36–60 3 Phase Models Only (Cont.)

| Unit | Heating Rise Range | Motor Speed | Wire Color | | External Static Pressure (IN. W.C.) | | | | | | | | | | |
|-------------------|--------------------------|-----------------------|------------|-------------------|-------------------------------------|------|------|------|------|------|------|-----|-----|--|--|
| | | | | | 0.1 | 0.2 | 0.3 | 0.4 | 0.5 | 0.6 | 0.7 | 0.8 | 0.9 | | |
| 42060 | 25 – 55°F (14 – 31°C) | Low | Blue | CFM | 952 | 882 | 806 | 746 | 671 | 605 | 530 | 551 | 486 | | |
| | | | | Heating Rise (°F) | 46 | 49 | 54 | NA | NA | NA | NA | NA | NA | | |
| | | | | Heating Rise (°C) | 25 | 27 | 30 | NA | NA | NA | NA | NA | NA | | |
| | | Med–Low ¹ | Pink | CFM | 1002 | 936 | 875 | 821 | 748 | 687 | 613 | 554 | 565 | | |
| | | | | Heating Rise (°F) | 43 | 46 | 50 | 53 | NA | NA | NA | NA | NA | | |
| | | | | Heating Rise (°C) | 24 | 26 | 28 | 29 | NA | NA | NA | NA | NA | | |
| | | Medium | Red | CFM | 1255 | 1210 | 1145 | 1074 | 1008 | 940 | 878 | 895 | 838 | | |
| | | | | Heating Rise (°F) | 35 | 36 | 38 | 40 | 43 | 46 | 49 | 48 | 52 | | |
| | | | | Heating Rise (°C) | 19 | 20 | 21 | 22 | 24 | 26 | 27 | 27 | 29 | | |
| | | Med–High ² | Orange | CFM | 1335 | 1267 | 1246 | 1176 | 1109 | 1049 | 988 | 926 | 872 | | |
| | | | | Heating Rise (°F) | 32 | 34 | 35 | 37 | 39 | 41 | 44 | 47 | 50 | | |
| Heating Rise (°C) | 18 | | | 19 | 19 | 20 | 22 | 23 | 24 | 26 | 28 | | | | |
| High | Black | CFM | 1472 | 1401 | 1326 | 1251 | 1275 | 1198 | 1139 | 1085 | 1023 | | | | |
| | | Heating Rise (°F) | 29 | 31 | 33 | 35 | 34 | 36 | 38 | 40 | 42 | | | | |
| | | Heating Rise (°C) | 16 | 17 | 18 | 19 | 19 | 20 | 21 | 22 | 24 | | | | |
| 42090 | 35 – 65°F (19 – 36°C) | Low | Blue | CFM | 952 | 882 | 806 | 746 | 671 | 605 | 530 | 551 | 486 | | |
| | | | | Heating Rise (°F) | NA | NA | NA | NA | NA | NA | NA | NA | NA | | |
| | | | | Heating Rise (°C) | NA | NA | NA | NA | NA | NA | NA | NA | NA | | |
| | | Med–Low | Pink | CFM | 1002 | 936 | 875 | 821 | 748 | 687 | 613 | 554 | 565 | | |
| | | | | Heating Rise (°F) | NA | NA | NA | NA | NA | NA | NA | NA | NA | | |
| | | | | Heating Rise (°C) | NA | NA | NA | NA | NA | NA | NA | NA | NA | | |
| | | Medium ¹ | Red | CFM | 1255 | 1210 | 1145 | 1074 | 1008 | 940 | 878 | 895 | 838 | | |
| | | | | Heating Rise (°F) | 53 | 55 | 58 | 62 | NA | NA | NA | NA | NA | | |
| | | | | Heating Rise (°C) | 30 | 31 | 32 | 35 | NA | NA | NA | NA | NA | | |
| | | Med–High ² | Orange | CFM | 1335 | 1267 | 1246 | 1176 | 1109 | 1049 | 988 | 926 | 872 | | |
| | | | | Heating Rise (°F) | 50 | 53 | 54 | 57 | 60 | 64 | NA | NA | NA | | |
| Heating Rise (°C) | 28 | | | 29 | 30 | 32 | 34 | 35 | NA | NA | NA | | | | |
| High | Black | CFM | 1472 | 1401 | 1326 | 1251 | 1275 | 1198 | 1139 | 1085 | 1023 | | | | |
| | | Heating Rise (°F) | 45 | 48 | 50 | 53 | 52 | 56 | 59 | 62 | 65 | | | | |
| | | Heating Rise (°C) | 25 | 27 | 28 | 30 | 29 | 31 | 33 | 34 | 36 | | | | |

Dry Coil Air Delivery* – Horizontal Discharge Sizes 36–60 3 Phase Models Only (Cont.)

| Unit | Heating Rise Range | Motor Speed | Wire Color | | External Static Pressure (IN. W.C.) | | | | | | | | | | |
|-------|--------------------------|-----------------------|------------|-------------------|-------------------------------------|------|------|------|------|------|------|------|------|----|----|
| | | | | | 0.1 | 0.2 | 0.3 | 0.4 | 0.5 | 0.6 | 0.7 | 0.8 | 0.9 | | |
| 48090 | 35 – 65°F (19 – 36°C) | Low ¹ | Blue | CFM | 1402 | 1351 | 1311 | 1263 | 1224 | 1172 | 1136 | 1080 | 1041 | | |
| | | | | Heating Rise (°F) | 48 | 50 | 51 | 53 | 55 | 57 | 59 | 62 | 64 | | |
| | | Med–Low | Pink | CFM | 1457 | 1404 | 1367 | 1318 | 1284 | 1233 | 1197 | 1144 | 1104 | | |
| | | | | Heating Rise (°F) | 46 | 48 | 49 | 51 | 52 | 54 | 56 | 58 | 61 | | |
| | | Medium ² | Red | CFM | 1736 | 1695 | 1642 | 1601 | 1553 | 1512 | 1465 | 1427 | 1381 | | |
| | | | | Heating Rise (°F) | 39 | 39 | 41 | 42 | 43 | 44 | 46 | 47 | 48 | | |
| | | Med–High | Orange | CFM | 2149 | 2111 | 2062 | 2026 | 1980 | 1945 | 1905 | 1864 | 1793 | | |
| | | | | Heating Rise (°F) | NA | NA | NA | NA | NA | NA | NA | NA | 35 | 36 | 37 |
| | | High | Black | CFM | 2344 | 2306 | 2259 | 2203 | 2141 | 2070 | 1991 | 1902 | 1803 | | |
| | | | | Heating Rise (°F) | NA | NA | NA | NA | NA | NA | NA | NA | 20 | 20 | 21 |
| 48115 | 30 – 60°F (17 – 33°C) | Low | Blue | CFM | 1402 | 1351 | 1311 | 1263 | 1224 | 1172 | 1136 | 1080 | 1041 | | |
| | | | | Heating Rise (°F) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| | | Med–Low | Pink | CFM | 1457 | 1404 | 1367 | 1318 | 1284 | 1233 | 1197 | 1144 | 1104 | | |
| | | | | Heating Rise (°F) | 58 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| | | Medium ² | Red | CFM | 1736 | 1695 | 1642 | 1601 | 1553 | 1512 | 1465 | 1427 | 1381 | | |
| | | | | Heating Rise (°F) | 49 | 50 | 52 | 53 | 55 | 56 | 58 | 60 | 60 | NA | NA |
| | | Med–High ¹ | Orange | CFM | 2149 | 2111 | 2062 | 2026 | 1980 | 1945 | 1905 | 1864 | 1793 | | |
| | | | | Heating Rise (°F) | 40 | 40 | 41 | 42 | 43 | 44 | 45 | 46 | 46 | 48 | |
| | | High | Black | CFM | 2344 | 2306 | 2259 | 2203 | 2141 | 2070 | 1991 | 1902 | 1803 | | |
| | | | | Heating Rise (°F) | 36 | 37 | 38 | 39 | 40 | 41 | 43 | 45 | 45 | 47 | |

Specifications subject to change without notice.

Dry Coil Air Delivery* – Horizontal Discharge Sizes 36–60 3 Phase Models Only (Cont.)

| Unit | Heating Rise Range | Motor Speed | Wire Color | | External Static Pressure (In. W.C.) | | | | | | | | | | | |
|-------|--------------------------|-------------|-------------------|---------------------|-------------------------------------|------|------|------|------|------|------|------|------|------|----|----|
| | | | | | 0.1 | 0.2 | 0.3 | 0.4 | 0.5 | 0.6 | 0.7 | 0.8 | 0.9 | | | |
| 48130 | 35 – 65°F (19 – 36°C) | Low | Blue | CFM | 1402 | 1351 | 1311 | 1263 | 1224 | 1172 | 1136 | 1080 | 1041 | | | |
| | | | | Heating Rise (°F) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | |
| | | | | Heating Rise (°C) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| | | | | CFM | 1457 | 1404 | 1367 | 1318 | 1284 | 1233 | 1197 | 1144 | 1104 | | | |
| | | | | Heating Rise (°F) | 65 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | |
| | | | | Heating Rise (°C) | 36 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | |
| | | Med–Low | Red | Medium ² | CFM | 1736 | 1695 | 1642 | 1601 | 1553 | 1512 | 1465 | 1427 | 1381 | | |
| | | | | | Heating Rise (°F) | 55 | 56 | 58 | 59 | 61 | 63 | 65 | NA | NA | NA | |
| | | | | | Heating Rise (°C) | 30 | 31 | 32 | 33 | 34 | 35 | 36 | NA | NA | NA | |
| | | | | | CFM | 2149 | 2111 | 2062 | 2026 | 1980 | 1945 | 1905 | 1864 | 1793 | | |
| | | | | | Heating Rise (°F) | 44 | 45 | 46 | 47 | 48 | 49 | 50 | 51 | 53 | | |
| | | | | | Heating Rise (°C) | 25 | 25 | 26 | 26 | 27 | 27 | 28 | 28 | 29 | | |
| 60090 | 35 – 65°F (19 – 36°C) | High | Black | CFM | 2344 | 2306 | 2259 | 2203 | 2141 | 2070 | 1991 | 1902 | 1803 | | | |
| | | | | Heating Rise (°F) | 41 | 41 | 42 | 43 | 44 | 46 | 48 | 50 | 53 | | | |
| | | | | Heating Rise (°C) | 23 | 23 | 23 | 24 | 25 | 26 | 27 | 28 | 29 | | | |
| | | | | CFM | 1445 | 1389 | 1341 | 1281 | 1236 | 1189 | 1139 | 1072 | 1027 | | | |
| | | | | Heating Rise (°F) | 46 | 48 | 50 | 52 | 54 | 56 | 59 | 62 | 65 | | | |
| | | | | Heating Rise (°C) | 26 | 27 | 28 | 29 | 30 | 31 | 33 | 35 | 36 | | | |
| | | Med–Low | Pink | Medium ² | CFM | 1678 | 1635 | 1602 | 1558 | 1513 | 1474 | 1438 | 1404 | 1349 | | |
| | | | | | Heating Rise (°F) | 40 | 41 | 42 | 43 | 44 | 45 | 47 | 48 | 50 | | |
| | | | | | Heating Rise (°C) | 22 | 23 | 23 | 24 | 25 | 25 | 26 | 26 | 28 | | |
| | | | | | CFM | 1962 | 1915 | 1880 | 1843 | 1794 | 1753 | 1711 | 1675 | 1628 | | |
| | | | | | Heating Rise (°F) | NA | 35 | 36 | 36 | 37 | 38 | 39 | 40 | 41 | | |
| | | | | | Heating Rise (°C) | NA | 19 | 20 | 20 | 21 | 21 | 22 | 22 | 23 | | |
| High | Black | High | CFM | 2131 | 2088 | 2065 | 2013 | 1982 | 1941 | 1888 | 1860 | 1785 | | | | |
| | | | Heating Rise (°F) | NA | NA | NA | NA | NA | NA | 35 | 36 | 37 | | | | |
| | | | Heating Rise (°C) | NA | NA | NA | NA | NA | NA | 20 | 20 | 21 | | | | |
| | | | CFM | 2461 | 2409 | 2339 | 2286 | 2192 | 2140 | 2062 | 1968 | 1874 | | | | |
| | | | Heating Rise (°F) | NA | NA | NA | NA | NA | NA | NA | NA | NA | | | | |
| | | | Heating Rise (°C) | NA | NA | NA | NA | NA | NA | NA | NA | NA | | | | |

Dry Coil Air Delivery* – Horizontal Discharge Sizes 36–60 3 Phase Models Only (Cont.)

| Unit | Heating Rise Range | Motor Speed | Wire Color | CFM | External Static Pressure (IN. W.C.) | | | | | | | | | | |
|-----------------------|--------------------------|-----------------------|--------------------------|-------------------|-------------------------------------|-------------------|------|------|------|------|------|------|------|------|------|
| | | | | | 0.1 | 0.2 | 0.3 | 0.4 | 0.5 | 0.6 | 0.7 | 0.8 | 0.9 | | |
| 60115 | 30 – 60°F (17 – 33°C) | Low | Blue | CFM | 1445 | 1389 | 1341 | 1281 | 1236 | 1189 | 1139 | 1072 | 1027 | | |
| | | | | Heating Rise (°F) | 59 | NA | NA | NA | NA | NA | NA | NA | NA | NA | |
| | | Med–Low | Pink | CFM | 1678 | 1635 | 1602 | 1558 | 1513 | 1474 | 1438 | 1404 | 1349 | | |
| | | | | Heating Rise (°F) | 51 | 52 | 53 | 55 | 56 | 58 | 59 | NA | NA | | |
| | | Medium ² | Red | CFM | 1962 | 1915 | 1880 | 1843 | 1794 | 1753 | 1711 | 1675 | 1628 | | |
| | | | | Heating Rise (°F) | 43 | 44 | 45 | 46 | 47 | 49 | 50 | 51 | 52 | | |
| | | Med–High ¹ | Orange | CFM | 2131 | 2088 | 2065 | 2013 | 1982 | 1941 | 1888 | 1860 | 1785 | | |
| | | | | Heating Rise (°F) | 40 | 41 | 41 | 42 | 43 | 44 | 45 | 46 | 48 | | |
| | | 60130 | 35 – 65°F (19 – 36°C) | High | Black | CFM | 2461 | 2409 | 2339 | 2286 | 2192 | 2140 | 2062 | 1968 | 1874 |
| | | | | | | Heating Rise (°F) | 35 | 35 | 36 | 37 | 39 | 40 | 41 | 43 | 45 |
| Low | Blue | | | CFM | 1445 | 1389 | 1341 | 1281 | 1236 | 1189 | 1139 | 1072 | 1027 | | |
| | | | | Heating Rise (°F) | 19 | 20 | 20 | 20 | 22 | 22 | 24 | 24 | 25 | | |
| Med–Low | Pink | | | CFM | 1678 | 1635 | 1602 | 1558 | 1513 | 1474 | 1438 | 1404 | 1349 | | |
| | | | | Heating Rise (°F) | 57 | 58 | 59 | 61 | 63 | 65 | NA | NA | NA | | |
| Medium ² | Red | | | CFM | 1962 | 1915 | 1880 | 1843 | 1794 | 1753 | 1711 | 1675 | 1628 | | |
| | | | | Heating Rise (°F) | 49 | 50 | 51 | 52 | 53 | 54 | 56 | 57 | 58 | | |
| Med–High ¹ | Orange | | | CFM | 2131 | 2088 | 2065 | 2013 | 1982 | 1941 | 1888 | 1860 | 1785 | | |
| | | | | Heating Rise (°F) | 45 | 46 | 46 | 47 | 48 | 49 | 50 | 51 | 53 | | |
| High | Black | CFM | 2461 | 2409 | 2339 | 2286 | 2192 | 2140 | 2062 | 1968 | 1874 | | | | |
| | | Heating Rise (°F) | 39 | 40 | 41 | 42 | 43 | 44 | 46 | 48 | 51 | | | | |

*Air delivery values are without air filter and are for dry coil (See Wet Coil Pressure Drop table).

¹ Factory-shipped heating speed

² Factory-shipped cooling speed

"NA" = Not allowed for heating speed

Note: Ductwork field-supplied air filter pressure drop and wet coil pressure drop to obtain external static pressure available for ducting.

Shaded areas indicate speed/static combinations that are not permitted for dehumidification speed.

Dry Coil Air Delivery – Downflow Discharge Sizes 36–60 3 Phase Models Only

| Unit | Heating Rise Range | Motor Speed | Wire Color | External Static Pressure (IN. W.C.) | | | | | | | | | | |
|-------------------|--------------------------|----------------------|------------|-------------------------------------|------|------|------|------|------|------|------|------|------|------|
| | | | | 0.1 | 0.2 | 0.3 | 0.4 | 0.5 | 0.6 | 0.7 | 0.8 | 0.9 | 1.0 | |
| 36060 | 25 – 55°F (14 – 31°C) | Low | Blue | CFM | 979 | 912 | 859 | 789 | 731 | 654 | 556 | 454 | 374 | 255 |
| | | | | WATTS | 202 | 212 | 217 | 221 | 231 | 236 | 245 | 251 | 259 | 253 |
| | | | | BHP | 0.22 | 0.23 | 0.23 | 0.24 | 0.25 | 0.25 | 0.26 | 0.27 | 0.28 | 0.27 |
| | | | | Heating Rise (°F) | 45 | 48 | 51 | NA | NA | NA | NA | NA | NA | NA |
| | | Heating Rise (°C) | 25 | 27 | 28 | NA | NA | NA | NA | NA | NA | NA | | |
| | | Med–Low ¹ | Pink | CFM | 1136 | 1080 | 1015 | 957 | 912 | 861 | 808 | 723 | 633 | 545 |
| | | | | WATTS | 294 | 309 | 310 | 322 | 325 | 333 | 341 | 349 | 354 | 367 |
| | | | | BHP | 0.32 | 0.33 | 0.33 | 0.35 | 0.35 | 0.36 | 0.37 | 0.37 | 0.38 | 0.38 |
| | | | | Heating Rise (°F) | 39 | 41 | 43 | 46 | 48 | 51 | 54 | NA | NA | NA |
| | | Heating Rise (°C) | 22 | 23 | 24 | 26 | 27 | 28 | 30 | NA | NA | NA | | |
| | | Medium ² | Red | CFM | 1208 | 1144 | 1091 | 1025 | 964 | 902 | 886 | 830 | 746 | 663 |
| | | | | WATTS | 345 | 350 | 358 | 366 | 373 | 377 | 390 | 396 | 407 | 410 |
| | | | | BHP | 0.37 | 0.38 | 0.38 | 0.39 | 0.40 | 0.40 | 0.42 | 0.42 | 0.44 | 0.44 |
| | | | | Heating Rise (°F) | 36 | 38 | 40 | 43 | 46 | 49 | 50 | 53 | NA | NA |
| | | Heating Rise (°C) | 20 | 21 | 22 | 24 | 25 | 27 | 28 | 29 | NA | NA | | |
| | | Med–High | Orange | CFM | 1495 | 1439 | 1376 | 1303 | 1221 | 1207 | 1137 | 1052 | 981 | 894 |
| WATTS | 625 | | | 634 | 635 | 633 | 624 | 613 | 598 | 583 | 573 | 551 | | |
| BHP | 0.67 | | | 0.68 | 0.68 | 0.68 | 0.67 | 0.66 | 0.64 | 0.63 | 0.61 | 0.59 | | |
| Heating Rise (°F) | 29 | | | 31 | 32 | 34 | 36 | 36 | 39 | 42 | 45 | 49 | | |
| Heating Rise (°C) | 16 | 17 | 18 | 19 | 20 | 20 | 22 | 23 | 25 | 27 | | | | |
| High | Black | CFM | 1560 | 1491 | 1416 | 1337 | 1255 | 1233 | 1160 | 1082 | 998 | 911 | | |
| | | WATTS | 708 | 699 | 683 | 674 | 660 | 634 | 624 | 606 | 581 | 566 | | |
| | | BHP | 0.76 | 0.75 | 0.73 | 0.72 | 0.71 | 0.68 | 0.67 | 0.65 | 0.62 | 0.61 | | |
| | | Heating Rise (°F) | 28 | 30 | 31 | 33 | 35 | 36 | 38 | 41 | 44 | 48 | | |
| Heating Rise (°C) | 16 | 16 | 17 | 18 | 19 | 20 | 21 | 23 | 24 | 27 | | | | |

Dry Coil Air Delivery – Downflow Discharge Sizes 36–60 3 Phase Models Only (Cont.)

| Unit | Heating Rise Range | Motor Speed | Wire Color | External Static Pressure (IN. W.C.) | | | | | | | | | | |
|-------------------|--------------------------|-----------------------|------------|-------------------------------------|------|------|------|------|------|------|------|------|------|------|
| | | | | 0.1 | 0.2 | 0.3 | 0.4 | 0.5 | 0.6 | 0.7 | 0.8 | 0.9 | 1.0 | |
| 36090 | 35 – 65°F (19 – 36°C) | Low | Blue | CFM | 979 | 912 | 859 | 789 | 731 | 654 | 556 | 454 | 374 | 255 |
| | | | | WATTS | 202 | 212 | 217 | 221 | 231 | 236 | 245 | 251 | 259 | 253 |
| | | | | BHP | 0.22 | 0.23 | 0.23 | 0.24 | 0.25 | 0.25 | 0.26 | 0.27 | 0.28 | 0.27 |
| | | | | Heating Rise (°F) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| | | Heating Rise (°C) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | |
| | | Med–Low | Pink | CFM | 1136 | 1080 | 1015 | 957 | 912 | 861 | 808 | 723 | 633 | 545 |
| | | | | WATTS | 294 | 309 | 310 | 322 | 325 | 333 | 341 | 349 | 354 | 367 |
| | | | | BHP | 0.32 | 0.33 | 0.33 | 0.35 | 0.35 | 0.36 | 0.37 | 0.37 | 0.38 | |
| | | | | Heating Rise (°F) | 58 | 61 | NA | NA | NA | NA | NA | NA | NA | NA |
| | | Heating Rise (°C) | 32 | 34 | NA | NA | NA | NA | NA | NA | NA | NA | NA | |
| | | Medium ² | Red | CFM | 1208 | 1144 | 1091 | 1025 | 964 | 902 | 886 | 830 | 746 | 663 |
| | | | | WATTS | 345 | 350 | 358 | 366 | 373 | 377 | 390 | 396 | 407 | 410 |
| | | | | BHP | 0.37 | 0.38 | 0.38 | 0.39 | 0.40 | 0.40 | 0.42 | 0.42 | 0.44 | 0.44 |
| | | | | Heating Rise (°F) | 54 | 58 | 60 | 64 | NA | NA | NA | NA | NA | NA |
| | | Heating Rise (°C) | 30 | 32 | 34 | 36 | NA | NA | NA | NA | NA | NA | NA | |
| | | Med–High ¹ | Orange | CFM | 1495 | 1439 | 1376 | 1303 | 1221 | 1207 | 1137 | 1052 | 981 | 894 |
| WATTS | 625 | | | 634 | 635 | 633 | 624 | 613 | 598 | 583 | 573 | 551 | | |
| BHP | 0.67 | | | 0.68 | 0.68 | 0.68 | 0.67 | 0.66 | 0.64 | 0.63 | 0.61 | 0.59 | | |
| Heating Rise (°F) | 44 | | | 46 | 48 | 51 | 54 | 55 | 58 | 63 | NA | NA | | |
| Heating Rise (°C) | 24 | 25 | 27 | 28 | 30 | 30 | 32 | 35 | NA | NA | | | | |
| High ¹ | Black | CFM | 1560 | 1491 | 1416 | 1337 | 1255 | 1233 | 1160 | 1082 | 998 | 911 | | |
| | | WATTS | 708 | 699 | 683 | 674 | 660 | 634 | 624 | 606 | 581 | 566 | | |
| | | BHP | 0.76 | 0.75 | 0.73 | 0.72 | 0.71 | 0.68 | 0.67 | 0.65 | 0.62 | 0.61 | | |
| | | Heating Rise (°F) | 42 | 44 | 46 | 49 | 52 | 53 | 57 | 61 | NA | NA | | |
| Heating Rise (°C) | 23 | 25 | 26 | 27 | 29 | 30 | 32 | 34 | NA | NA | | | | |

Dry Coil Air Delivery – Downflow Discharge Sizes 36–60 3 Phase Models Only (Cont.)

| Unit | Heating Rise Range | Motor Speed | Wire Color | External Static Pressure (IN. W.C.) | | | | | | | | | | | | | | | | |
|-------------------|--------------------------|-------------------|------------|-------------------------------------|------|------|------|------|------|------|------|------|------|------|------|------|----|----|----|----|
| | | | | 0.1 | 0.2 | 0.3 | 0.4 | 0.5 | 0.6 | 0.7 | 0.8 | 0.9 | 1.0 | | | | | | | |
| 42060 | 25 – 55°F (14 – 31°C) | Low | Blue | CFM | 952 | 882 | 806 | 746 | 671 | 605 | 530 | 551 | 486 | 435 | | | | | | |
| | | | | WATTS | 124 | 134 | 140 | 150 | 156 | 166 | 171 | 182 | 188 | 198 | | | | | | |
| | | | | BHP | 0.13 | 0.14 | 0.15 | 0.16 | 0.17 | 0.18 | 0.18 | 0.20 | 0.20 | 0.21 | 0.22 | 0.24 | | | | |
| | | | | Heating Rise (°F) | 45 | 49 | 54 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| | | | | Heating Rise (°C) | 25 | 27 | 30 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| | | | | CFM | 1002 | 936 | 875 | 821 | 748 | 687 | 613 | 554 | 565 | 518 | | | | | | |
| | | | | WATTS | 144 | 155 | 161 | 171 | 176 | 187 | 193 | 203 | 209 | 220 | | | | | | |
| | | | | BHP | 0.15 | 0.17 | 0.17 | 0.18 | 0.19 | 0.20 | 0.21 | 0.22 | 0.22 | 0.24 | | | | | | |
| | | Heating Rise (°F) | 43 | 46 | 49 | 53 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | | |
| | | Heating Rise (°C) | 24 | 26 | 27 | 29 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | | |
| | | CFM | 1255 | 1210 | 1145 | 1074 | 1008 | 940 | 878 | 895 | 838 | 785 | | | | | | | | |
| | | WATTS | 249 | 272 | 284 | 292 | 305 | 319 | 320 | 329 | 336 | 347 | | | | | | | | |
| | | BHP | 0.27 | 0.29 | 0.30 | 0.31 | 0.33 | 0.34 | 0.34 | 0.35 | 0.36 | 0.37 | | | | | | | | |
| | | Heating Rise (°F) | 35 | 36 | 38 | 40 | 43 | 46 | 49 | 48 | 52 | 55 | | | | | | | | |
| | | Heating Rise (°C) | 19 | 20 | 21 | 22 | 24 | 26 | 27 | 27 | 29 | 31 | | | | | | | | |
| | | CFM | 1335 | 1267 | 1246 | 1176 | 1109 | 1049 | 988 | 926 | 872 | 891 | | | | | | | | |
| WATTS | 311 | 323 | 330 | 342 | 356 | 367 | 378 | 385 | 395 | 403 | | | | | | | | | | |
| BHP | 0.33 | 0.35 | 0.35 | 0.37 | 0.38 | 0.39 | 0.41 | 0.41 | 0.42 | 0.43 | | | | | | | | | | |
| Heating Rise (°F) | 32 | 34 | 35 | 37 | 39 | 41 | 44 | 47 | 50 | 49 | | | | | | | | | | |
| Heating Rise (°C) | 18 | 19 | 19 | 20 | 22 | 23 | 24 | 26 | 28 | 27 | | | | | | | | | | |
| CFM | 1472 | 1401 | 1326 | 1251 | 1275 | 1198 | 1139 | 1085 | 1023 | 961 | | | | | | | | | | |
| WATTS | 401 | 414 | 426 | 440 | 471 | 462 | 473 | 478 | 486 | 491 | | | | | | | | | | |
| BHP | 0.43 | 0.44 | 0.46 | 0.47 | 0.51 | 0.50 | 0.51 | 0.51 | 0.52 | 0.53 | | | | | | | | | | |
| Heating Rise (°F) | 29 | 31 | 33 | 35 | 34 | 36 | 38 | 40 | 42 | 45 | | | | | | | | | | |
| Heating Rise (°C) | 16 | 17 | 18 | 19 | 19 | 20 | 21 | 22 | 24 | 25 | | | | | | | | | | |

Dry Coil Air Delivery – Downflow Discharge Sizes 36–60 3 Phase Models Only (Cont.)

| Unit | Heating Rise Range | Motor Speed | Wire Color | External Static Pressure (IN. W.C.) | | | | | | | | | | |
|-------------------|--------------------------|-----------------------|------------|-------------------------------------|------|------|------|------|------|------|------|------|------|------|
| | | | | 0.1 | 0.2 | 0.3 | 0.4 | 0.5 | 0.6 | 0.7 | 0.8 | 0.9 | 1.0 | |
| 42090 | 35 – 65°F (19 – 36°C) | Low | Blue | CFM | 952 | 882 | 806 | 746 | 671 | 605 | 530 | 551 | 486 | 435 |
| | | | | WATTS | 124 | 134 | 140 | 150 | 156 | 166 | 171 | 182 | 188 | 198 |
| | | | | BHP | 0.13 | 0.14 | 0.15 | 0.16 | 0.17 | 0.18 | 0.18 | 0.20 | 0.20 | 0.21 |
| | | | | Heating Rise (°F) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| | | Heating Rise (°C) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| | | Med–Low | Pink | CFM | 1002 | 936 | 875 | 821 | 748 | 687 | 613 | 554 | 565 | 518 |
| | | | | WATTS | 144 | 155 | 161 | 171 | 176 | 187 | 193 | 203 | 209 | 220 |
| | | | | BHP | 0.15 | 0.17 | 0.17 | 0.18 | 0.19 | 0.20 | 0.21 | 0.22 | 0.22 | 0.24 |
| | | | | Heating Rise (°F) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| | | Heating Rise (°C) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| | | Medium ¹ | Red | CFM | 1255 | 1210 | 1145 | 1074 | 1008 | 940 | 878 | 895 | 838 | 785 |
| | | | | WATTS | 249 | 272 | 284 | 292 | 305 | 319 | 320 | 329 | 336 | 347 |
| | | | | BHP | 0.27 | 0.29 | 0.30 | 0.31 | 0.33 | 0.34 | 0.34 | 0.35 | 0.36 | 0.37 |
| | | | | Heating Rise (°F) | 53 | 55 | 58 | 62 | NA | NA | NA | NA | NA | NA |
| | | Heating Rise (°C) | 30 | 31 | 32 | 35 | NA | NA | NA | NA | NA | NA | NA | |
| | | Med–High ² | Orange | CFM | 1335 | 1267 | 1246 | 1176 | 1109 | 1049 | 988 | 926 | 872 | 891 |
| WATTS | 311 | | | 323 | 330 | 342 | 356 | 367 | 378 | 385 | 395 | 403 | | |
| BHP | 0.33 | | | 0.35 | 0.35 | 0.37 | 0.38 | 0.39 | 0.41 | 0.41 | 0.42 | 0.43 | | |
| Heating Rise (°F) | 50 | | | 53 | 54 | 57 | 60 | 64 | NA | NA | NA | NA | NA | |
| Heating Rise (°C) | 28 | 29 | 30 | 32 | 34 | 35 | NA | NA | NA | NA | NA | | | |
| High | Black | CFM | 1472 | 1401 | 1326 | 1251 | 1275 | 1198 | 1139 | 1085 | 1023 | 961 | | |
| | | WATTS | 401 | 414 | 426 | 440 | 471 | 462 | 473 | 478 | 486 | 491 | | |
| | | BHP | 0.43 | 0.44 | 0.46 | 0.47 | 0.51 | 0.50 | 0.51 | 0.51 | 0.52 | 0.53 | | |
| | | Heating Rise (°F) | 45 | 48 | 50 | 53 | 52 | 56 | 59 | 62 | 65 | NA | | |
| Heating Rise (°C) | 25 | 27 | 28 | 30 | 29 | 31 | 33 | 33 | 34 | 36 | NA | | | |

Dry Coil Air Delivery – Downflow Discharge Sizes 36–60 3 Phase Models Only (Cont.)

| Unit | Heating Rise Range | Motor Speed | Wire Color | External Static Pressure (IN. W.C.) | | | | | | | | | | | | | | | | | | | | | |
|-------|--------------------------|-------------------|-------------------|-------------------------------------|-------------------|------|------|------|------|------|------|------|------|------|------|--|--|--|--|--|--|--|--|--|--|
| | | | | 0.1 | 0.2 | 0.3 | 0.4 | 0.5 | 0.6 | 0.7 | 0.8 | 0.9 | 1.0 | | | | | | | | | | | | |
| 48090 | 35 – 65°F (19 – 36°C) | Low ¹ | Blue | CFM | 1503 | 1457 | 1423 | 1374 | 1330 | 1287 | 1241 | 1199 | 1153 | 1111 | | | | | | | | | | | |
| | | | | WATTS | 225 | 233 | 246 | 254 | 269 | 282 | 292 | 307 | 314 | 329 | | | | | | | | | | | |
| | | | | BHP | 0.24 | 0.25 | 0.26 | 0.27 | 0.29 | 0.30 | 0.31 | 0.33 | 0.34 | 0.35 | | | | | | | | | | | |
| | | | | Heating Rise (°F) | 45 | 46 | 47 | 49 | 50 | 52 | 54 | 56 | 58 | 60 | | | | | | | | | | | |
| | | | | Heating Rise (°C) | 25 | 26 | 26 | 27 | 28 | 29 | 30 | 31 | 32 | 33 | | | | | | | | | | | |
| | | Med–Low | Pink | CFM | 1556 | 1508 | 1461 | 1432 | 1388 | 1346 | 1302 | 1256 | 1221 | 1168 | | | | | | | | | | | |
| | | | | WATTS | 244 | 261 | 268 | 281 | 290 | 305 | 319 | 330 | 345 | 353 | | | | | | | | | | | |
| | | | | BHP | 0.26 | 0.28 | 0.29 | 0.30 | 0.31 | 0.33 | 0.34 | 0.35 | 0.37 | 0.38 | | | | | | | | | | | |
| | | | | Heating Rise (°F) | 43 | 44 | 46 | 47 | 48 | 50 | 51 | 53 | 55 | 57 | | | | | | | | | | | |
| | | | | Heating Rise (°C) | 24 | 25 | 25 | 26 | 27 | 28 | 29 | 30 | 30 | 32 | | | | | | | | | | | |
| | Medium ² | Red | CFM | 1861 | 1822 | 1786 | 1758 | 1716 | 1688 | 1660 | 1619 | 1583 | 1539 | | | | | | | | | | | | |
| | | | WATTS | 400 | 417 | 426 | 441 | 452 | 467 | 482 | 492 | 507 | 519 | | | | | | | | | | | | |
| | | | BHP | 0.43 | 0.45 | 0.46 | 0.47 | 0.48 | 0.50 | 0.52 | 0.53 | 0.54 | 0.56 | | | | | | | | | | | | |
| | | | Heating Rise (°F) | 36 | 37 | 37 | 38 | 39 | 40 | 40 | 41 | 42 | 43 | | | | | | | | | | | | |
| | | | Heating Rise (°C) | 20 | 20 | 21 | 21 | 22 | 22 | 22 | 23 | 23 | 24 | | | | | | | | | | | | |
| | | | Med–High | Orange | CFM | 2319 | 2291 | 2255 | 2230 | 2193 | 2166 | 2118 | 2057 | 1992 | 1887 | | | | | | | | | | |
| | | | | | WATTS | 758 | 769 | 787 | 799 | 808 | 823 | 822 | 805 | 780 | 737 | | | | | | | | | | |
| | | | | | BHP | 0.81 | 0.82 | 0.84 | 0.86 | 0.87 | 0.88 | 0.88 | 0.86 | 0.84 | 0.79 | | | | | | | | | | |
| | | | | | Heating Rise (°F) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | | | | | | | | | | |
| | | | | | Heating Rise (°C) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | | | | | | | | | | |
| High | Black | CFM | 2532 | 2487 | 2444 | 2391 | 2330 | 2259 | 2179 | 2111 | 2033 | 1949 | | | | | | | | | | | | | |
| | | WATTS | 1014 | 1022 | 1015 | 994 | 965 | 935 | 898 | 858 | 823 | 786 | | | | | | | | | | | | | |
| | | BHP | 1.09 | 1.10 | 1.09 | 1.07 | 1.03 | 1.00 | 0.96 | 0.92 | 0.88 | 0.84 | | | | | | | | | | | | | |
| | | Heating Rise (°F) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | | | | | | | | | | | | | |
| | | Heating Rise (°C) | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | | | | | | | | | | | | | |

Dry Coil Air Delivery – Downflow Discharge Sizes 36–60 3 Phase Models Only (Cont.)

| Unit | Heating Rise Range | Motor Speed | Wire Color | External Static Pressure (IN. W.C.) | | | | | | | | | | |
|-------------------|-----------------------|-------------------|-------------------|-------------------------------------|------|------|------|------|------|------|------|------|------|--|
| | | | | 0.1 | 0.2 | 0.3 | 0.4 | 0.5 | 0.6 | 0.7 | 0.8 | 0.9 | 1.0 | |
| 48115 | Low | Blue | CFM | 1503 | 1457 | 1423 | 1374 | 1330 | 1287 | 1241 | 1199 | 1153 | 1111 | |
| | | | WATTS | 225 | 233 | 246 | 254 | 269 | 282 | 292 | 307 | 314 | 329 | |
| | | | BHP | 0.24 | 0.25 | 0.26 | 0.27 | 0.29 | 0.30 | 0.31 | 0.33 | 0.34 | 0.35 | |
| | | | Heating Rise (°F) | 57 | 58 | 60 | NA | NA | NA | NA | NA | NA | NA | |
| | Heating Rise (°C) | 31 | 32 | 33 | NA | NA | NA | NA | NA | NA | NA | | | |
| | Med–Low | Pink | CFM | 1556 | 1508 | 1461 | 1432 | 1388 | 1346 | 1302 | 1256 | 1221 | 1168 | |
| | | | WATTS | 244 | 261 | 268 | 281 | 290 | 305 | 319 | 330 | 345 | 353 | |
| | | | BHP | 0.26 | 0.28 | 0.29 | 0.30 | 0.31 | 0.33 | 0.34 | 0.35 | 0.37 | 0.38 | |
| | | | Heating Rise (°F) | 55 | 56 | 58 | 59 | NA | NA | NA | NA | NA | NA | |
| | Heating Rise (°C) | 30 | 31 | 32 | 33 | NA | NA | NA | NA | NA | NA | | | |
| | Medium ² | Red | CFM | 1861 | 1822 | 1786 | 1758 | 1716 | 1688 | 1660 | 1619 | 1583 | 1539 | |
| | | | WATTS | 400 | 417 | 426 | 441 | 452 | 467 | 482 | 492 | 507 | 519 | |
| | | | BHP | 0.43 | 0.45 | 0.46 | 0.47 | 0.48 | 0.50 | 0.52 | 0.53 | 0.54 | 0.56 | |
| | | | Heating Rise (°F) | 46 | 47 | 48 | 48 | 50 | 50 | 51 | 53 | 54 | 55 | |
| | Heating Rise (°C) | 25 | 26 | 26 | 27 | 28 | 28 | 29 | 29 | 29 | 30 | 31 | | |
| | Med–High ¹ | Orange | CFM | 2319 | 2291 | 2255 | 2230 | 2193 | 2166 | 2118 | 2057 | 1992 | 1887 | |
| WATTS | | | 758 | 769 | 787 | 799 | 808 | 823 | 822 | 805 | 780 | 737 | | |
| BHP | | | 0.81 | 0.82 | 0.84 | 0.86 | 0.87 | 0.88 | 0.88 | 0.86 | 0.84 | 0.79 | | |
| Heating Rise (°F) | | | 37 | 37 | 38 | 38 | 39 | 39 | 40 | 41 | 43 | 45 | | |
| Heating Rise (°C) | 20 | 21 | 21 | 21 | 22 | 22 | 22 | 22 | 23 | 24 | 25 | | | |
| High | Black | CFM | 2532 | 2487 | 2444 | 2391 | 2330 | 2259 | 2179 | 2111 | 2033 | 1949 | | |
| | | WATTS | 1014 | 1022 | 1015 | 994 | 965 | 935 | 898 | 858 | 823 | 786 | | |
| | | BHP | 1.09 | 1.10 | 1.09 | 1.07 | 1.03 | 1.00 | 0.96 | 0.92 | 0.88 | 0.84 | | |
| | | Heating Rise (°F) | 34 | 34 | 35 | 36 | 37 | 38 | 39 | 40 | 42 | 44 | | |
| Heating Rise (°C) | 19 | 19 | 19 | 20 | 20 | 21 | 22 | 22 | 22 | 23 | 24 | | | |

Dry Coil Air Delivery – Downflow Discharge Sizes 36–60 3 Phase Models Only (Cont.)

| Unit | Heating Rise Range | Motor Speed | Wire Color | External Static Pressure (IN. W.C.) | | | | | | | | | | | |
|-------|--------------------------|-------------------|-------------------|-------------------------------------|------|------|------|------|------|------|------|------|------|------|----|
| | | | | 0.1 | 0.2 | 0.3 | 0.4 | 0.5 | 0.6 | 0.7 | 0.8 | 0.9 | 1.0 | | |
| 48130 | 35 – 65°F (19 – 36°C) | Low | Blue | CFM | 1503 | 1457 | 1423 | 1374 | 1330 | 1287 | 1241 | 1199 | 1153 | 1111 | |
| | | | | WATTS | 225 | 233 | 246 | 254 | 269 | 282 | 292 | 307 | 314 | 329 | |
| | | | | BHP | 0.24 | 0.25 | 0.26 | 0.27 | 0.29 | 0.30 | 0.31 | 0.33 | 0.34 | 0.35 | |
| | | | | Heating Rise (°F) | 63 | 65 | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| | | | | Heating Rise (°C) | 35 | 36 | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| | | Med–Low | Pink | CFM | 1556 | 1508 | 1461 | 1432 | 1388 | 1346 | 1302 | 1256 | 1221 | 1168 | |
| | | | | WATTS | 244 | 261 | 268 | 281 | 290 | 305 | 319 | 330 | 345 | 353 | |
| | | | | BHP | 0.26 | 0.28 | 0.29 | 0.30 | 0.31 | 0.33 | 0.34 | 0.35 | 0.37 | 0.38 | |
| | | | | Heating Rise (°F) | 61 | 63 | 65 | NA | NA | NA | NA | NA | NA | NA | |
| | | | | Heating Rise (°C) | 34 | 35 | 36 | NA | NA | NA | NA | NA | NA | NA | |
| | Medium ² | Red | CFM | 1861 | 1822 | 1786 | 1758 | 1716 | 1688 | 1660 | 1619 | 1583 | 1539 | | |
| | | | WATTS | 400 | 417 | 426 | 441 | 452 | 467 | 482 | 492 | 507 | 519 | | |
| | | | BHP | 0.43 | 0.45 | 0.46 | 0.47 | 0.48 | 0.50 | 0.52 | 0.53 | 0.54 | 0.56 | | |
| | | | Heating Rise (°F) | 51 | 52 | 53 | 54 | 55 | 56 | 57 | 59 | 60 | 62 | | |
| | | | Heating Rise (°C) | 28 | 29 | 30 | 30 | 31 | 31 | 32 | 33 | 33 | 34 | | |
| | Med–High ¹ | Orange | CFM | 2319 | 2291 | 2255 | 2230 | 2193 | 2166 | 2118 | 2057 | 1992 | 1887 | | |
| | | | WATTS | 758 | 769 | 787 | 799 | 808 | 823 | 822 | 805 | 780 | 737 | | |
| | | | BHP | 0.81 | 0.82 | 0.84 | 0.86 | 0.87 | 0.88 | 0.88 | 0.86 | 0.84 | 0.79 | | |
| | | | Heating Rise (°F) | 41 | 42 | 42 | 43 | 43 | 44 | 45 | 46 | 48 | 50 | | |
| | | | Heating Rise (°C) | 23 | 23 | 23 | 24 | 24 | 24 | 25 | 26 | 27 | 28 | | |
| High | Black | CFM | 2532 | 2487 | 2444 | 2391 | 2330 | 2259 | 2179 | 2111 | 2033 | 1949 | | | |
| | | WATTS | 1014 | 1022 | 1015 | 994 | 965 | 935 | 898 | 858 | 823 | 786 | | | |
| | | BHP | 1.09 | 1.10 | 1.09 | 1.07 | 1.03 | 1.00 | 0.96 | 0.92 | 0.88 | 0.84 | | | |
| | | Heating Rise (°F) | 38 | 38 | 39 | 40 | 41 | 42 | 44 | 45 | 47 | 49 | | | |
| | | Heating Rise (°C) | 21 | 21 | 22 | 22 | 23 | 23 | 24 | 25 | 26 | 27 | | | |

Dry Coil Air Delivery – Downflow Discharge Sizes 36–60 3 Phase Models Only (Cont.)

| Unit | Heating Rise Range | Motor Speed | Wire Color | External Static Pressure (IN. W.C.) | | | | | | | | | | |
|-------------------|--------------------------|---------------------|------------|-------------------------------------|------|------|------|------|------|------|------|------|------|------|
| | | | | 0.1 | 0.2 | 0.3 | 0.4 | 0.5 | 0.6 | 0.7 | 0.8 | 0.9 | 1.0 | |
| 60090 | 35 – 65°F (19 – 36°C) | Low ¹ | Blue | CFM | 1479 | 1436 | 1387 | 1346 | 1298 | 1253 | 1206 | 1160 | 1114 | 1061 |
| | | | | WATTS | 224 | 239 | 247 | 262 | 270 | 284 | 300 | 307 | 319 | 330 |
| | | | | BHP | 0.24 | 0.26 | 0.26 | 0.28 | 0.29 | 0.30 | 0.32 | 0.33 | 0.34 | 0.35 |
| | | | | Heating Rise (°F) | 46 | 47 | 49 | 51 | 52 | 54 | 56 | 59 | 61 | 64 |
| | | Heating Rise (°C) | 26 | 26 | 27 | 28 | 29 | 30 | 31 | 33 | 34 | 36 | | |
| | | Med–Low | Pink | CFM | 1841 | 1796 | 1761 | 1724 | 1690 | 1651 | 1616 | 1578 | 1527 | 1478 |
| | | | | WATTS | 425 | 434 | 453 | 460 | 476 | 485 | 501 | 508 | 525 | 542 |
| | | | | BHP | 0.46 | 0.47 | 0.49 | 0.49 | 0.51 | 0.52 | 0.54 | 0.54 | 0.56 | 0.58 |
| | | | | Heating Rise (°F) | 36 | 37 | 38 | 39 | 40 | 41 | 41 | 42 | 44 | 45 |
| | | Heating Rise (°C) | 20 | 21 | 21 | 22 | 22 | 23 | 23 | 24 | 24 | 25 | | |
| | | Medium ² | Red | CFM | 1944 | 1913 | 1872 | 1838 | 1801 | 1771 | 1731 | 1698 | 1655 | 1613 |
| | | | | WATTS | 486 | 501 | 511 | 529 | 537 | 554 | 565 | 578 | 595 | 603 |
| | | | | BHP | 0.52 | 0.54 | 0.55 | 0.57 | 0.58 | 0.59 | 0.61 | 0.62 | 0.64 | 0.65 |
| | | | | Heating Rise (°F) | 34 | 35 | 36 | 36 | 37 | 38 | 39 | 39 | 40 | 41 |
| | | Heating Rise (°C) | 19 | 19 | 20 | 20 | 21 | 21 | 21 | 22 | 22 | 23 | | |
| | | Med–High | Orange | CFM | 2178 | 2148 | 2105 | 2073 | 2036 | 2002 | 1967 | 1919 | 1845 | 1751 |
| WATTS | 674 | | | 691 | 703 | 717 | 733 | 743 | 758 | 754 | 734 | 701 | | |
| BHP | 0.72 | | | 0.74 | 0.75 | 0.77 | 0.79 | 0.80 | 0.81 | 0.81 | 0.79 | 0.75 | | |
| Heating Rise (°F) | NA | | | NA | NA | NA | NA | NA | NA | NA | 35 | 36 | | |
| Heating Rise (°C) | NA | NA | NA | NA | NA | NA | NA | NA | 19 | 20 | | | | |
| High | Black | CFM | 2480 | 2432 | 2375 | 2322 | 2236 | 2161 | 2085 | 2006 | 1917 | 1808 | | |
| | | WATTS | 1029 | 1012 | 995 | 975 | 941 | 908 | 869 | 836 | 796 | 751 | | |
| | | BHP | 1.10 | 1.09 | 1.07 | 1.05 | 1.01 | 0.97 | 0.93 | 0.90 | 0.85 | 0.81 | | |
| | | Heating Rise (°F) | NA | NA | NA | NA | NA | NA | NA | NA | NA | 35 | | |
| Heating Rise (°C) | NA | NA | NA | NA | NA | NA | NA | NA | NA | 19 | | | | |

Dry Coil Air Delivery – Downflow Discharge Sizes 36–60 3 Phase Models Only (Cont.)

| Unit | Heating Rise Range | Motor Speed | Wire Color | External Static Pressure (IN. W.C.) | | | | | | | | | | |
|-------------------|--------------------------|-----------------------|------------|-------------------------------------|------|------|------|------|------|------|------|------|------|------|
| | | | | 0.1 | 0.2 | 0.3 | 0.4 | 0.5 | 0.6 | 0.7 | 0.8 | 0.9 | 1.0 | |
| 60115 | 30 – 60°F (17 – 33°C) | Low | Blue | CFM | 1479 | 1436 | 1387 | 1346 | 1298 | 1253 | 1206 | 1160 | 1114 | 1061 |
| | | | | WATTS | 224 | 239 | 247 | 262 | 270 | 284 | 300 | 307 | 319 | 330 |
| | | | | BHP | 0.24 | 0.26 | 0.26 | 0.28 | 0.29 | 0.30 | 0.32 | 0.33 | 0.34 | 0.35 |
| | | | | Heating Rise (°F) | 58 | 59 | NA | NA | NA | NA | NA | NA | NA | NA |
| | | Heating Rise (°C) | 32 | 33 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| | | Med–Low | Pink | CFM | 1841 | 1796 | 1761 | 1724 | 1690 | 1651 | 1616 | 1578 | 1527 | 1478 |
| | | | | WATTS | 425 | 434 | 453 | 460 | 476 | 485 | 501 | 508 | 525 | 542 |
| | | | | BHP | 0.46 | 0.47 | 0.49 | 0.49 | 0.51 | 0.52 | 0.54 | 0.54 | 0.56 | 0.58 |
| | | | | Heating Rise (°F) | 46 | 47 | 48 | 49 | 50 | 52 | 53 | 54 | 56 | 58 |
| | | Heating Rise (°C) | 26 | 26 | 27 | 27 | 28 | 29 | 29 | 30 | 31 | 32 | | |
| | | Medium ² | Red | CFM | 1944 | 1913 | 1872 | 1838 | 1801 | 1771 | 1731 | 1698 | 1655 | 1613 |
| | | | | WATTS | 486 | 501 | 511 | 529 | 537 | 554 | 565 | 578 | 595 | 603 |
| | | | | BHP | 0.52 | 0.54 | 0.55 | 0.57 | 0.58 | 0.59 | 0.61 | 0.62 | 0.64 | 0.65 |
| | | | | Heating Rise (°F) | 44 | 45 | 46 | 46 | 47 | 48 | 49 | 50 | 51 | 53 |
| | | Heating Rise (°C) | 24 | 25 | 25 | 26 | 26 | 27 | 27 | 28 | 29 | 29 | | |
| | | Med–High ¹ | Orange | CFM | 2178 | 2148 | 2105 | 2073 | 2036 | 2002 | 1967 | 1919 | 1845 | 1751 |
| | | | | WATTS | 674 | 691 | 703 | 717 | 733 | 743 | 758 | 754 | 734 | 701 |
| | | | | BHP | 0.72 | 0.74 | 0.75 | 0.77 | 0.79 | 0.80 | 0.81 | 0.81 | 0.79 | 0.75 |
| | | | | Heating Rise (°F) | 39 | 40 | 40 | 41 | 42 | 43 | 43 | 44 | 46 | 49 |
| | | Heating Rise (°C) | 22 | 22 | 22 | 23 | 23 | 24 | 24 | 24 | 25 | 27 | | |
| High | Black | CFM | 2480 | 2432 | 2375 | 2322 | 2236 | 2161 | 2085 | 2006 | 1917 | 1808 | | |
| | | WATTS | 1029 | 1012 | 995 | 975 | 941 | 908 | 869 | 836 | 796 | 751 | | |
| | | BHP | 1.10 | 1.09 | 1.07 | 1.05 | 1.01 | 0.97 | 0.93 | 0.90 | 0.85 | 0.81 | | |
| | | Heating Rise (°F) | NA | 35 | 36 | 37 | 38 | 39 | 41 | 42 | 44 | 47 | | |
| Heating Rise (°C) | NA | 19 | 20 | 20 | 21 | 22 | 23 | 23 | 24 | 25 | 26 | | | |

Dry Coil Air Delivery – Downflow Discharge Sizes 36–60 3 Phase Models Only (Cont.)

| Unit | Heating Rise Range | Motor Speed | Wire Color | External Static Pressure (IN. W.C.) | | | | | | | | | | | |
|-----------------------|--------------------------|-------------------|-------------------|-------------------------------------|------|------|------|------|------|------|------|------|------|------|----|
| | | | | 0.1 | 0.2 | 0.3 | 0.4 | 0.5 | 0.6 | 0.7 | 0.8 | 0.9 | 1.0 | | |
| 60130 | 35 – 65°F (19 – 36°C) | Low | Blue | CFM | 1479 | 1436 | 1387 | 1346 | 1298 | 1253 | 1206 | 1160 | 1114 | 1061 | |
| | | | | WATTS | 224 | 239 | 247 | 262 | 270 | 284 | 300 | 307 | 319 | 330 | |
| | | | | BHP | 0.24 | 0.26 | 0.26 | 0.28 | 0.29 | 0.30 | 0.32 | 0.33 | 0.34 | 0.35 | |
| | | | | Heating Rise (°F) | 64 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| | | | | Heating Rise (°C) | 36 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| | | | | CFM | 1841 | 1796 | 1761 | 1724 | 1690 | 1651 | 1616 | 1578 | 1527 | 1478 | |
| | Med–Low | Pink | WATTS | 425 | 434 | 453 | 460 | 476 | 485 | 501 | 508 | 525 | 542 | | |
| | | | BHP | 0.46 | 0.47 | 0.49 | 0.49 | 0.51 | 0.52 | 0.54 | 0.54 | 0.56 | 0.58 | | |
| | | | Heating Rise (°F) | 52 | 53 | 54 | 55 | 56 | 58 | 59 | 60 | 62 | 64 | | |
| | | | Heating Rise (°C) | 29 | 29 | 30 | 31 | 31 | 32 | 33 | 34 | 35 | 36 | | |
| | | | CFM | 1944 | 1913 | 1872 | 1838 | 1801 | 1771 | 1731 | 1698 | 1655 | 1613 | | |
| | | | WATTS | 486 | 501 | 511 | 529 | 537 | 554 | 565 | 578 | 595 | 603 | | |
| | Medium ² | Red | BHP | 0.52 | 0.54 | 0.55 | 0.57 | 0.58 | 0.59 | 0.61 | 0.62 | 0.64 | 0.65 | | |
| | | | Heating Rise (°F) | 49 | 50 | 51 | 52 | 53 | 54 | 55 | 56 | 58 | 59 | | |
| | | | Heating Rise (°C) | 27 | 28 | 28 | 29 | 29 | 30 | 31 | 31 | 32 | 33 | | |
| | | | CFM | 2178 | 2148 | 2105 | 2073 | 2036 | 2002 | 1967 | 1919 | 1845 | 1751 | | |
| WATTS | | | 674 | 691 | 703 | 717 | 733 | 743 | 758 | 754 | 734 | 701 | | | |
| BHP | | | 0.72 | 0.74 | 0.75 | 0.77 | 0.79 | 0.80 | 0.81 | 0.81 | 0.79 | 0.75 | | | |
| Med–High ¹ | Orange | Heating Rise (°F) | 44 | 44 | 45 | 46 | 47 | 48 | 48 | 50 | 52 | 54 | | | |
| | | Heating Rise (°C) | 24 | 25 | 25 | 26 | 26 | 26 | 27 | 28 | 29 | 30 | | | |
| | | CFM | 2480 | 2432 | 2375 | 2322 | 2236 | 2161 | 2085 | 2006 | 1917 | 1808 | | | |
| | | WATTS | 1029 | 1012 | 995 | 975 | 941 | 908 | 869 | 836 | 796 | 751 | | | |
| | | BHP | 1.10 | 1.09 | 1.07 | 1.05 | 1.01 | 0.97 | 0.93 | 0.90 | 0.85 | 0.81 | | | |
| | | Heating Rise (°F) | 38 | 39 | 40 | 41 | 43 | 44 | 46 | 47 | 50 | 53 | | | |
| High | Black | Heating Rise (°C) | 21 | 22 | 22 | 23 | 24 | 24 | 25 | 26 | 28 | 29 | | | |
| | | Heating Rise (°C) | 21 | 22 | 22 | 23 | 24 | 24 | 25 | 26 | 28 | 29 | | | |

*Air delivery values are without air filter and are for dry coil (See Wet Coil Pressure Drop table).

¹ Factory-shipped heating speed

² Factory-shipped cooling speed

"NA" = Not allowed for heating speed

NOTE: Duct field-supplied air filter pressure drop and wet coil pressure drop to obtain external static pressure available for ducting.

Shaded areas indicate speed/static combinations that are not permitted for dehumidification speed.

Wet Coil Pressure Drop (IN. W.C.)

| UNIT SIZE | STANDARD CFM (SCFM) | | | | | | | | | | | | | | | | | |
|-----------|---------------------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|--|
| | 600 | 700 | 800 | 900 | 1000 | 1100 | 1200 | 1300 | 1400 | 1500 | 1600 | 1700 | 1800 | 1900 | 2000 | 2100 | 2200 | |
| 24 | 0.03 | 0.04 | 0.04 | 0.05 | 0.06 | 0.06 | 0.06 | 0.06 | 0.06 | 0.07 | 0.08 | 0.11 | | | | | | |
| 30 | | | | 0.05 | 0.06 | 0.07 | 0.08 | 0.11 | | | | | | | | | | |
| 36 | | | | 0.06 | 0.06 | 0.09 | 0.10 | 0.11 | 0.14 | | | | | | | | | |
| 42 | | | | | 0.05 | 0.05 | 0.06 | 0.07 | 0.08 | 0.08 | 0.09 | 0.09 | 0.11 | | | | | |
| 48 | | | | | | | 0.04 | 0.06 | 0.09 | 0.10 | 0.10 | 0.11 | 0.12 | 0.13 | 0.14 | | | |
| 60 | | | | | | | | | 0.06 | 0.07 | 0.07 | 0.08 | 0.08 | 0.09 | 0.10 | 0.12 | 0.13 | |


Economizer with 1-in. Filter Pressure Drop (IN. W.C.)

| FILTER SIZE IN. (MM) | COOLING TONS | STANDARD CFM (SCFM) | | | | | | | | | | | | | | | | | |
|---|--------------|---------------------|-----|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|--|
| | | 600 | 700 | 800 | 900 | 1000 | 1100 | 1200 | 1300 | 1400 | 1500 | 1600 | 1700 | 1800 | 1900 | 2000 | 2100 | 2200 | |
| 600-1400 CFM 12x20x1 + 12x20x1 (305x508x25+305x508x25) | 2.0, | - | - | 0.09 | 0.14 | 0.16 | 0.18 | 0.25 | 0.28 | 0.30 | - | - | - | - | - | - | - | - | |
| | 2.5, | | | | | | | | | | | | | | | | | | |
| | 3.0 | | | | | | | | | | | | | | | | | | |
| 1200-1800 CFM 16x24x1 + 14x24x1 (406x610x25+356x610x25) | 3.5, | - | - | - | - | - | - | 0.10 | 0.11 | 0.12 | 0.13 | 0.14 | 0.16 | 0.16 | - | - | - | - | |
| | 4.0 | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | | | | | | |
| 1500-2200 CFM 16x24x1 + 18x24x1 (406x610x25+457x610x25) | 5.0 | - | - | - | - | - | - | - | - | - | 0.15 | 0.17 | 0.18 | 0.20 | 0.21 | 0.22 | 0.23 | 0.23 | |
| | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | | | | | | |


Filter Pressure Drop Table (IN. W.C.)

| FILTER SIZE IN. (MM) | COOLING TONS | STANDARD CFM (SCFM) | | | | | | | | | | | | | | | | | |
|---|--------------|---------------------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|--|
| | | 600 | 700 | 800 | 900 | 1000 | 1100 | 1200 | 1300 | 1400 | 1500 | 1600 | 1700 | 1800 | 1900 | 2000 | 2100 | 2200 | |
| 600-1400 CFM 12x20x1 + 12x20x1 (305x508x25+305x508x25) | 2.0, | 0.03 | 0.05 | 0.06 | 0.08 | 0.10 | 0.11 | 0.13 | 0.14 | 0.16 | - | - | - | - | - | - | - | - | |
| | 2.5, | | | | | | | | | | | | | | | | | | |
| | 3.0 | | | | | | | | | | | | | | | | | | |
| 1200-1800 CFM 16x24x1 + 14x24x1 (406x610x25+356x610x25) | 3.5, | - | - | - | - | - | - | 0.07 | 0.08 | 0.09 | 0.10 | 0.11 | 0.12 | - | - | - | - | - | |
| | 4.0 | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | | | | | | |
| 1500-2200 CFM 16x24x1 + 18x24x1 (406x610x25+457x610x25) | 5.0 | - | - | - | - | - | - | - | - | - | 0.04 | 0.06 | 0.08 | 0.10 | 0.11 | 0.13 | 0.14 | 0.15 | |
| | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | | | | | | |

TYPICAL PIPING AND WIRING

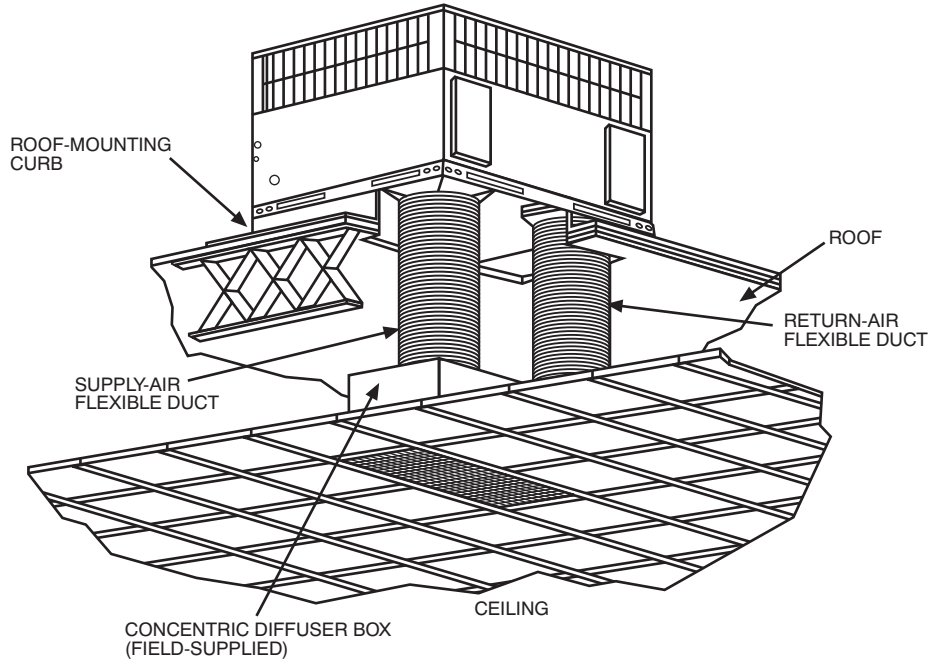

A09230

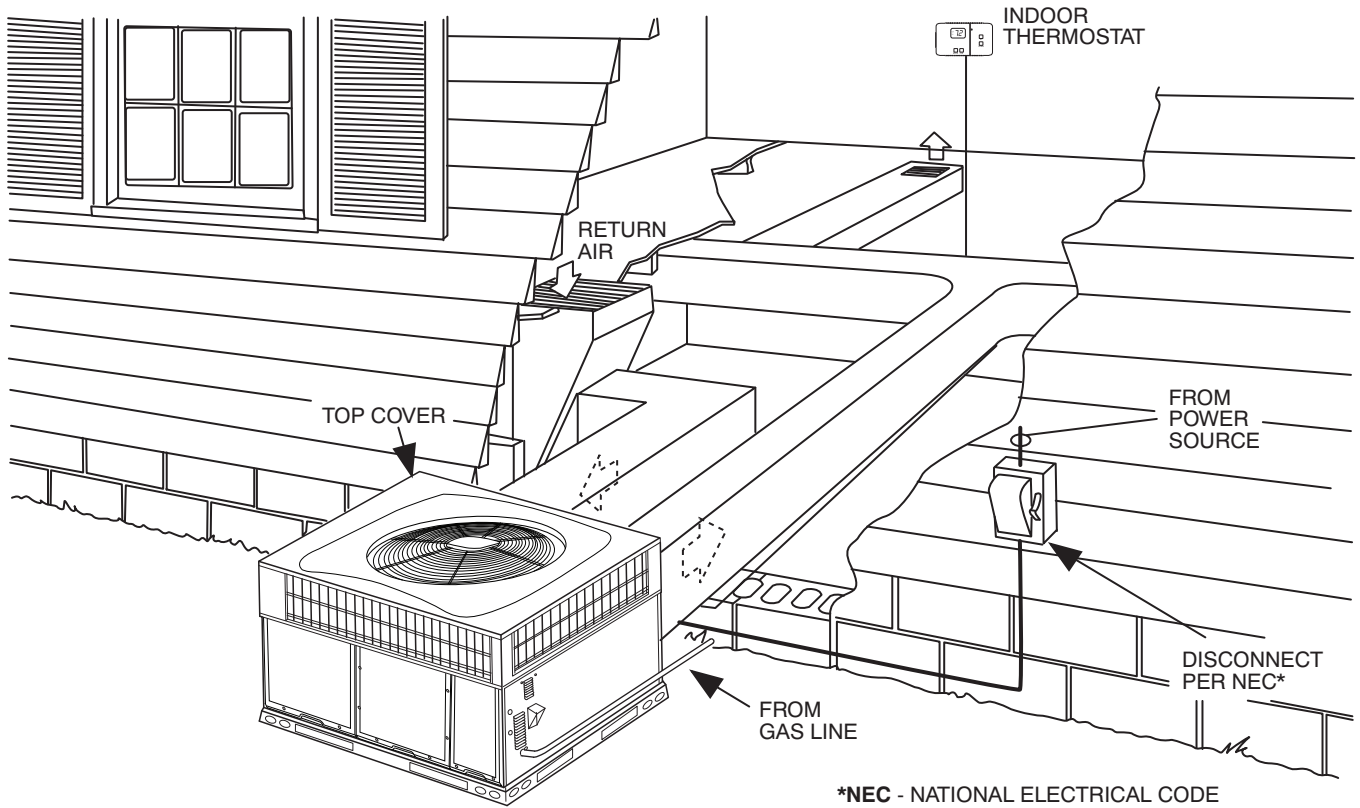

A09231

APPLICATION DATA

Condensate trap — A 2-in. (50.8 mm) condensate trap must be field supplied.

Ductwork — Secure downflow discharge ductwork to roof curb. For horizontal discharge applications, attach ductwork to unit with flanges.

To convert a unit to downflow discharge — Units are equipped with factory-installed inserts in the down-flow openings. Removal of the inserts is similar to removing an electrical knock-out. Use the duct cover to seal the horizontal discharge openings in the unit. Units installed in horizontal discharge orientation do not require duct covers.

Airflow — Units are draw-thru in the cooling mode and blow-thru in the heating mode.

Maximum cooling airflow — To minimize the possibility of condensate blow-off from the evaporator, airflow through the units should not exceed 450 cfm per ton.

Minimum cooling airflow — Minimum cooling airflow is 350 cfm per ton.

Minimum ambient cooling operation temperature — All standard units have a minimum ambient operating temperature of 40°F (4°C). With accessory low ambient temperature kit, units can operate at temperatures down to 0°F (-17°C).

Minimum temperature — Air entering the heat exchanger in heating mode must be a minimum of 50°F (10°C) continuous and/or 45°F (7°C) intermittent.

ELECTRICAL DATA

| MODEL | NOMINAL V-PH-HZ | VOLTAGE RANGE | | COMPRESSOR | | OFM | IFM | IDM | POWER SUPPLY | |
|-------|--------------------|------------------|-----|------------|-------|------|-----|------|--------------|------|
| | | MIN | MAX | RLA | LRA | FLA | FLA | FLA | MCA | MOCP |
| 24040 | 208/230-1-60 | 197 | 253 | 8.7 | 46 | 0.6 | 3.9 | 0.65 | 15.4 | 20 |
| 24060 | 208/230-1-60 | 197 | 253 | 8.7 | 46 | 0.6 | 3.9 | 0.65 | 15.4 | 20 |
| 30040 | 208/230-1-60 | 197 | 253 | 13.2 | 57 | 0.7 | 3.9 | 0.65 | 21.1 | 30 |
| 30060 | 208/230-1-60 | 197 | 253 | 13.2 | 57 | 0.7 | 3.9 | 0.65 | 21.1 | 30 |
| 36060 | 208/230-1-60 | 197 | 253 | 16.7 | 79 | 1.05 | 5.8 | 0.65 | 27.8 | 40 |
| 36060 | 208/230-3-60 | 197 | 253 | 10.4 | 73 | 1.05 | 6 | 1.65 | 20.1 | 30 |
| 36060 | 460-3-60 | 414 | 506 | 5.8 | 38 | 0.53 | 3.2 | 0.65 | 11.0 | 15 |
| 36090 | 208/230-1-60 | 197 | 253 | 16.7 | 79 | 1.05 | 5.8 | .75 | 27.8 | 40 |
| 36090 | 208/230-3-60 | 197 | 253 | 10.4 | 73 | 1.05 | 6 | 0.52 | 20.1 | 30 |
| 36090 | 460-3-60 | 414 | 506 | 5.8 | 38 | 0.53 | 3.2 | 0.3 | 11.0 | 15 |
| 42060 | 208/230-1-60 | 197 | 253 | 16.7 | 109 | 1.05 | 3.8 | 0.65 | 25.8 | 40 |
| 42060 | 208/230-3-60 | 197 | 253 | 11.2 | 88 | 1.05 | 4.1 | 1.65 | 19.2 | 30 |
| 42060 | 460-3-60 | 414 | 506 | 5.6 | 44 | 0.53 | 3.2 | 0.65 | 10.7 | 15 |
| 42090 | 208/230-1-60 | 197 | 253 | 16.7 | 109 | 1.05 | 3.8 | 0.65 | 25.8 | 40 |
| 42090 | 208/230-3-60 | 197 | 253 | 11.2 | 88 | 1.05 | 4.1 | 0.65 | 19.2 | 30 |
| 42090 | 460-3-60 | 414 | 506 | 5.6 | 44 | 0.53 | 3.2 | 0.33 | 10.7 | 15 |
| 48090 | 208/230-1-60 | 197 | 253 | 19.6 | 130 | 1.05 | 6.9 | 0.65 | 32.5 | 50 |
| 48090 | 208/230-3-60 | 197 | 253 | 13.7 | 83.1 | 1.05 | 7.6 | 0.65 | 25.8 | 35 |
| 48090 | 460-3-60 | 414 | 506 | 6.2 | 41 | 0.53 | 4.0 | 0.33 | 12.3 | 15 |
| 48115 | 208/230-1-60 | 197 | 253 | 19.6 | 130 | 1.05 | 6.9 | 0.65 | 32.5 | 50 |
| 48115 | 208/230-3-60 | 197 | 253 | 13.7 | 83.1 | 1.05 | 7.6 | 1.65 | 25.8 | 35 |
| 48115 | 460-3-60 | 414 | 506 | 6.2 | 41 | 0.53 | 4.0 | 0.65 | 12.3 | 15 |
| 48130 | 208/230-1-60 | 197 | 253 | 19.6 | 130 | 1.05 | 6.9 | .75 | 32.5 | 50 |
| 48130 | 208/230-3-60 | 197 | 253 | 13.7 | 83.1 | 1.05 | 7.6 | 0.52 | 25.8 | 35 |
| 48130 | 460-3-60 | 414 | 506 | 6.2 | 41 | 0.53 | 4.0 | 0.3 | 12.3 | 15 |
| 60090 | 208/230-1-60 | 197 | 253 | 23.7 | 152.5 | 1.05 | 6.9 | 0.65 | 37.6 | 60 |
| 60090 | 208/230-3-60 | 197 | 253 | 15.9 | 110 | 1.05 | 7.6 | 0.65 | 28.6 | 40 |
| 60090 | 460-3-60 | 414 | 506 | 7.1 | 52 | 0.53 | 4.0 | 0.33 | 13.4 | 20 |
| 60115 | 208/230-1-60 | 197 | 253 | 23.7 | 152.5 | 1.05 | 6.9 | 0.65 | 37.6 | 60 |
| 60115 | 208/230-3-60 | 197 | 253 | 15.9 | 110 | 1.05 | 7.6 | 1.65 | 28.6 | 40 |
| 60115 | 460-3-60 | 414 | 506 | 7.1 | 52 | 0.53 | 4.0 | 0.65 | 13.4 | 20 |
| 60130 | 208/230-1-60 | 197 | 253 | 23.7 | 152.5 | 1.05 | 6.9 | .75 | 37.6 | 60 |
| 60130 | 208/230-3-60 | 197 | 253 | 15.9 | 110 | 1.05 | 7.6 | 0.52 | 28.6 | 40 |
| 60130 | 460-3-60 | 414 | 506 | 7.1 | 52 | 0.53 | 4.0 | 0.3 | 13.4 | 20 |

LEGEND

- FLA - Full Load Amps
- IDM - Inducer Motor
- IFM - Indoor Fan Motor
- LRA - Locked Rotor Amps
- MCA - Minimum Circuit Amps
- MOCP - Maximum Over Current Protection
- OFM - Outdoor Fan Motor
- RLA - Rated Load Amps


NOTES:

1. In compliance with NEC (National Electrical Code) requirements for multimotor and combination load equipment (refer to NEC Articles 430 and 440), the overcurrent protective device for the unit shall be Power Supply fuse or circuit breaker.
2. Minimum wire size is based on 60 C copper wire. If other than 60 C wire is used, or if length exceeds wire length in table, determine size from NEC.
3. Unbalanced 3-Phase Supply Voltage
Never operate a motor where a phase imbalance in supply voltage is greater than 2%. Use the following formula to determine the percentage of voltage imbalance

% Voltage imbalance

$$= 100 \times \frac{\text{max voltage deviation from average voltage}}{\text{average voltage}}$$

EXAMPLE: Supply voltage is 230-3-60.



AB = 228 v
BC = 231 v
AC = 227 v

$$\begin{aligned} \text{Average Voltage} &= \frac{228 + 231 + 227}{3} \\ &= \frac{686}{3} \\ &= 229 \end{aligned}$$

Determine maximum deviation from average voltage.

(AB) 229 - 228 = 1 v
(BC) 231 - 229 = 2 v
(AC) 229 - 227 = 2 v

Maximum deviation is 2 v.

Determine percent of voltage imbalance


$$\begin{aligned} \% \text{ Voltage Imbalance} &= 100 \times \frac{2}{229} \\ &= 0.8\% \end{aligned}$$

This amount of phase imbalance is satisfactory as it is below the maximum allowable 2%.

IMPORTANT: If the supply voltage phase imbalance is more than 2%, contact your local electric utility company immediately.

A06564

CONNECTION WIRING DIAGRAM
DANGER: ELECTRICAL SHOCK HAZARD DISCONNECT POWER BEFORE SERVICING
SCHEMATIC 208/230-1-60 (SIZES 24, 36--60)

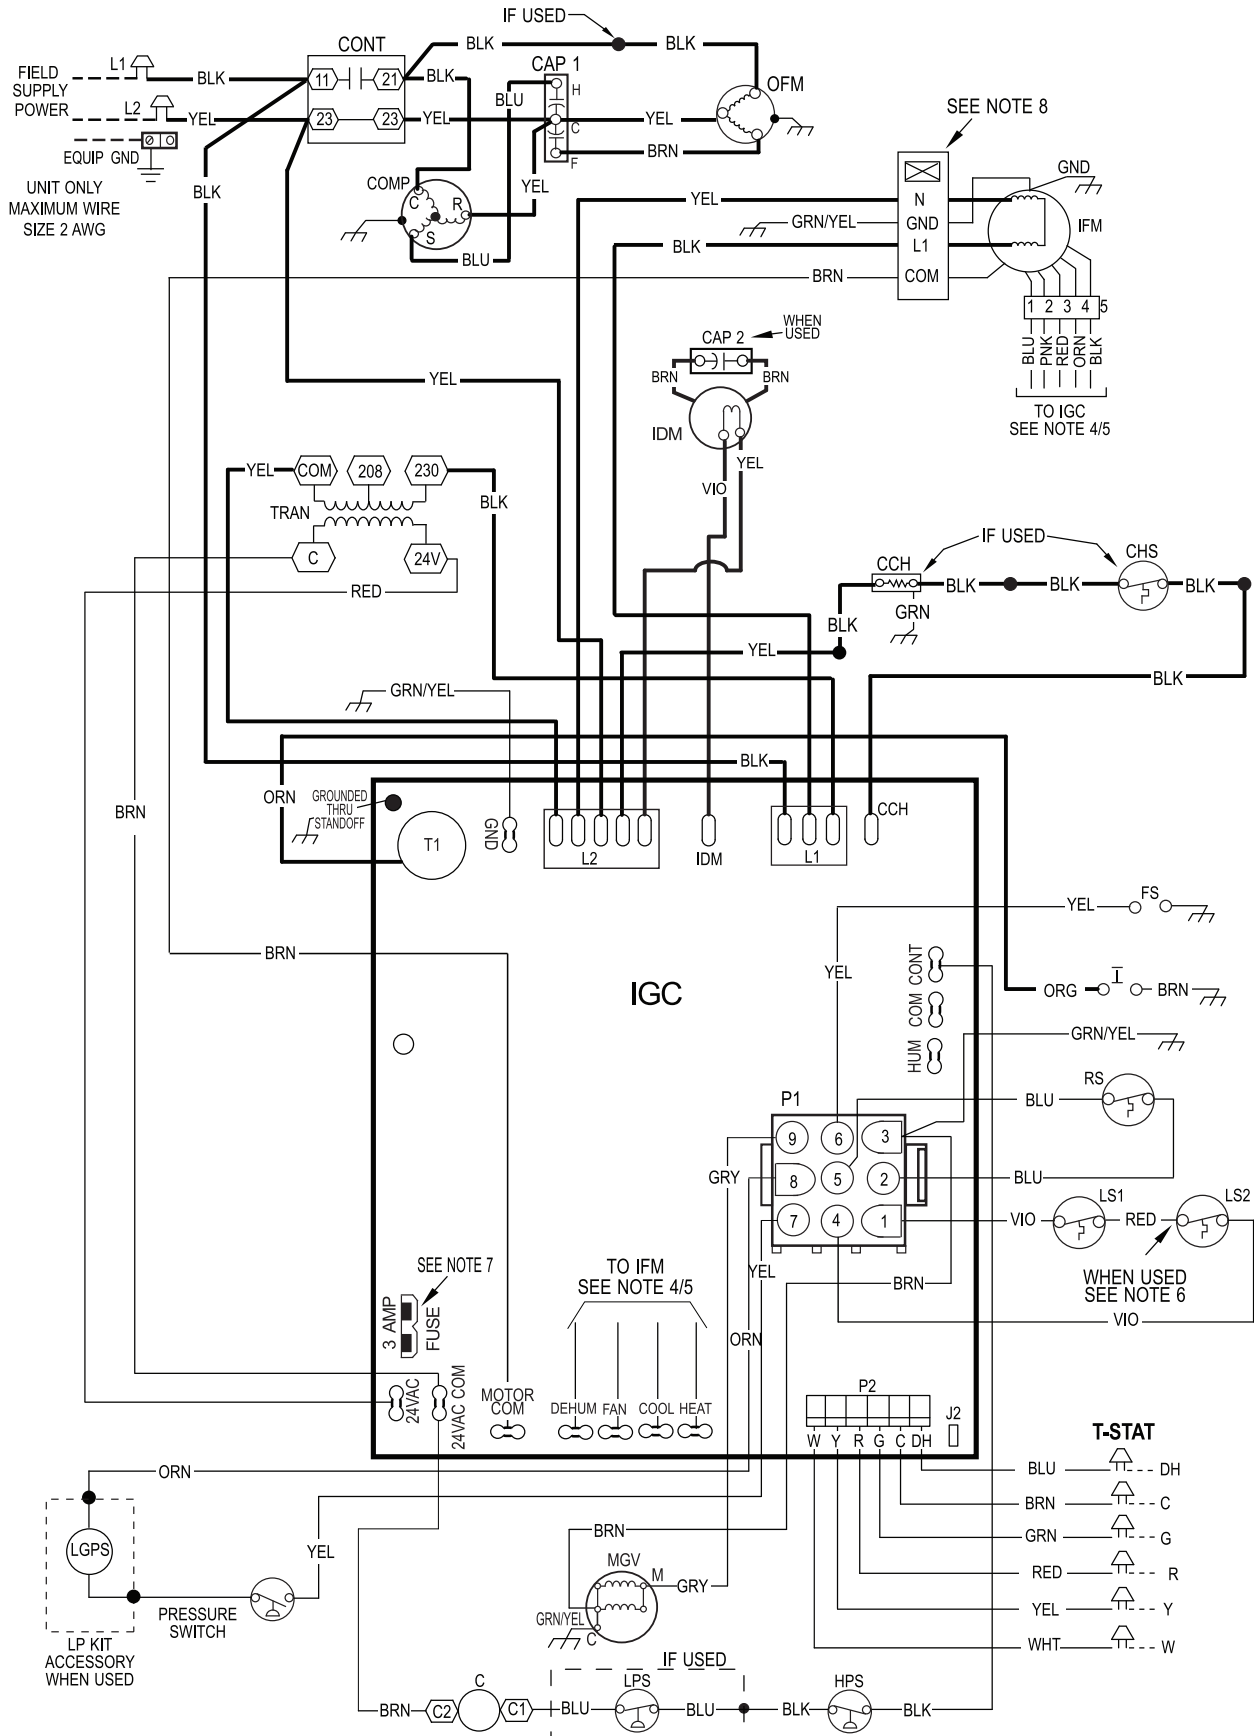

A150502





LADDER WIRING SCHEMATIC 208/230-1-60 (SIZES 24, 36--60)

LADDER WIRING DIAGRAM

DANGER: ELECTRICAL SHOCK HAZARD DISCONNECT POWER BEFORE SERVICING

| LEGEND | |
|--------|-------------------------------------|
| | FIELD SPICE |
| | TERMINAL (MARKED) |
| | TERMINAL (UNMARKED) |
| | SPLICE |
| | SPLICE (MARKED) |
| | FACTORY LO VOLTAGE |
| | FIELD CONTROL WIRING |
| | FIELD POWER WIRING |
| | ACCESSORY OR OPTIONAL WIRING |
| | FACTORY HI VOLTAGE |
| C | CONTACTOR |
| CAP1 | CAPACITOR, COMP |
| CAP2 | CAPACITOR, INDUCER (WHEN USED) |
| CCH | CRANKCASE HEATER |
| CHS | CRANKCASE HEATER SWITCH |
| COMP | COMPRESSOR MOTOR |
| EQUIP | EQUIPMENT |
| FS | FLAME SENSOR |
| GND | GROUND |
| HPS | HIGH PRESSURE SWITCH |
| I | IGNITOR |
| IDM | INDUCED DRAFT MOTOR |
| IFM | INDOOR FAN MOTOR |
| IGC | INTERGRATED GAS UNIT CONTROLLER |
| LGPS | LOW GAS PRESSURE SWITCH (WHEN USED) |
| LPS | LOW PRESSURE SWITCH |
| LS1 | PRIMARY LIMIT SWITCH |
| LS2 | SECONDARY LIMIT SWITCH |
| MGV | MAIN GAS VALVE |
| OFM | OUTDOOR FAN MOTOR |
| OT | OUTDOOR FAN MOTOR |
| RS | ROLLOUT SWITCH |
| TRAN | TRANSFORMER |
| T-STAT | THERMOSTAT |

10 UNIT COMPONENT ARRANGEMENT

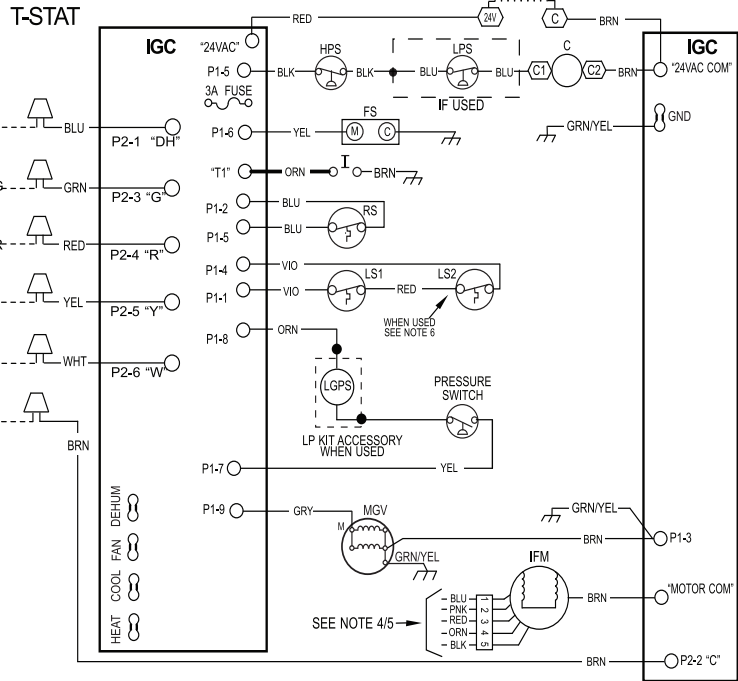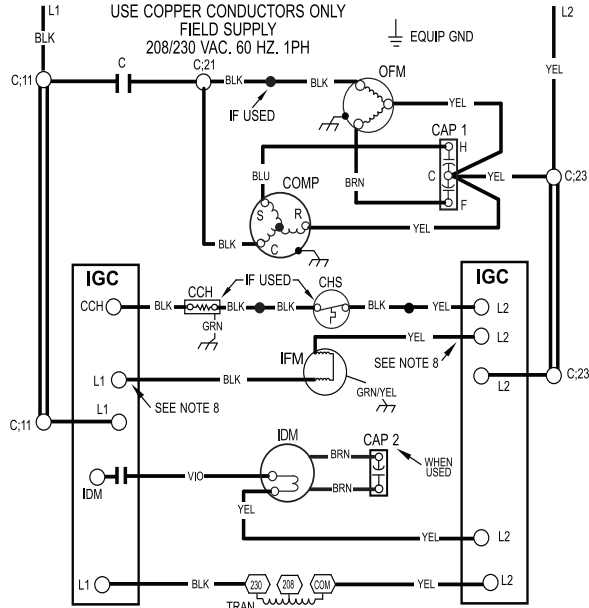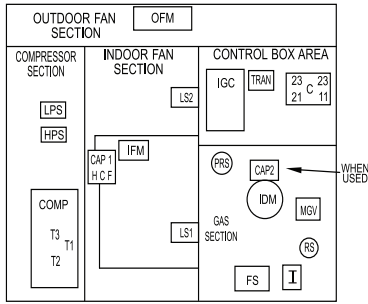

NOTES:

- IF ANY OF THE ORIGINAL WIRES FURNISHED ARE REPLACED THEY MUST BE REPLACED WITH THE SAME WIRE OR IT'S EQUIVALENT.
- SEE PRE-SALE LITERATURE FOR THERMOSTATS.
- USE 75 DEGREES C COPPER CONDUCTORS FOR FIELD INSTALLATION.
- REFER TO INSTALLATION INSTRUCTIONS FOR CORRECT SPEED SELECTION FOR IFM.
- SEE INSTALLATION INSTRUCTIONS FOR PROPER HEATING AND COOLING CONNECTIONS FOR YOUR UNIT.
- ON SOME MODELS LS1 AND LS2 ARE WIRED IN SERIES. ON OTHER MODELS ONLY LS1 IS USED.
- THIS FUSE IS MANUFACTURED BY LITTLE FUSE, PIN 287003.
- DO NOT DISCONNECT PLUG UNDER LOAD.
- N.E.C. CLASS 2, 24V.



48VLS00420 REV. -




A150510

LADDER WIRING SCHEMATIC 208/230-1-60 (30 SIZE)

CONNECTION WIRING DIAGRAM

DANGER: ELECTRICAL SHOCK HAZARD DISCONNECT POWER BEFORE SERVICING

SCHEMATIC 208/230-1-60

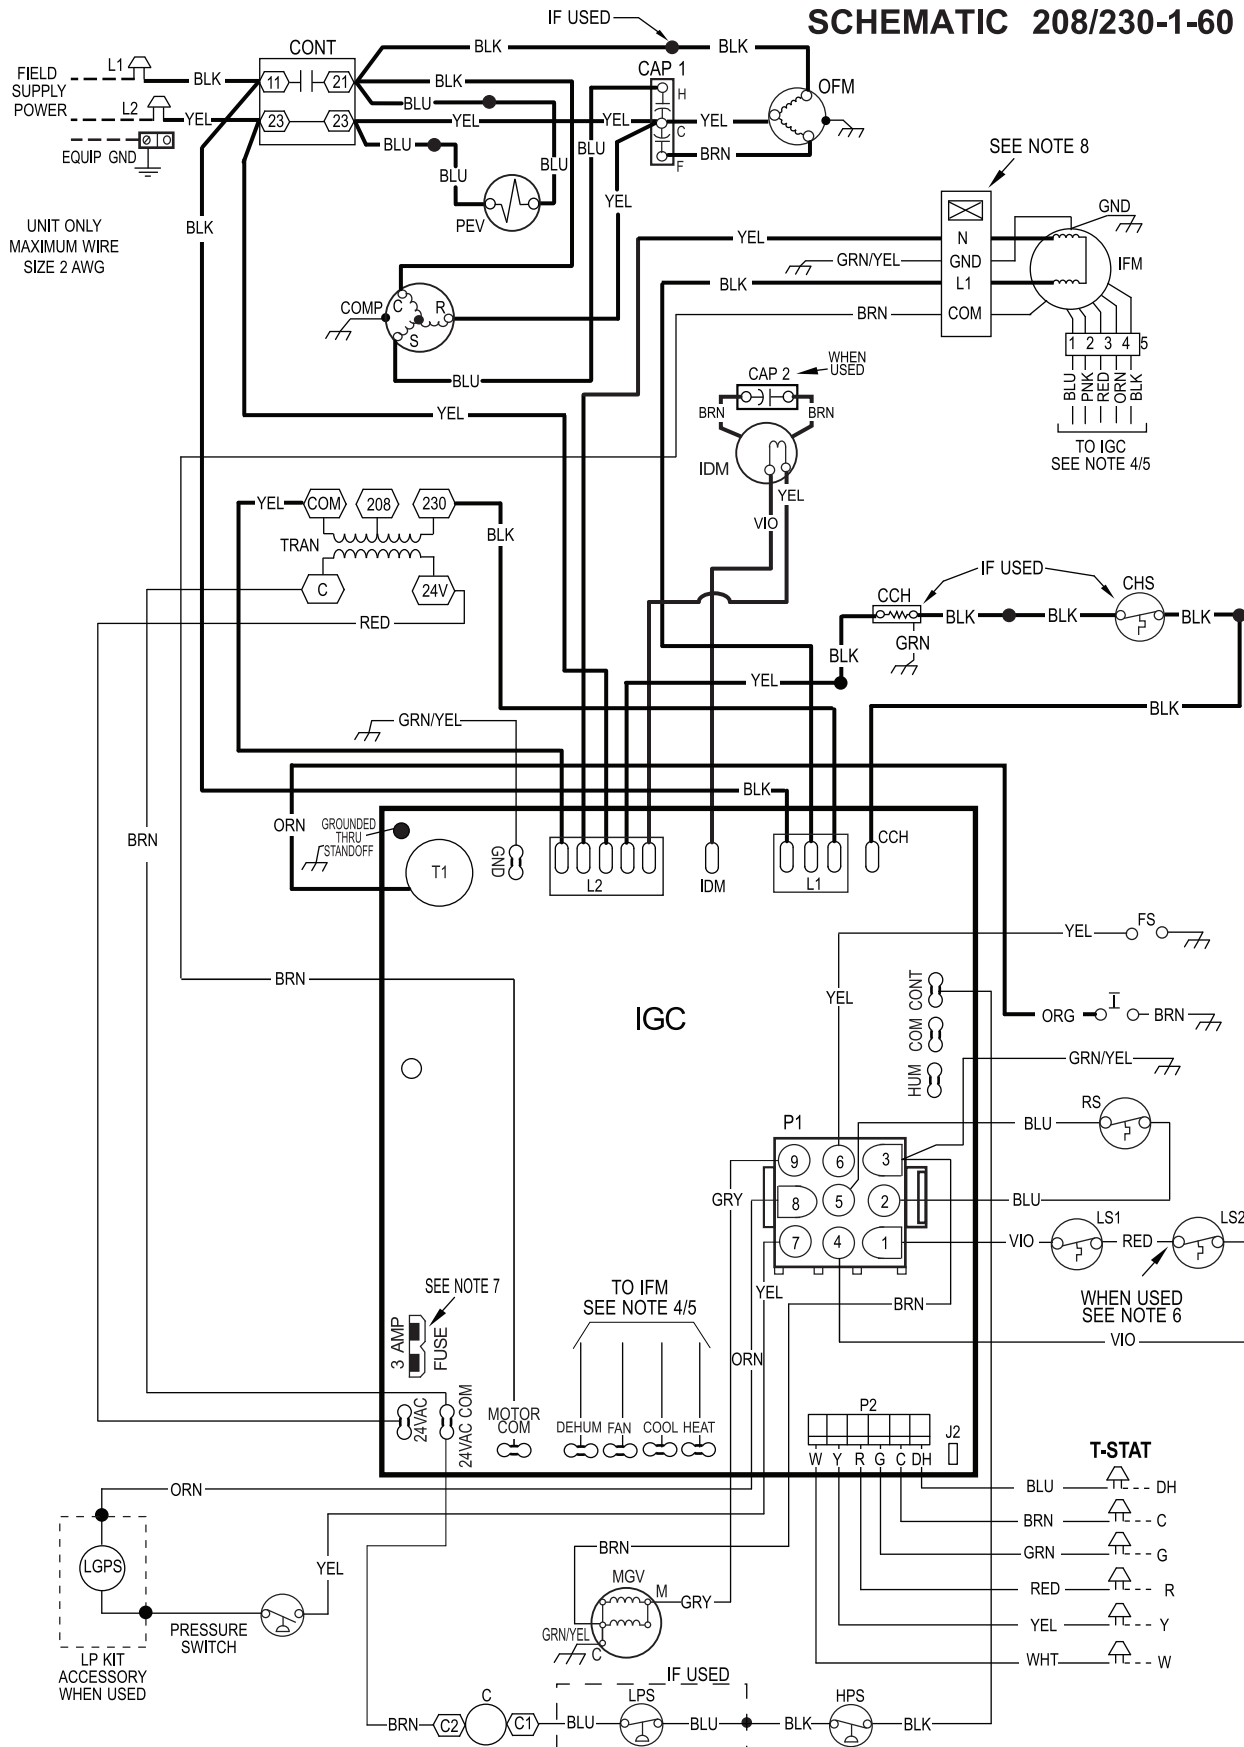

A200011

LADDER WIRING SCHEMATIC 208/230-1-60 (30 SIZE)



LADDER WIRING DIAGRAM

DANGER: ELECTRICAL SHOCK HAZARD DISCONNECT POWER BEFORE SERVICING

LEGEND



| | | | |
|--|--------------------------------|--------|-------------------------------------|
| | FIELD SPLICE | EQUIP | EQUIPMENT |
| | TERMINAL (MARKED) | FS | FLAME SENSOR |
| | TERMINAL (UNMARKED) | GND | GROUND |
| | SPLICE | HPS | HIGH PRESSURE SWITCH |
| | SPLICE (MARKED) | IDM | INDUCED DRAFT MOTOR |
| | FACTORY LO VOLTAGE | IFM | INDOOR FAN MOTOR |
| | FIELD CONTROL WIRING | IGC | INTERGRATED GAS UNIT CONTROLLER |
| | FIELD POWER WIRING | LGPS | LOW GAS PRESSURE SWITCH (WHEN USED) |
| | ACCESSORY OR OPTIONAL WIRING | LPS | LOW PRESSURE SWITCH |
| | FACTORY HI VOLTAGE | LS1 | PRIMARY LIMIT SWITCH |
| | CONTACTOR | LS2 | SECONDARY LIMIT SWITCH |
| | CAPACITOR, COMP | MGV | MAIN GAS VALVE |
| | CAPACITOR, INDUCER (WHEN USED) | OFM | OUTDOOR FAN MOTOR |
| | CAPACITOR, INDUCER (WHEN USED) | OT | QUADRUPLE TERMINAL |
| | CRANKCASE HEATER | PEV | PRESSURE EQUALIZER VALVE |
| | CRANKCASE HEATER SWITCH | RS | ROLLOUT SWITCH |
| | COMPRESSOR MOTOR | TRAN | TRANSFORMER |
| | | T-STAT | THERMOSTAT |

1Ø UNIT COMPONENT ARRANGEMENT

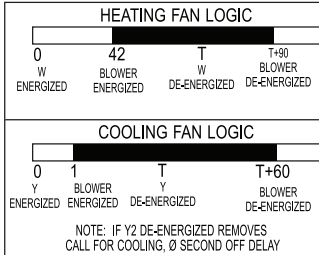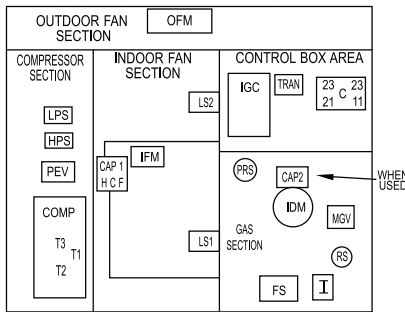

NOTES:

- IF ANY OF THE ORIGINAL WIRES FURNISHED ARE REPLACED THEY MUST BE REPLACED WITH THE SAME WIRE OR IT'S EQUIVALENT.
- SEE PRE-SALE LITERATURE FOR THERMOSTATS.
- USE 75 DEGREES C COPPER CONDUCTORS FOR FIELD INSTALLATION.
- REFER TO INSTALLATION INSTRUCTIONS FOR CORRECT SPEED SELECTION FOR IFM.
- SEE INSTALLATION INSTRUCTIONS FOR PROPER HEATING AND COOLING CONNECTIONS FOR YOUR UNIT.
- ON SOME MODELS LS1 AND LS2 ARE WIRED IN SERIES. ON OTHER MODELS ONLY LS1 IS USED.
- THIS FUSE IS MANUFACTURED BY LITTLE FUSE, P/N 287003.
- DO NOT DISCONNECT PLUG UNDER LOAD.
- N.E.C. CLASS 2, 24V.

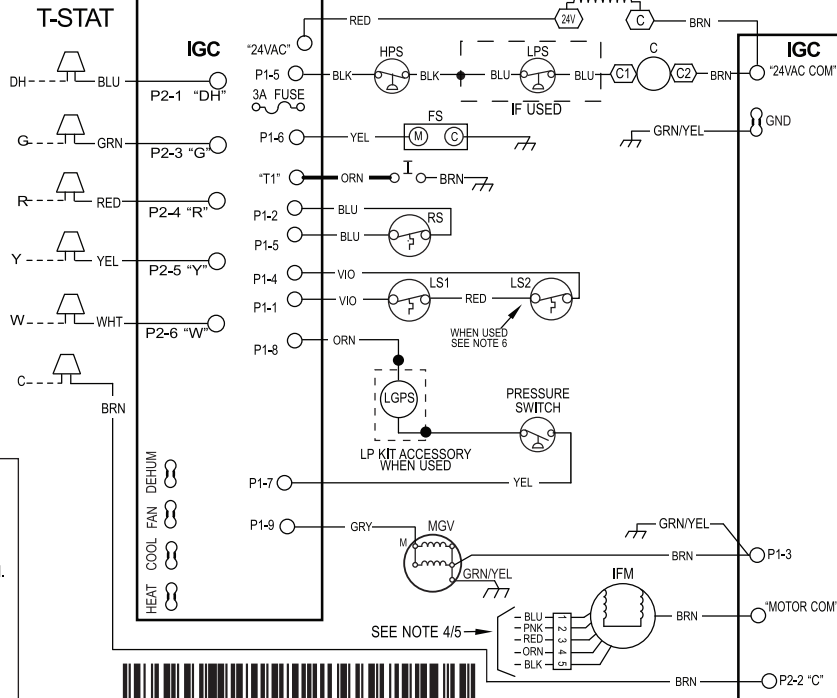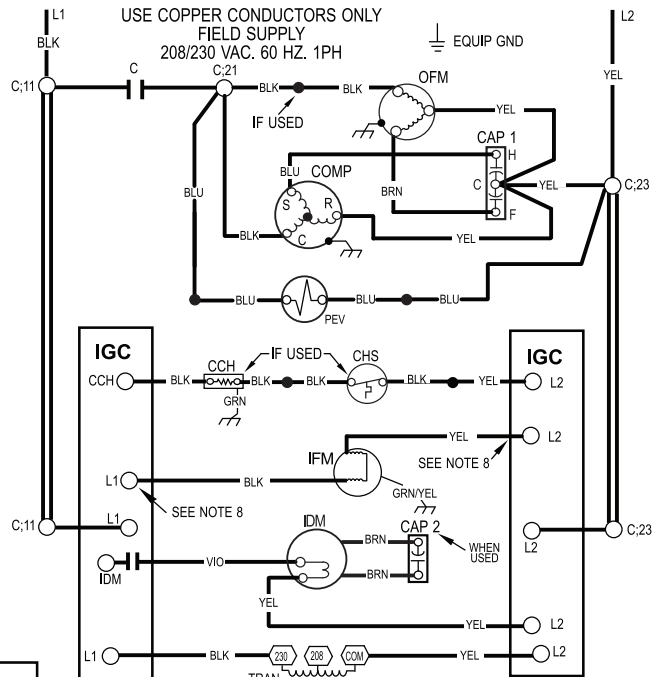

345755-101 REV.-

345755-101 REV.-




A200012

CONNECTION WIRING DIAGRAM

DANGER: ELECTRICAL SHOCK HAZARD DISCONNECT POWER BEFORE SERVICING

NOTES:



1. IF ANY OF THE ORIGINAL WIRES FURNISHED ARE REPLACED, THEY MUST BE REPLACED WITH TYPE 90 DEG. C WIRE OR ITS EQUIVALENT.
2. SEE PRE-SALE LITERATURE FOR THERMOSTAT AND SUBBASES. - "DO NOT DISCONNECT UNDER LOAD"
3. USE MIN. 75 DEG. COPPER CONDUCTORS FOR FIELD INSTALLATION.
4. SEE INSTALLATION INSTRUCTIONS FOR PROPER HEATING AND COOLING CONNECTIONS FOR YOUR UNIT. INDOOR FAN MOTOR PLUGS - "DO NOT DISCONNECT UNDER LOAD"
5. LS2 USED ON SMALL CHASSIS ONLY.
6. INDUCER CAPACITOR AND WIRING ON CERTAIN MODELS ONLY. IF CAP2 IS PRESENT, YELLOW WIRES FROM IGC AND IDM CONNECT ON SAME SIDE OF CAP2.
7. THIS FUSE IS MANUFACTURED BY LITTELFUSE, P/N 287003.
8. THIS FUSE IS MANUFACTURED BY LITTELFUSE, P/N 287005.
9. DEHUMIDIFICATION FEATURE CANNOT BE USED WHEN ECONOMIZER IS INSTALLED.
10. N.E.C. CLASS 2 24 V

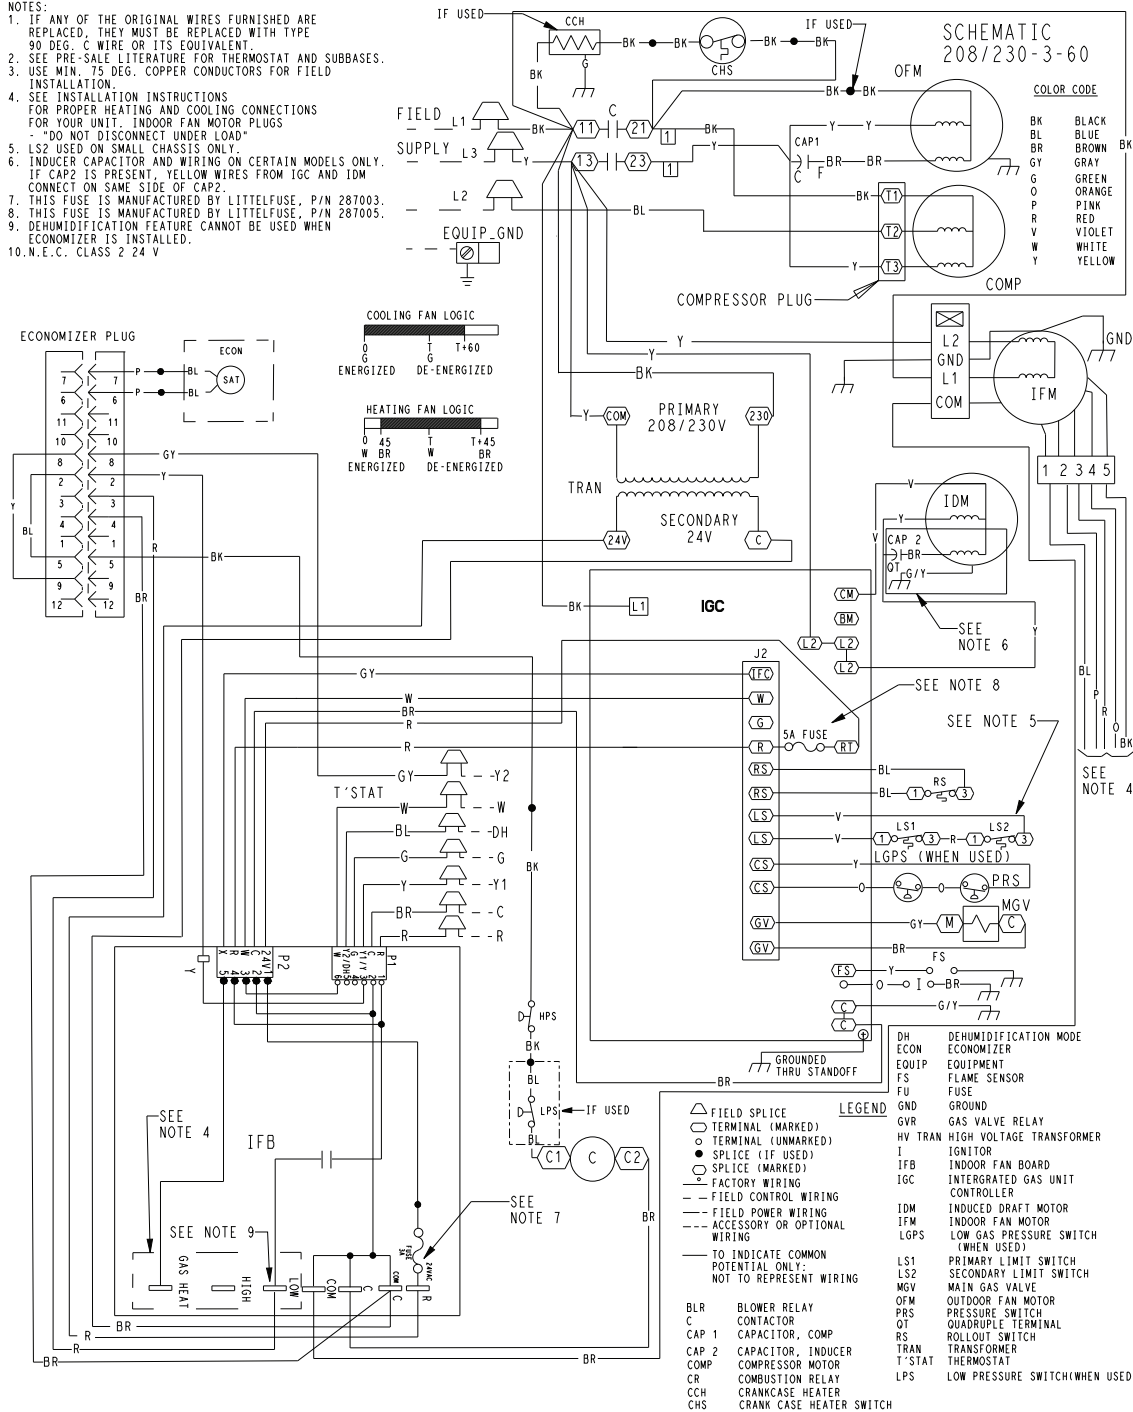

LADDER WIRING SCHEMATIC 208/230-3-60

LADDER WIRING DIAGRAM

DANGER: ELECTRICAL SHOCK HAZARD DISCONNECT POWER BEFORE SERVICING

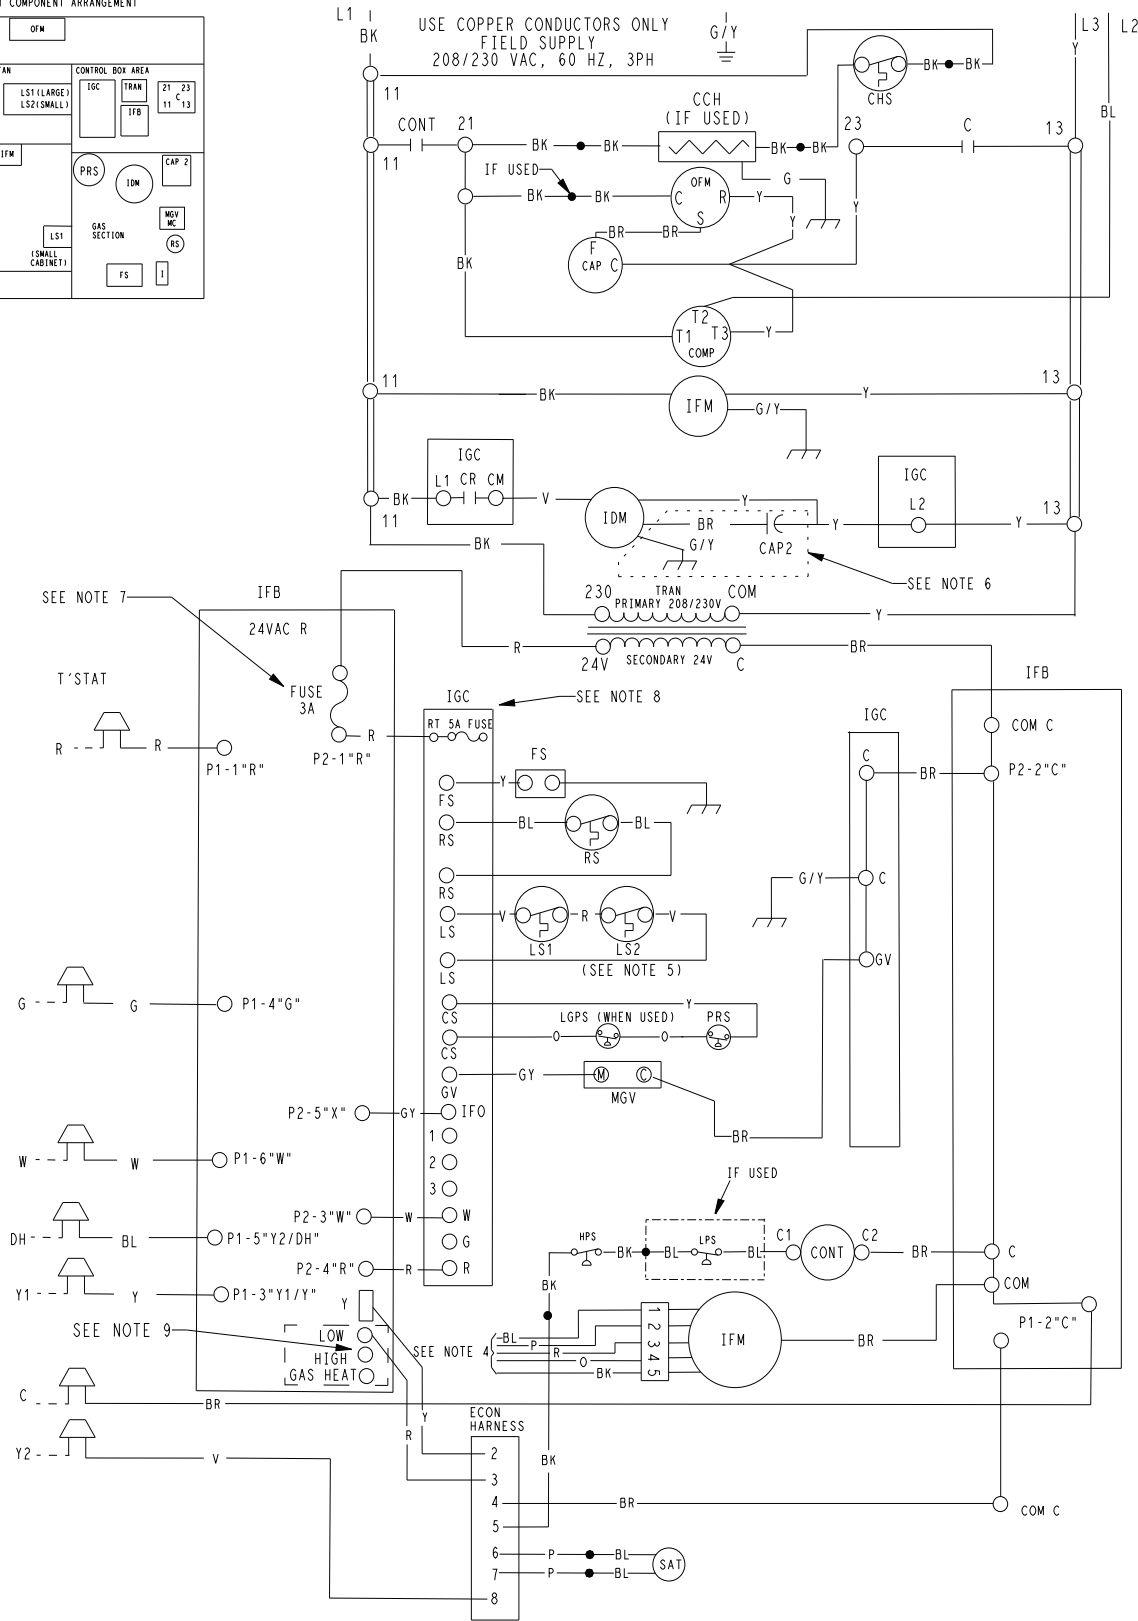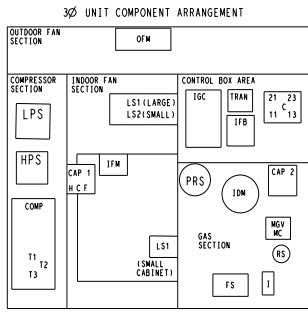

48VL500421 -

A150511

CONNECTION WIRING DIAGRAM

DANGER: ELECTRICAL SHOCK HAZARD DISCONNECT POWER BEFORE SERVICING


NOTES:

- IF ANY OF THE ORIGINAL WIRES FURNISHED ARE REPLACED, THEY MUST BE REPLACED WITH TYPE 90 DEG. C WIRE OR ITS EQUIVALENT.
- SEE PRE-SALE LITERATURE FOR THERMOSTAT AND SUBBASES.
- USE MIN. 75 DEG. COPPER CONDUCTORS FOR FIELD INSTALLATION.
- SEE INSTALLATION INSTRUCTIONS FOR PROPER HEATING AND COOLING CONNECTIONS FOR YOUR UNIT. INDOOR FAN MOTOR PLUGS - "DO NOT DISCONNECT UNDER LOAD"
- LS2 USED ON SMALL CHASSIS ONLY.
- INDUCER CAPACITOR AND WIRING ON CERTAIN MODELS ONLY. IF CAP2 IS PRESENT, YELLOW WIRES FROM CONTACTOR AND IDM CONNECT ON SAME SIDE OF CAP2.
- THIS FUSE IS MANUFACTURED BY LITTELFUSE, P/N 287003.
- THIS FUSE IS MANUFACTURED BY LITTELFUSE, P/N 287005.
- DEHUMIDIFICATION FEATURE CANNOT BE USED WHEN ECONOMIZER IS INSTALLED.
- N.E.C. CLASS 2 24 V

SCHEMATIC 460-3-60

COLOR CODE


- BK BLACK
- BL BLUE
- BR BROWN
- G Y GRAY
- GO GREEN
- O PINK
- R RED
- V VIOLET
- W WHITE
- Y YELLOW

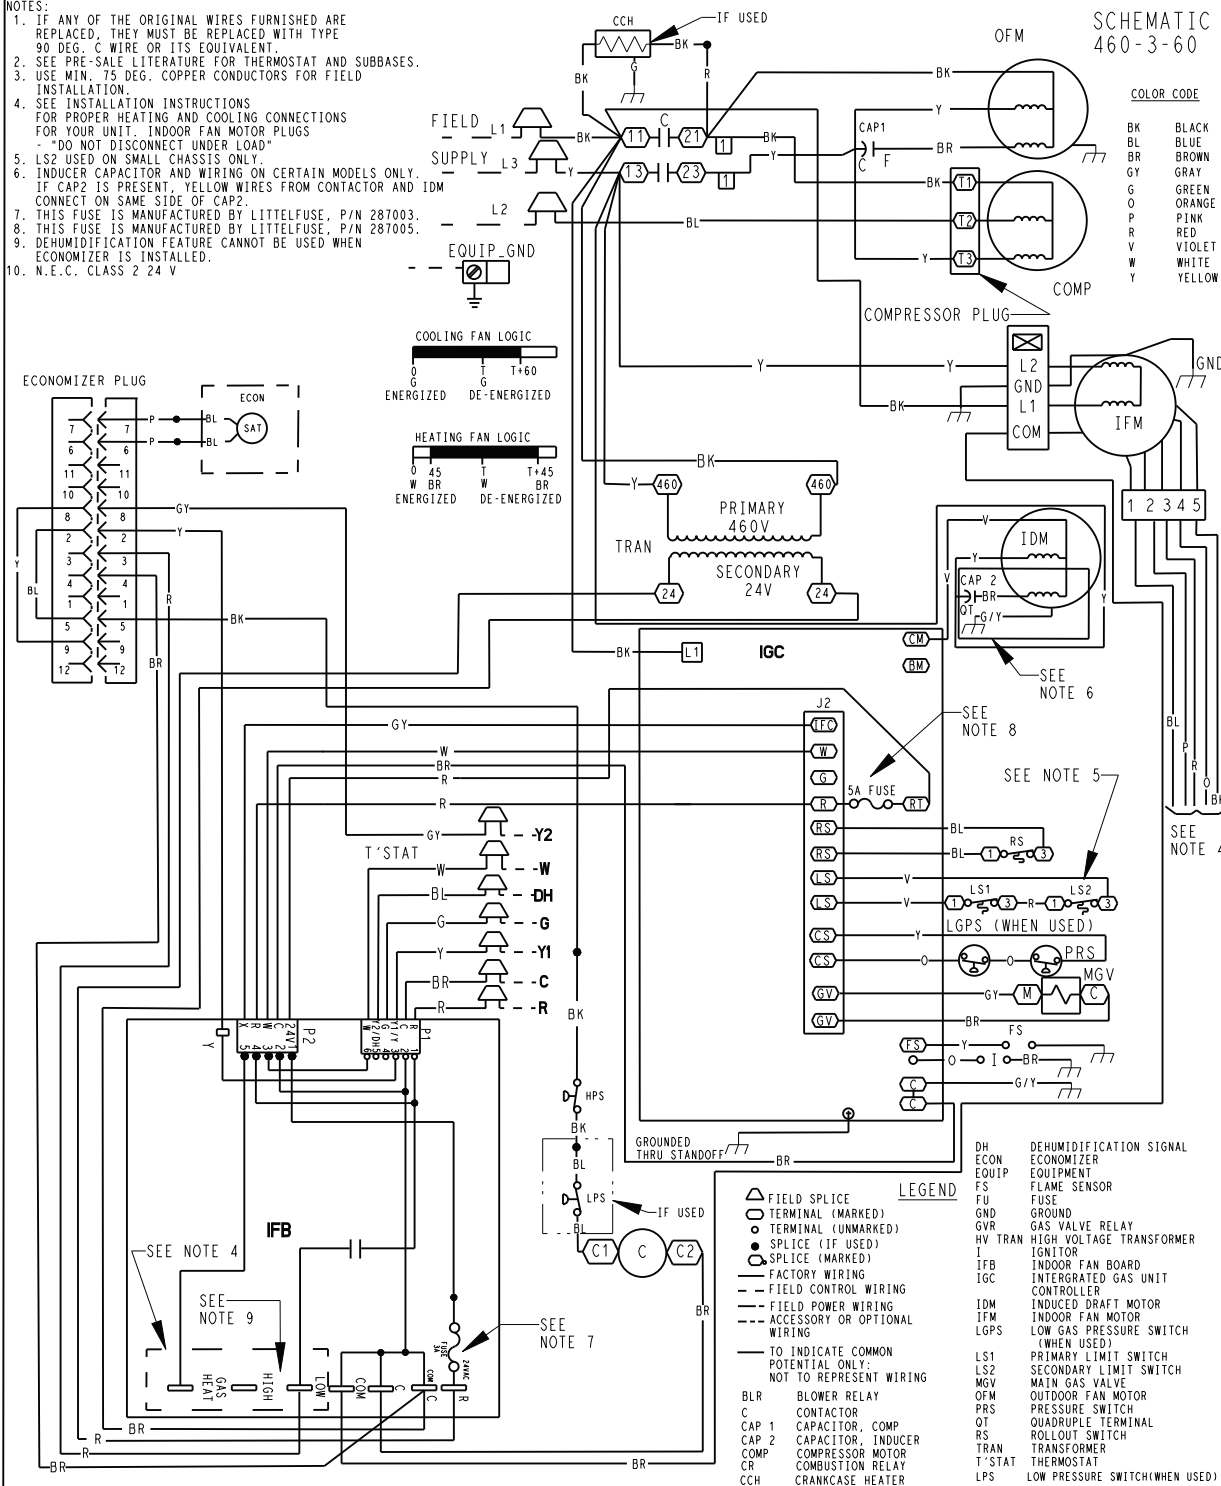

- LEGEND**
- △ FIELD SPLICE
 - TERMINAL (MARKED)
 - TERMINAL (UNMARKED)
 - SPLICE (IF USED)
 - SPLICE (MARKED)
 - FACTORY WIRING
 - - - FIELD CONTROL WIRING
 - - - FIELD POWER WIRING
 - - - ACCESSORY OR OPTIONAL WIRING
 - TO INDICATE COMMON POTENTIAL ONLY; NOT TO REPRESENT WIRING
- BLR BLOWER RELAY
 - C CONTACTOR
 - CAP 1 CAPACITOR, COMP
 - CAP 2 CAPACITOR, INDUCER
 - COMP COMPRESSOR MOTOR
 - CR COMBUSTION RELAY
 - CCH CRANKCASE HEATER
 - DH DEHUMIDIFICATION SIGNAL
 - ECON ECONOMIZER
 - EQUIP EQUIPMENT
 - FS FLAME SENSOR
 - FU FUSE
 - GND GROUND
 - GVR GAS VALVE RELAY
 - HV TRAN HIGH VOLTAGE TRANSFORMER
 - I IGNITOR
 - IFB INDOOR FAN BOARD
 - IGC INTEGRATED GAS UNIT CONTROLLER
 - IDM INDUCED DRAFT MOTOR
 - IFM INDOOR FAN MOTOR
 - LGPS LOW GAS PRESSURE SWITCH (WHEN USED)
 - LS1 PRIMARY LIMIT SWITCH
 - LS2 SECONDARY LIMIT SWITCH
 - MGV MAIN GAS VALVE
 - OFM OUTDOOR FAN MOTOR
 - PRS PRESSURE SWITCH
 - QT QUADRUPLE TERMINAL
 - RS ROLLOUT SWITCH
 - TRAN TRANSFORMER
 - T-STAT THERMOSTAT
 - LPS LOW PRESSURE SWITCH (WHEN USED)

LADDER WIRING DIAGRAM

DANGER: ELECTRICAL SHOCK HAZARD DISCONNECT POWER BEFORE SERVICING

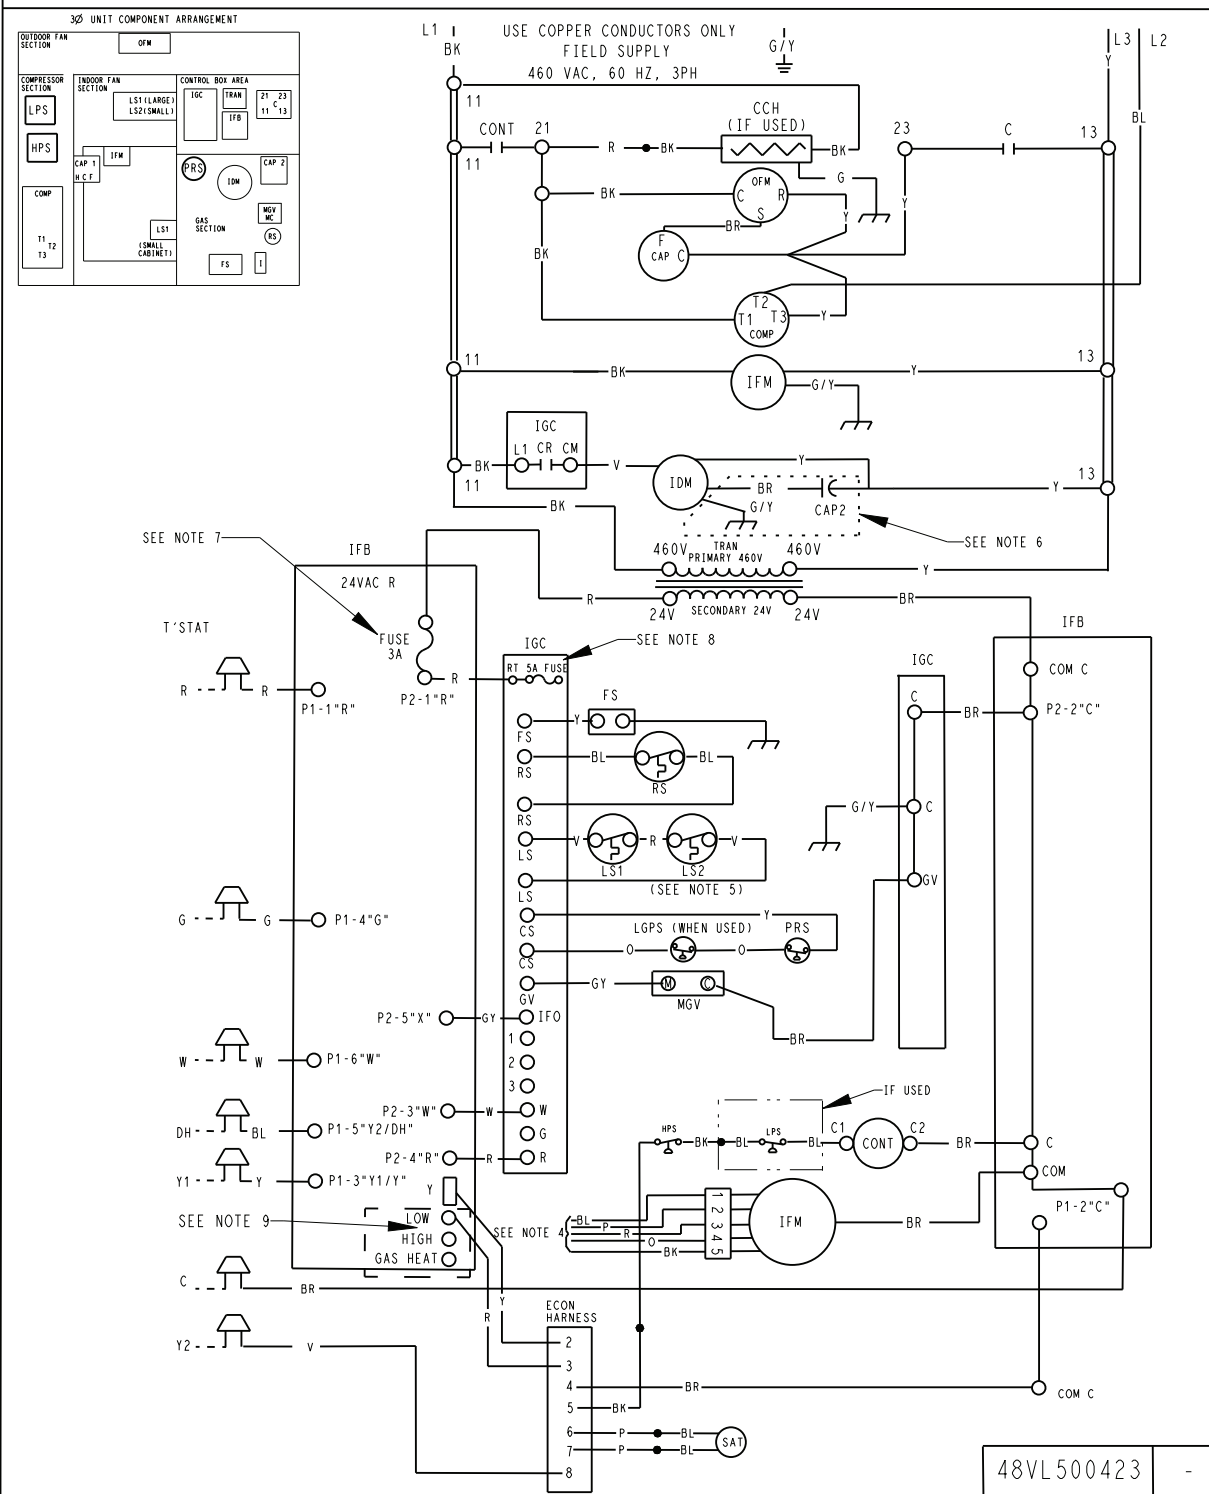

A150512

CONTROLS

Operating sequence

Heating (Single Phase Models) – (See unit wiring label) On a call for heating, terminal W of the thermostat is energized, starting the induced-draft motor for a 5 second pre-purge. When the pressure switch senses that the induced-draft motor is moving sufficient combustion air, the burner sequence begins. This function is controlled by the integrated gas unit controller (IGC). The indoor (evaporator) fan motor is energized 30 seconds after flame is established. When the thermostat is satisfied and W is de-energized, the burners stop firing and the indoor (evaporator) fan motor shuts off after a 90 second time-off delay. Please note that the IGC has the capability to automatically reduce the indoor fan motor on delay and increase the indoor fan motor off delay in the event of high duct static and/or a partially-clogged filter.

Heating (Three Phase Models) – On a call for heating, terminal W of the thermostat is energized, starting the induced-draft motor. When the pressure switch senses that the induced-draft motor is moving sufficient combustion air, the burner sequence begins. This function is performed by the integrated gas unit controller (IGC). The indoor (evaporator) fan motor is energized 45 sec after flame is established. When the thermostat is satisfied and W is de-energized, the burners stop firing and the indoor (evaporator) fan motor shuts off after a 45-sec time-off delay. Please note that the IGC has the capability to automatically reduce the indoor fan motor on delay and increase the indoor fan motor off delay in the event of high duct static and/or partially-clogged filter.

Cooling — When the system thermostat calls for cooling, 24 V is supplied to the “Y” and “G” terminals of the thermostat. This completes the circuit to the contactor coil (C) and indoor (evaporator) fan relay (IFR). The normally open contacts of energized C close and complete the circuit through compressor motor (COMP) to outdoor (condenser) fan motor (OFM). Both motors start instantly. The set of normally open contacts of energized IFR close and complete the circuit through IFM. The IFM starts instantly.

On the loss of the thermostat call for cooling, 24 V is removed from both the “Y” and “G” terminals (provided the fan switch is in the “AUTO” position) de-energizing the compressor contactor and opening the contacts supplying power to compressor/OFM. After a 60-second delay (1-phase) or 90-second delay (3-phase), the IFM shuts off. If the thermostat fan selector switch is in the “ON” position, the IFM will run continuously.

GUIDE SPECIFICATIONS

Packaged Gas Heating/Electric Cooling Units Constant Volume Application

HVAC Guide Specifications

Size Range: **2 to 5 Tons, Nominal Cooling
40,000 to 127,000 Btuh,
Nominal Heating Input**

SYSTEM DESCRIPTION

Outdoor rooftop mounted, gas heating/electric cooling unit utilizing a hermetic scroll compressor for cooling duty. Unit shall discharge supply air vertically or horizontally as shown on contract drawings. Condenser fan/coil section shall have a draw-thru design with vertical discharge for minimum sound levels.

QUALITY ASSURANCE

- A. Unit shall be rated in accordance with AHRI Standards 210/240 and 270-1995.**
- B. Unit shall be designed in accordance with UL Standard 1995 and ANSI Z 21.47.**
- C. Unit shall be manufactured in a facility registered to ISO 9001 manufacturing quality standard.**
- D. Unit shall be UL listed and c-UL certified as a total package for safety requirements.**
- E. Roof curb shall be designed to conform to NRCA Standards.**
- F. Insulation and adhesives shall meet NFPA 90.1 requirements for flame spread and smoke generation.**
- G. Cabinet insulation shall meet ASHRAE Standard 62.2.**

DELIVERY, STORAGE AND HANDLING

Unit shall be stored and handled per manufacturer's recommendations.

Part 2 — Products

EQUIPMENT

A. General:

Factory-assembled, single-piece, heating and cooling unit. Contained within the enclosure shall be all factory wiring, piping, controls, refrigerant charge with R-410A refrigerant, and special features required prior to field start-up.

B. Unit Cabinet:

1. Unit cabinet shall be constructed of phosphated, zinc-coated, pre-painted steel capable of with-standing 500 hours in salt spray.
2. Normal service shall be through 3 removable cabinet panels.
3. The unit shall be constructed on a rust proof unit base that has an externally trapped, integrated sloped drain.
4. Evaporator fan compartment top surface shall be insulated with a minimum 1/2-in. (12.7 mm) thick, flexible fiberglass insulation, coated on the air side and retained by adhesive and mechanical means. The evaporator wall sections will be insulated with a minimum semi-rigid foil-faced board capable of being wiped clean. Aluminum foil-faced fiberglass insulation shall be used in the entire indoor air cavity section.
5. Unit shall have a field-supplied condensate trap.

C. Fans:

1. The evaporator fan shall be a multi-speed, direct-drive, as shown on equipment drawings.
2. Fan wheel shall be made from steel, be double-inlet type with forward curved blades with corrosion resistant finish. Fan wheel shall be dynamically balanced.
3. Condenser fan shall be direct drive propeller type with aluminum blades riveted to corrosion resistant steel spiders, be dynamically balanced, and discharge air vertically.

D. Compressor:

1. Fully hermetic compressors with factory-installed vibration isolation.

E. Coils:

Evaporator and condenser coils shall have aluminum plate fins mechanically bonded to seamless copper tubes with all joints brazed. Tube sheet openings shall be belled to prevent tube wear.

GUIDE SPECIFICATIONS (CONT)

F. Heating Section:

1. Induced-draft combustion type with energy saving direct spark ignition system and redundant main gas valve.
2. Induced-draft motors shall provide adequate airflow for combustion.
3. The heat exchangers shall be constructed of aluminized steel for corrosion resistance.
4. Burners shall be of the in-shot type constructed of aluminum coated steel.
5. All gas piping and electric power shall enter the unit cabinet at a single location.

G. Refrigerant Components:

Refrigerant expansion device shall be of the TXV (thermostatic expansion valve) or fixed orifice type.

H. Filters:

Filter section shall consist of field-installed, throwaway, 1-in. (25 mm) thick fiberglass filters of commercially available sizes.

I. Controls and Safeties:

1. Unit controls shall be complete with a self-contained low voltage control circuit.
2. Compressors shall incorporate a solid-state compressor protector that provides reset capability.

J. Operating Characteristics:

1. Unit shall be capable of starting and running at 125°F (51°C) ambient outdoor temperature per maximum load criteria of AHRI Standard 210.
2. Compressor with standard controls shall be capable of operation down to 40°F (4°C) ambient outdoor temperature.
3. Units shall be provided with fan time delay to prevent cold air delivery before the heat exchanger warms up.
4. Unit shall be provided with 60-second fan time delay (single phase models) or 90 second fan time delay (three phase models) after the thermostat is satisfied.

K. Electrical Requirements:

All unit power wiring shall enter the unit cabinet at a single location.

L. Motors:

1. Compressor motors shall be of the refrigerant-cooled type with line-break thermal and current overload protection.
2. All fan motors shall have permanently lubricated bearings, and inherent, automatic reset, thermal overload protection.
3. Condenser fan motor shall be totally enclosed.
4. Evaporator Fan Motor to be ECM Motor.

M. Compressor Protection:

Solid-state control shall protect compressor by preventing "short cycling."

N. Low NOx:

Shall provide NOx reduction to values below 40 nano-grams/joule to meet California's and other localities' emission requirements as shipped from factory.

O. Special Features Available:

1. Compressor Start Kit (single phase units only):
Shall provide additional starting torque for single-phase compressors.
2. Thermostat:
To provide for one-stage heating and cooling in addition manual or automatic changeover and indoor fan control.

3. Crankcase Heater:
Shall provide anti-floodback protection for low-load cooling applications.
4. Economizer:
(Horizontal – Field installed accessory)
(Vertical – Field installed accessory)
 - a. Economizer controls capable of providing free cooling using outside air.
 - b. Equipped with low leakage dampers not to exceed 3% leakage, at 1.0 IN. W.C. pressure differential.
 - c. Spring return motor shuts off outdoor damper on power failure.
5. Filter Rack Kit:
Shall provide filter mounting for downflow applications. Offered as field installed accessory.
6. Flat Roof Curb:
Curbs shall have seal strip and a wood nailer for flashing and shall be installed per manufacturer's instructions.
7. Flue Discharge Deflector
Directs flue gas exhaust; 90 degrees upward from current discharge.
8. High Altitude Propane Conversion Kit:
Shall consist of all required hardware to convert to propane gas heat operation at 2001 to 6000 ft (611 to 1829 m) above sea level.
9. Low Ambient Package:
Shall consist of a solid-state control and condenser coil temperature sensor for controlling condenser-fan motor operation, which shall allow unit to operate down to 0°F (-18°C) outdoor ambient temperature when properly installed.
10. Manual Outdoor Air Damper:
Package shall consist of damper, birdscreen, and rain-hood which can be preset to admit outdoor air for year-round ventilation.
11. Natural-to-Propane Conversion Kit:
Shall be complete with all required hardware to convert to propane gas operation at 10.0 IN. W.C. manifold pressure.
12. Propane-to-Natural Conversion Kit
Shall be complete with all hardware to convert to natural gas at standard altitude (0 to 2000 ft [0 to 610 m] above sea level).
13. Square-To-Round Duct Transitions (24-48 models):
Shall have the ability to convert the supply and return openings from rectangular to round.
14. Cabinet Leakage
Cabinet air leakage less than 2.0% at 0.5 inch W.C. when tested in accordance with ASHRAE standard 193. Available as a factory installed option.
15. Low Pressure Switch Kit
Kit is designed for use when a low pressure control is desired. This kit provides added reliability for the compressor.

ACCESSORIES

| PGD4, PGS4 ACCESSORIES | | |
|--|--|------------|
| Accessory Model Number | Description | Use With |
| CURBS | | |
| CPRFCURB011B00 | Roof Curb, 14" High | 24 – 60 |
| CPRFCURB013B00 | Roof Curb, 14" High | 42 – 60 |
| Note: CPRFCURB011B00 can be used with 42–60 size units with some overhang. | | |
| ADAPTER CURBS* | | |
| CPADCURB001A00 | Adapter curb for use with NPRFCURB006A00 & NPRFCURB007A00 | 24 – 36 |
| CPADCURB002A00 | Adapter curb for use with NPRFCURB008A00 & NPRFCURB009A00 | 42 – 60 |
| * Can also be used when replacing other manufacturer's older generation units that contain a composite base without a metal base rail. | | |
| CONCENTRIC ADAPTERS – (Use with curb only) | | |
| NPCONADP001A00 | For 18" round duct (use with curb CPRFCURB011B00) | Small Curb |
| NPCONADP002A00 | For 18" round duct (use with curb CPRFCURB013B00) | Large Curb |
| ECONOMIZERS | | |
| CPECOMZR007B00 | Dedicated Vertical Economizer – Internal with solid state controller, gear driven, fully modulating damper, spring return actuator, up to 50% barometric relief, supply and dry bulb outdoor air sensors. Includes filter rack with 1" filters. | 24 – 36 |
| CPECOMZR008A00 | | 42 – 48 |
| CPECOMZR009A00 | | 60 |
| CPECOMZR010B00 | Dedicated Horizontal Economizer – Internal with solid state controller, fully modulating damper, spring return actuator, supply and dry bulb outdoor air sensor, and low ambient compressor lockout switch included. Includes filter rack with 1" filters. | 24 – 36 |
| CPECOMZR011B00 | | 42 – 48 |
| CPECOMZR012B00 | | 60 |
| AXB078ENT | Outdoor Enthalpy Control | ALL |
| * Outdoor enthalpy available as field installed accessory; Filter rack and 1" filter, same as CPFILTRK kit | | |
| DAMPERS | | |
| CPMANDPR007A00 | Manual Outside Air Damper (Includes filter rack and 1" filter, same as CPFILTRK kit) | 24 – 36 |
| CPMANDPR008A00 | | 42 – 48 |
| CPMANDPR009A00 | | 60 |
| INTERNAL FILTER RACKS | | |
| CPFILTRK007A00 | Internal Filter Rack (includes 1-inch filters) | 24 – 36 |
| CPFILTRK008A00 | | 42– 48 |
| CPFILTRK009A00 | | 60 |
| CRANKCASE HEATER – BELLY BAND TYPE | | |
| CPCRKHTR008A00 | 240V Crankcase Heater (3-phase) | 24 – 36 |
| CPCRKHTR004A00 | 240V Crankcase Heater (Single-phase) | 30 |
| CPCRKHTR004A00 | 240V Crankcase Heater (Single-phase & 3-phase) | 42 – 60 |
| CPCRKHTR009A00 | 460V Crankcase Heater | 36 |
| CPCRKHTR005A00 | 460V Crankcase Heater | 42 – 60 |
| LOW AMBIENT, ANTI-CYCLE TIMER, COMPRESSOR START ASSIST | | |
| CPLOWAMB001A00 | Low Ambient Control – enables cooling system to operate down to 0 Deg. F by cycling condenser fan on and off. | ALL |
| NRTIMEGD001A00 | Five Minute Compressor Delay | ALL |
| CPHSTART002A00 | PTC Compressor Start Assist Kit (Single-phase) | ALL |
| HAIL GUARDS / COIL PROTECTION (Factory installed on PGS models) | | |
| NAPA00501GR | 3/8" spacing dense wire grilles 18" | 24 |
| NAPA00701GR | 3/8" spacing dense wire grilles 16" | 30 |
| NAPA01401GR | 3/8" spacing dense wire grilles 22" | 36 |
| NAPA00601GR | 3/8" spacing dense wire grilles 14" | 42 |
| NAPA01201GR | 3/8" spacing dense wire grilles 16" | 48 |
| NAPA01301GR | 3/8" spacing dense wire grilles 24" | 60 |

ACCESSORIES (CONT)

| GAS CONVERSION KITS | | |
|---------------------------------|--|-------|
| NPLPCONV013C00 | Natural to LP Conversion Kit (0 – 2000') | ALL |
| NPLPCONV014C00 | Natural to LP Conversion Kit (2001' – 6000') | ALL |
| NPNGCONV004C00 | LP to Natural Gas Conversion Kit (0 – 2000') | ALL |
| FLUE DISCHARGE DEFLECTOR | | |
| CPFLUEDS001A00 | Directs flue gas exhaust 90 degrees upward from current discharge. Designed to allow tighter distances between unit and combustible surfaces. 24 inch Height. AGA certified. | ALL |
| DUCT TRANSITIONS | | |
| NPDUCFLG002A00 | Square to Round (1 set of 2, use with horizontal duct flanges only) | 24–48 |