




ROOF 35

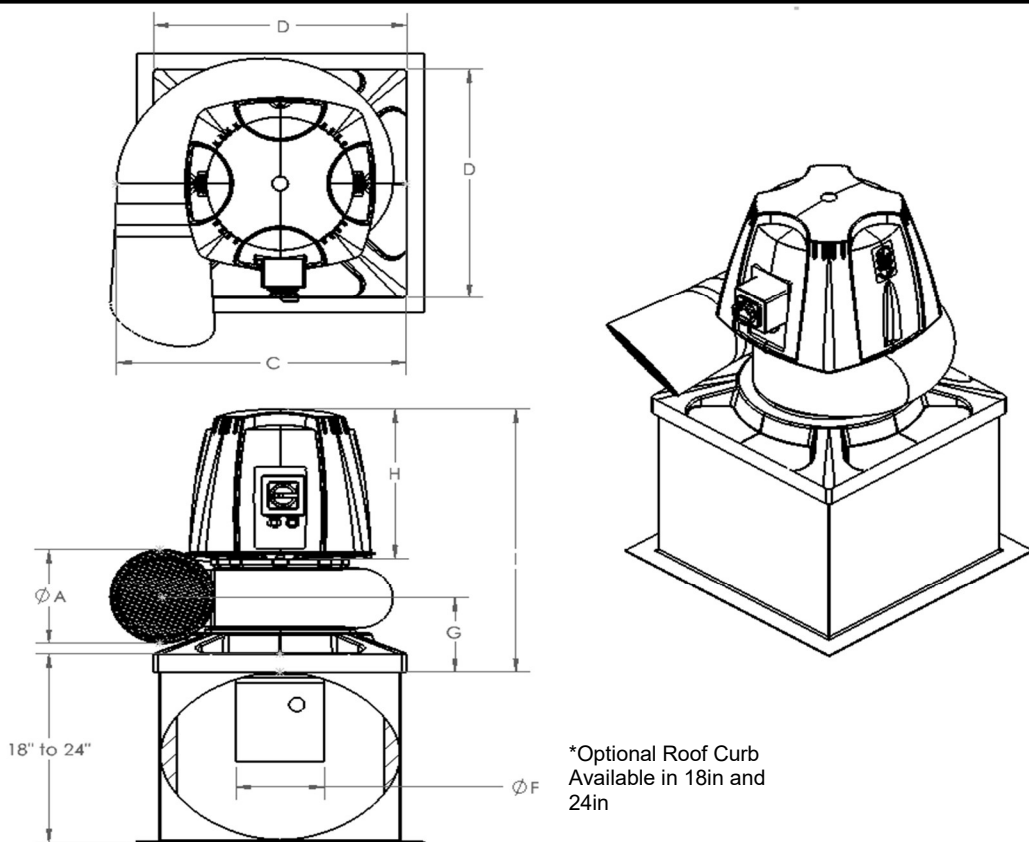

*Optional Roof Curb
Available in 18in and
24in

Mechanical Data

	ØA (OD)	C	D	ØF (OD)	G	H	I
in	14.66	36.67	28.49	12.38	8.8	20.40	36.55
mm	373	933	725	315	223	519	930

Project Name	
Date	
Engineer/Sales Rep	
Client	
Contractor	

Property rights to all drawings, details, representations, ideas, data, notes and specifications either copies or originals thereof that may be incorporated into the design and/or project are the property solely of Plastec ventilation, inc. Permission for any copies of said copyrighted materials, drawings, details, representations, ideas, data, notes and specifications either originals or copies thereof to be made, copied or altered by any person, business, or corporation may only be authorized with the expressed written permission of Plastec ventilation, inc. By the use of this data, the user acknowledges that he/she has read and understand all of the notes included herein.



ROOF 35


Model Numbers

Model Number	Max. Flow (cfm)	Min. Flow (cfm)	Max. Static (in. Wg)	Min. Static (in. Wg)	Phase	Power (hp)	RPM	Voltage (V)	FLA	Blower Weight (lbs)
R35XT6P300	5000	500	2.4	0.4	Three Phase	3	1170	208-230/460	5.1/4.8	208.34
R35XT4P1000	6400	500	5.45	0.4	Three Phase	10	1770	208-230/460	26.8-25/12.5	281.42
R35CX4P1000	6400	500	5.45	0.4	Three Phase	10	1760	575	9.55	217.36

Property rights to all drawings, details, representations, ideas, data, notes and specifications either copies or originals thereof that may be incorporated into the design and/or project are the property solely of Plastec ventilation, inc. Permission for any copies of said copyrighted materials, drawings, details, representations, ideas, data, notes and specifications either originals or copies thereof to be made, copied or altered by any person, business, or corporation may only be authorized with the expressed written permission of Plastec ventilation, inc. By the use of this data, the user acknowledges that he/she has read and understand all of the notes included herein.



Performance Curve

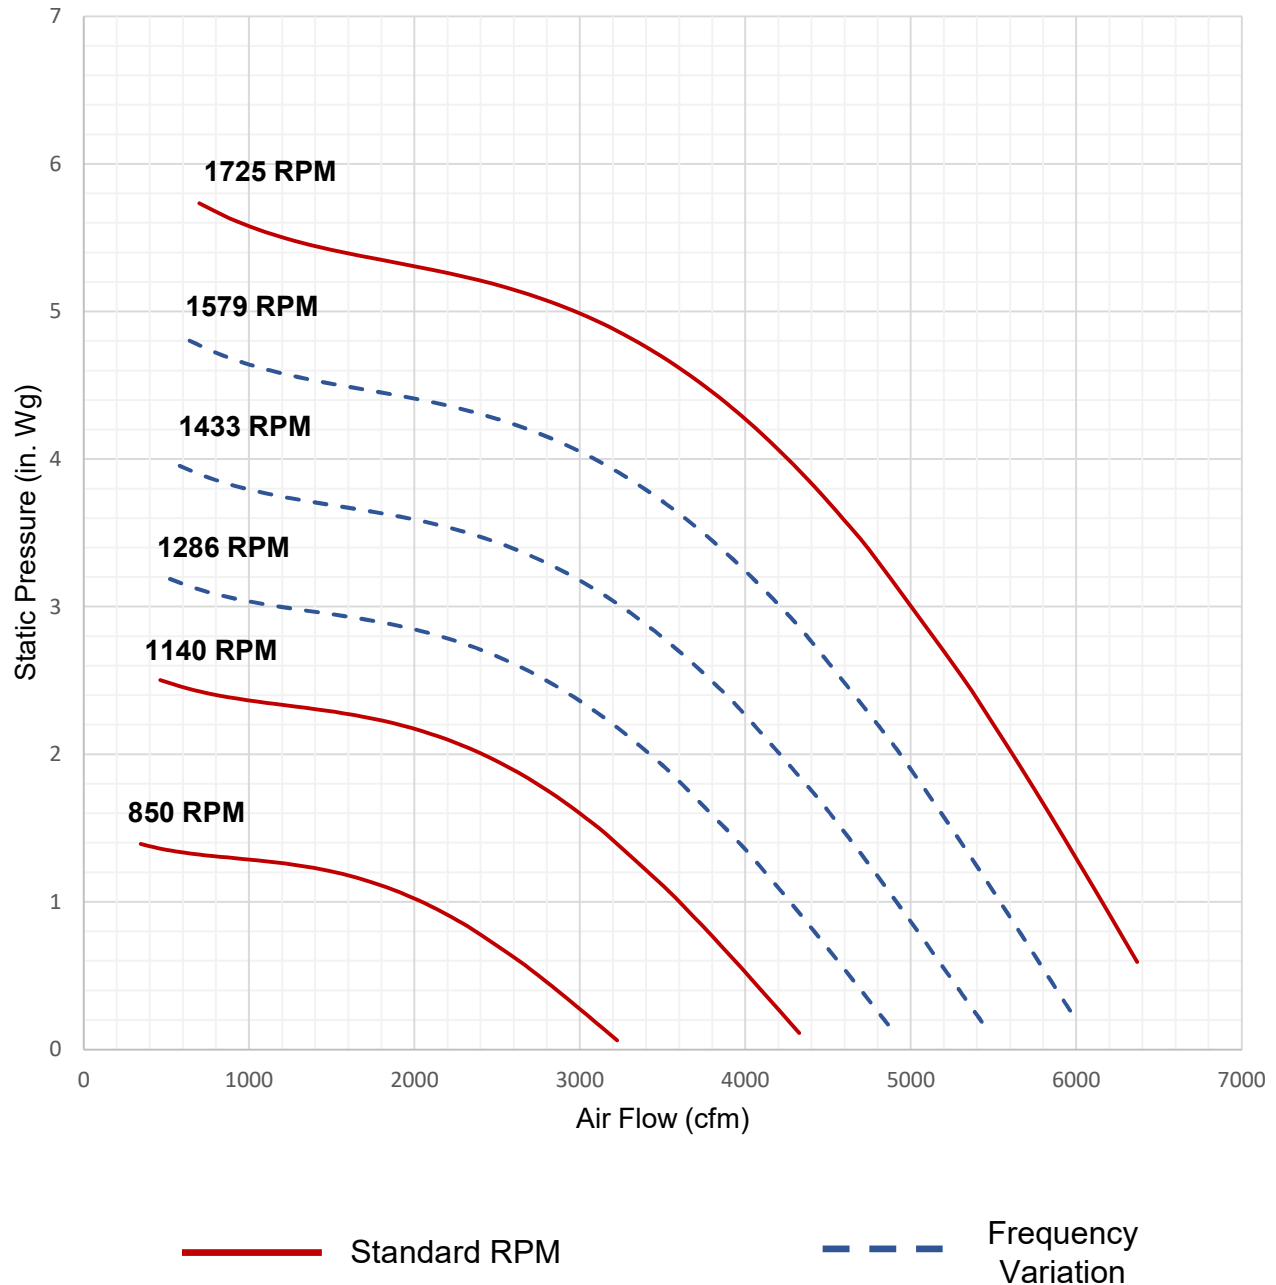

Property rights to all drawings, details, representations, ideas, data, notes and specifications either copies or originals thereof that may be incorporated into the design and/or project are the property solely of Plastec ventilation, inc. Permission for any copies of said copyrighted materials, drawings, details, representations, ideas, data, notes and specifications either originals or copies thereof to be made, copied or altered by any person, business, or corporation may only be authorized with the expressed written permission of Plastec ventilation, inc. By the use of this data, the user acknowledges that he/she has read and understand all of the notes included herein.



ROOF 35

Acoustic Data


		Qv	Ps	Octave Band (Hz)								Lw	Lw(A)	Lp(A)
		(cfm)	(inwg)	63	125	250	500	1000	2000	4000	8000	dB	dB(A)	dB(A)
1725 RPM	Inlet 1	6499	0.01	85.9	91.4	83.1	86.5	86.3	87.1	84.2	79.0	99.7	97.0	95.0
	Inlet 2	4112	3.99	75.9	90.8	82.3	81.8	81.8	80.4	76.7	70.7	96.2	91.7	89.6
	Inlet 3	5520	1.89	89.8	100.0	89.0	85.6	86.6	86.2	83.3	75.7	103.5	97.2	95.1
	Inlet 4	5520	1.89	80.3	90.1	81.6	84.6	84.8	83.9	80.9	75.6	97.7	94.6	92.5
	Outlet 1	6499	0.01	91.8	101.8	91.7	88.0	88.3	90.7	86.5	79.4	105.6	100.0	97.9
	Outlet 2	2042	5.24	85.4	95.5	84.5	82.3	82.4	82.0	77.1	67.8	98.8	92.3	90.3
	Outlet 3	4112	3.99	86.1	100.7	85.9	83.4	84.3	82.9	79.5	71.5	102.9	94.4	92.3
	Outlet 4	2042	5.24	76.8	86.8	78.9	80.2	80.0	78.8	74.1	67.4	94.2	89.6	87.5
1140 RPM	Inlet 1	2717	1.74	66.9	81.8	73.3	72.8	72.9	71.4	67.7	61.8	87.2	82.7	80.6
	Inlet 2	3648	0.82	71.3	81.1	72.6	75.6	75.8	74.9	71.9	66.6	88.7	85.6	83.5
	Inlet 3	4295	0.01	82.8	92.8	82.7	79.0	79.4	81.7	77.5	70.4	96.6	91.0	88.9
	Inlet 4	2717	1.74	77.1	91.7	76.9	74.4	75.3	73.9	70.6	62.5	93.9	85.4	83.3
	Outlet 1	4295	0.01	76.9	82.4	74.1	77.5	77.3	78.1	75.2	70.0	90.7	88.0	86.0
	Outlet 2	1350	2.29	67.8	77.8	69.9	71.2	71.0	69.8	65.1	58.4	85.3	80.6	78.5
	Outlet 3	1350	2.29	76.4	86.5	75.5	73.3	73.4	73.0	68.2	58.9	89.8	83.3	81.3
	Outlet 4	3648	0.82	80.8	91.0	80.0	76.6	77.6	77.2	74.3	66.8	94.5	88.2	86.1
850 RPM	Inlet 1	2026	0.97	60.5	75.5	66.9	66.4	66.5	65.0	61.3	55.4	80.8	76.3	74.3
	Inlet 2	1006	1.27	61.4	71.4	63.6	64.8	64.6	63.4	58.7	52.1	78.9	74.2	72.2
	Inlet 3	2720	0.46	64.9	74.8	66.2	69.2	69.4	68.5	65.5	60.3	82.3	79.2	77.1
	Inlet 4	2026	0.97	70.7	85.3	70.5	68.0	68.9	67.5	64.2	56.1	87.6	79.0	77.0
	Outlet 1	2720	0.46	74.4	84.7	73.7	70.3	71.2	70.8	67.9	60.4	88.2	81.8	79.7
	Outlet 2	1006	1.27	70.0	80.1	69.1	66.9	67.0	66.6	61.8	52.5	83.4	76.9	74.9
	Outlet 3	3202	0.00	70.5	76.0	67.7	71.1	70.9	71.7	68.8	63.6	84.4	81.7	79.6
	Outlet 4	3202	0.00	76.4	86.4	76.3	72.6	73.0	75.3	71.2	64.0	90.2	84.6	82.5

Property rights to all drawings, details, representations, ideas, data, notes and specifications either copies or originals thereof that may be incorporated into the design and/or project are the property solely of Plastec ventilation, inc. Permission for any copies of said copyrighted materials, drawings, details, representations, ideas, data, notes and specifications either originals or copies thereof to be made, copied or altered by any person, business, or corporation may only be authorized with the expressed written permission of Plastec ventilation, inc. By the use of this data, the user acknowledges that he/she has read and understand all of the notes included herein.



ROOF 35

Expanded View

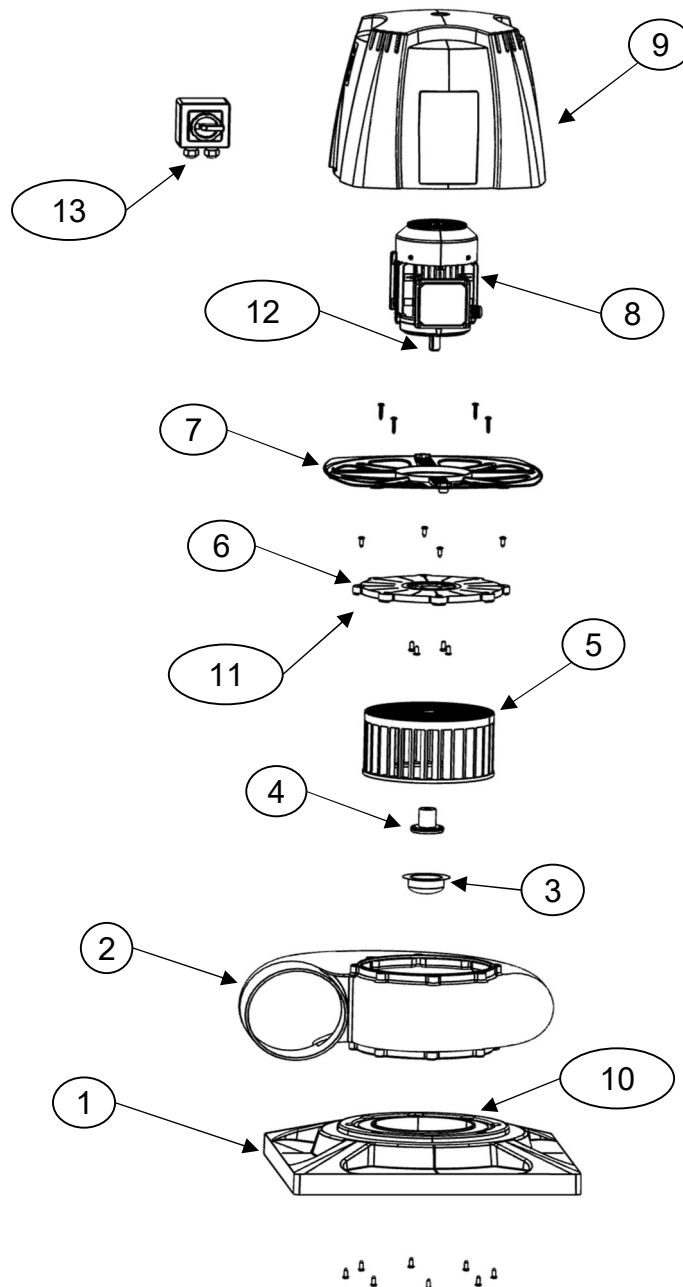

1	Roof Unit Base
2	Housing
3	Hub Cap
4	Hub
5	Impeller
6	Motor Plate
7	Cap Bracket
8	Motor
9	Roof Unit Cap
10	Inlet Gasket
11	Motor Plate Seal
12	Shaft Key
13	Disconnect Switch

Property rights to all drawings, details, representations, ideas, data, notes and specifications either copies or originals thereof that may be incorporated into the design and/or project are the property solely of Plastec ventilation, inc. Permission for any copies of said copyrighted materials, drawings, details, representations, ideas, data, notes and specifications either originals or copies thereof to be made, copied or altered by any person, business, or corporation may only be authorized with the expressed written permission of Plastec ventilation, inc. By the use of this data, the user acknowledges that he/she has read and understand all of the notes included herein.