
# **Submittal**

# **Single Packaged Heat Pump**

4WCA4024C1000A



**Note:** "Graphics in this document are for representation only. Actual model may differ in appearance."

# **Product Specifications**


MODEL	4WCA4024C1000A					
RATED Volts/PH/Hz	208-230/1/60					
Performance Cooling BTUH(a)	23600					
Indoor Airflow (CFM)	815					
Power Input (KW)	2.08					
EER2/SEER2 (BTU/Watt-Hr.)(b)	10.6/13.4					
Sound Power Rating [dB(A)](c)	75.6					
PERFORMANCE HEATING						
(High Temp.) BTUH	23000					
Power Input (KW)	1.85					
(Low Temp.) BTUH	12900					
Power Input (KW)	1.75					
HSPF2 (BTUH/Watt-Hr)	6.7					
POWER CONN. — V/Ph/Hz	208/230/1/60					
Min. Brch. Cir. Ampacity (d)	22					
Fuse Size — Max. (amps)	35					
Fuse Size — Recmd. (amps)	35					
COMPRESSOR	SCROLL					
VOLTS/PH/HZ	208/230/1/60					
R.L. Amps — L.R. Amps	10.3/62					
OUTDOOR COIL — TYPE	PLATE FIN					
Rows/F.P.I	1/16					
Face Area (sq. ft.)	13.2					
Tube Size (in.)	5/16					
Refrigerant Control	EXPANSION VALVE					
INDOOR COIL — TYPE	PLATE FIN					
Rows/F.P.I	3/16					
Face Area (sq. ft.)	4.56					
Tube Size (in.)	5/16					
Refrigeration Control	EXPANSION VALVE					
Drain Conn. Size (in.)	3/4 MALE NPT					
OUTDOOR FAN — TYPE	PROPELLER					

DIA. (IN.)	23					
DRIVE/NO. SPEEDS	DIRECT / 1					
CFM @ 0.0 in. w.g.(e)	3220					
Motor — HP/R.P.M	1/8 / 825					
Volts/Ph/Hz	200/230/1/60					
F.L. Amps/L.R Amps	0.85/1.49					
INDOOR FAN — TYPE	CENTRIFUGAL					
Dia. x Width (in.)	11 X 8					
Drive/No. Speeds	DIRECT / 3					
CFM @ 0.0 in. w.g. <sup>(f)</sup>	SEE FAN PERFORMANCE TABLE					
Motor — HP/R.P.M.	1/2 / VARIABLE					
Volts/Ph/Hz	208-230/1/60					
F.L. Amps	4.6					
FILTER / FURNISHED	NO					
Type Recommended	THROWAWAY					
Recmd. Face Area (sq. ft)(g)	4.0					
REFRIGERANT	R-410A					
Charge (lbs.)	4.4					
CHARGING SPECIFICATIONS						
Subcooling	11°					
DIMENSIONS	HXWXL					
Crated (in.)	40 7/8 x 36 3/8 x 61 1/8					
WEIGHT						
Shipping (lbs.) / Net (lbs.)	455					
	-					


- (a) Rated in accordance with AHRI Standard 210/240.
- (b) Rated in accordance with D.O.E. test procedure.
- (c) Sound Power values are not adjusted for AHRI 270–95 tonal corrections.
- (d) Calculated in accordance with currently prevailing Nat'l Electrical
- (e) Standard Air Dry Coil Outdoor. (f) Standard Air Dry Coil Indoor
- (g) Filters must be installed in return air stream. Square footages listed are based on 300 f.p.m. face velocity. If permanent filters are used size per manufacturer's recommendation with a clean resistance of 0.05" W.C.


# **Outline Drawings**

Figure 1. 2 – 5 Tons

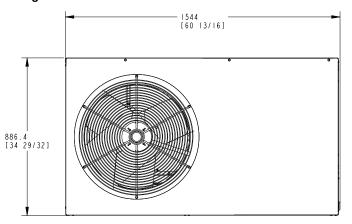


TOP SIDE

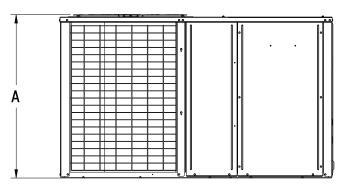

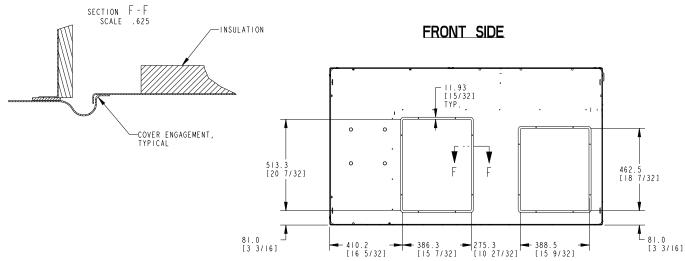

# **BOTTOM SIDE**

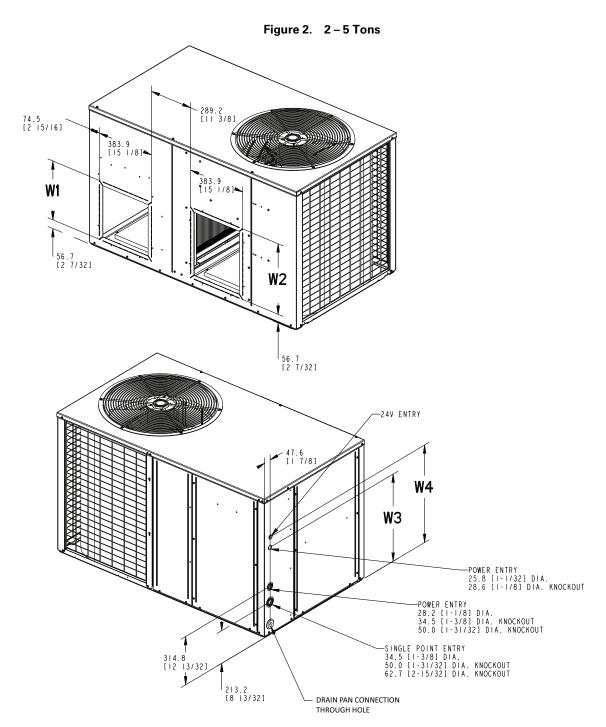

MODEL	HEIGHT MM/IN .					
WODEL	Α	W1	W2	W3	W4	NET WEIGHT/LBS
4WCA4024C	918.8 [36-5/32]	383.9 [15 1/8]	460.1 [18 1/18]	568.8 [22 13/32]	636.1 [25 1/32]	410
4WCA4030C	918.8 [36-5/32]	383.9 [15 1/8]	460.1 [18 1/18]	568.8 [22 13/32]	636.1 [25 1/32]	410
4WCA4036C	918.8 [36-5/32]	383.9 [15 1/8]	460.1 [18 1/18]	568.8 [22 13/32]	636.1 [25 1/32]	430
4WCA4042C	918.8 [36-5/32]	383.9 [15 1/8]	460.1 [18 1/18]	568.8 [22 13/32]	636.1 [25 1/32]	440
4WCA4048C	1045.8 [41-5/32]	460.1 [18 1/8]	510.9 [20 1/8]	645.0 [25 13/32]	712.3 [28 1/32]	460
4WCA4060C	1045.8 [41-5/32]	460.1 [18 1/8]	510.9 [20 1/8]	645.0 [25 13/32]	712.3 [28 1/32]	460

# **Indoor Fan Performance (230v)**

Table 1. Heater Table

Heater	Minimum Heater Airflow CFM
	4WCA4024C1000A
BAYHTR1V05LUGAA	600
BAYHTR1H08LUGAA	820
BAYHTR1H10LUGAA	900

Table 2. Airflow Table


4WCA4024C	ESP	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9	1
	CFM	898	835	773	710						
Low	WATTS	112	119	126	132						
Medium	CFM					947	892	823	761	690	
Medium	WATTS					209	218	227	236	242	
High	CFM										917
	WATTS										386

**Note:** Airflow must not exceed 900 CFM due to condensate blowoff.

# **Full Perimeter Roof Mounting Curb**

Figure 3. 2.0 — 5.0 Ton Models

BAYCURB060A Full Perimeter Roof Mounting Curb

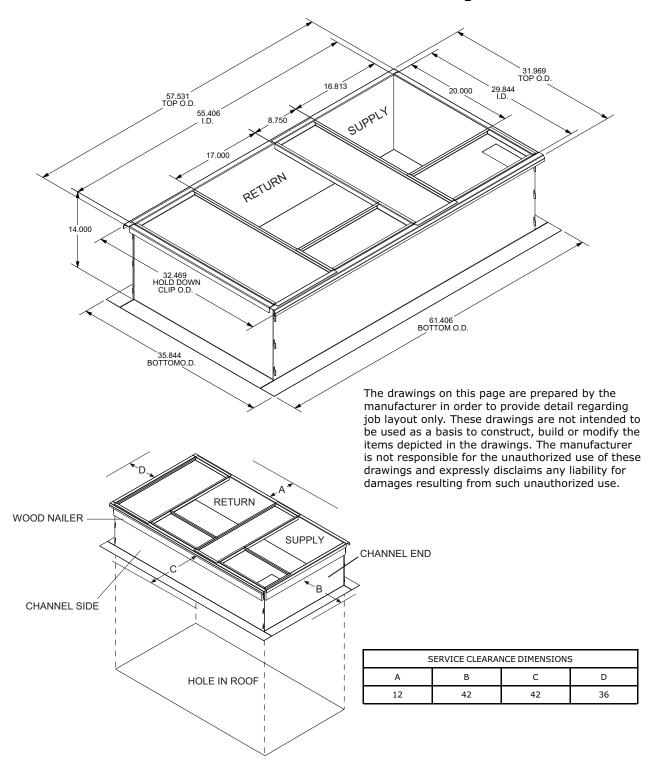

# **Supplementary Electric Heaters**

Table 3. HP Models Only

UNIT MODEL	ELECTRIC HEATER MODEL	RATED VOLT- AGE	PHASE	AMPS	HEATER CAPACITY		NO.	KW/STAGE			MAX. OVER CURRENT
					ĸw	втин	OF STAGES	1	2	MCA	PROTEC- TION DEVICE
4WCA4024*1000A 4WCA4030*1000A	BAYHTR1V05LUGA*	208/240	1	17/ 20	3.6/ 4.8	12300/ 16400	1	3.6/ 4.8	_	22/ 25	25/ 25
4WCA4036*1000A 4WCA4042*1000A	BAYHTR1H08LUGA*	208/240	1	28/ 32	5.76/ 7.68	19700/ 26200	1	5.76/ 7.68	_	35/ 40	35/ 40
4WCA4048*1000A 4WCA4060*1000A	BAYHTR1H10LUGA*	208/240	1	35/ 40	7.2/ 9.6	24600/ 32800	1	7.2/ 9.6	_	43/ 50	45/ 50
4WCA4036*1000A 4WCA4042*1000A 4WCA4048*1000A 4WCA4060*1000A	BAYHTR1H15BRKA*	208/240	1	52/ 60	10.8/ 14.4	36900/ 49100	2	7.2/ 9.6	3.6/ 4.8	65/ 75	70/ 80
4WCA4060*1000A	BAYHTR1H20BRKA*	208/240	1	69/ 80	14.4/ 19.2	49100/ 65500	2	7.2/ 9.6	7.2/ 9.6	87/ 100	90/ 100

<sup>1.</sup> Any power supply and circuits must be wired and protected in accordance with local electrical codes.

ALL VALUES ARE FOR THE ELECTRIC HEATER ONLY

Table 4. BAYSPEK - Single Power Entry Kit

SINGLE CIRCUIT POWER AMPACITY AND OVER CURRENT PROTECTION									
UNIT MODEL	SINGLE POWER ENTRY KIT	HEATER MODEL MIN CKT AMP MAX OVER-CURRENT							
4WCA4024C	BAYSPEK070	BAYHTR1H08	62	70					
	BATSPLKU/U	BAYHTR1H10	72	80					
	BAYSPEK072	BAYHTR1V05	47	50					

The values listed in the above table are for the electric heater only.
 Field wiring must be rated at least 75° C.
 \* indicates an alpha character

# **Mechanical Specifications**

#### General

The units shall be horizontal airflow as shipped and convertible to downflow. All units shall be factory assembled, piped, internally wired and fully charged with refrigerant. Units shall be certified to UL Standard 1995. All units shall be factory run tested to check cooling operation, fan and blower rotation and control or TXV sequence. Units shall be designed to operate at ambient temperatures between 115°F and 55°F in cooling as manufactured. Cooling performance shall be rated in accordance with AHRI standards.

#### **Unit Casing**

All components shall be mounted in a weather-resistant steel cabinet with an enamel finish. Access panels shall be provided for unit controls and indoor coil and fans. Indoor air section compartment shall be completely insulated with fireproof, permanent, odorless fiber material. Knockouts shall be provided for utility and control connections. Drain connections shall be provided to accommodate indoor water runoff.

### Compressor (2 and 2 1/2 Ton Models)

The compressor shall be hermetically sealed, high efficiency rotary compressors. Internal overcurrent and over temperature protection, internal pressure relief shall be standard. Other features include centrifugal oil pump, low vibration and noise.

### Compressor (3-5 Ton Models)

The compressor shall be hermetically sealed, high efficiency scroll compressors. Internal overcurrent and over temperature protection, internal pressure relief shall be standard. Other features include centrifugal oil pump, low vibration and noise.

#### Refrigeration System

All units shall have refrigerant control. Service pressure tap ports and a refrigerant line filter shall be standard.

**Evaporator Coil** Internally enhanced 3/8" OD seamless copper tubing mechanically bonded to aluminum fins, factory pressure and leak tested at 480 – 650 psig. All units have TXV to control refrigerant flow.

#### Condenser Coil

All aluminum micro channel, extruded tubes, mechanically bonded to aluminum fins, and factory pressure and leak tested at 480 – 650 psig.

#### Indoor Air Fan

Constant Torgue, forward-curved, centrifugal wheel in a Metallic Blower housing. Motor shall have thermal overload protection and permanently lubricated motor bearings. Motor/blower assembly isolated from unit with rubber mounts.

#### **Outdoor Fan**

One direct-drive, statically and dynamically balanced propeller fan shall be used in a draw-through vertical discharge configuration. Permanently lubricated weather proof motor shall have built-in thermal overload protection.

### System Controls

System controls include condenser fan, evaporator fan and compressor contactors.

#### Accessories Roof Curb

The roof curb shall be designed to mate with the unit and provide support and complete weathertight installation when properly installed. Adhesive back polyurethane sealing strips shall be provided to ensure an airtight seal between supply and return openings of the curb and unit. The roof curb design allows field fabricated ductwork to be connected directly to the curb. Curb ships knocked down for field assembly, and includes factory installed wood nailer strips.

#### **Electric Heaters**

Each heater assembly shall include power supply fusing if over 48 amps, automatic resetting limit switches and heat limiters for thermal protection. Heaters shall be provided with polarized plugs for quick connection to unit low voltage wiring. Electric heat modules shall be UL listed.

### Single Source Power Entry

This accessory when used with electric heat accessory shall allow single source power connection to unit and heater combination. Single source power entry kits shall have specific matching heater(s). Kit shall include high voltage terminal blocks, fuse blocks and fuses, cut-to-length interconnecting wiring, and junction box (if required) to provide power sources with fuse protection as required for both the unit and accessory heater. Kit components shall install within the heater cabinet in the heater access section. Single source branch power circuit shall be protected and wired in accordance with local codes.

### **Start Kit**

Extra compressor starting capacity for single phase equipment.

### Control Options Standard Indoor Thermostats

Two stage heating/cooling or one stage heating/cooling thermostats shall be available in either manual or automatic changeover.

## **Programmable Electronic Night Setting Thermostat**

Programmable electronic thermostat shall provide heating setback and cooling setup with 7–day programming capability. 1H/1C or 2H/2C models available.

## About Trane and American Standard Heating and Air Conditioning

Trane and American Standard create comfortable, energy efficient indoor environments for residential applications. For more information, please visit www.trane.com or www.americanstandardair.com.





The AHRI Certified mark indicates company participation in the AHRI Certification program. For verification of individual certified products, go to ahridirectory.org.

The manufacturer has a policy of continuous data improvement and it reserves the right to change design and specifications without notice. We are committed to using environmentally conscious print practices.

Supersedes (New) ©2022